


OVERVIEW OF LEAD & COPPER MONITORING REQUIREMENTS FOR SMALL AND MEDIUM SIZED PUBLIC WATER SYSTEMS (INCLUDING COMMUNITY AND NON-TRANSIENT, NON-COMMUNITY SYSTEMS)

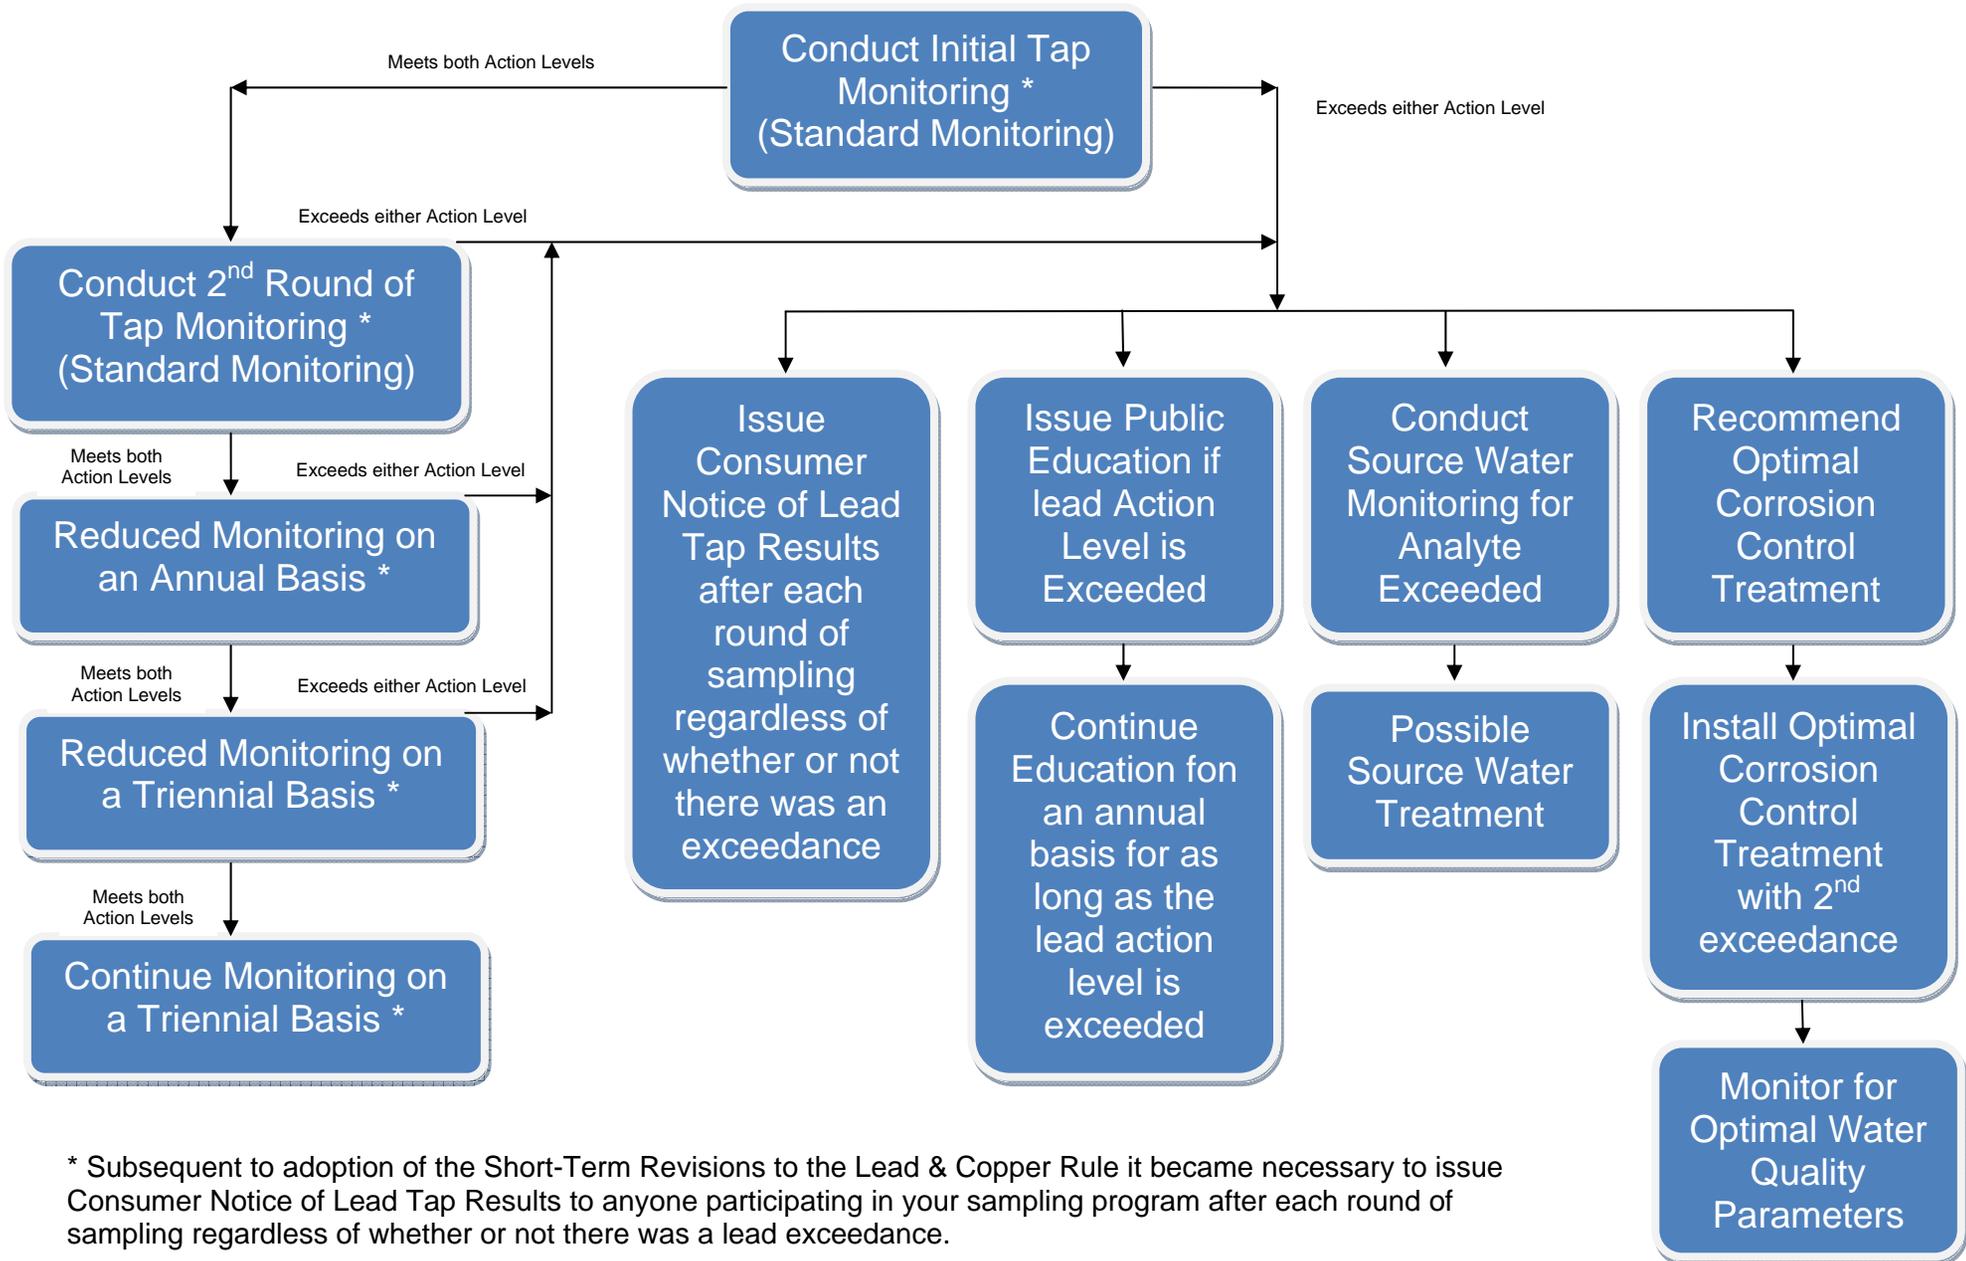

* Subsequent to adoption of the Short-Term Revisions to the Lead & Copper Rule it became necessary to issue Consumer Notice of Lead Tap Results to anyone participating in your sampling program after each round of sampling regardless of whether or not there was a lead exceedance.