

Town of Brattleboro

Stormwater Infrastructure Mapping Project

August 2010



***VTDEC – ECOSYSTEM RESTORATION SECTION
WATERSHED MANAGEMENT DIVISION***

David Ainley, David.Ainley@state.vt.us
Jim Pease, Jim.Pease@state.vt.us

Overview

This stormwater infrastructure mapping project was completed for the municipality by the ANR Clean and Clear program to supplement the existing drainage data collected by the town and with the intention of providing a tool for planning, maintenance, and inspection of the stormwater infrastructure.

The GIS maps and geodatabase are meant to provide an overall picture and understanding of the connectivity or connectedness of the storm system on both public and private properties in order to raise the awareness of the need for regular maintenance. The generation and transport of nonpoint source pollution increases with increasing connectivity of a drainage system. Having an understanding of the connectedness of the system is also a valuable tool for hazardous material spill planning and prevention. Knowledge of the extent of the system is also essential for the detection and elimination of illicit discharges. Outfall locations and system connectedness data are used as a base for locating illicit or illegal discharges of non-stormwater to the municipal storm system and tracing them up to the source. Another benefit of knowing the layout and extent of the stormwater system is the possibility to address existing untreated stormwater discharges. This project provides information and guidance for potential retrofit treatment locations and opportunities. Finally by providing a more thorough understanding of the system it is the hope that this project could be the basis for a local stormwater ordinance or be used to help enhance an existing stormwater management program.

Project Summary

The main goal of this project was to develop up to date municipal drainage maps. These drainage maps were created showing the paths that stormwater runoff travels from where it falls on impervious surfaces such as parking lots, roads, and rooftops, to the outfall points in various receiving waters. These maps show the stormwater infrastructure including things such as pipes, manholes, catchbasins, and swales within a municipality. Data sources included data collected from field work, a mapping grade Trimble GPS unit, available state permit plans, record drawings, town plans, existing GIS data from contractors, and the input and guidance of knowledgeable members from municipalities.

A second goal of this project was to establish potential locations for Best Management Practice (BMP) stormwater retrofit sites. These are sites where stormwater treatment structures could be added and where they would be most cost effective and efficient for sediment and phosphorus or nitrogen removal. In order to develop a retrofit site list, drainage area subwatersheds were delineated around the drainage networks. Determining how the stormwater infrastructure was connected was necessary in determining the subwatershed drainage areas within the town.

Delineating the drainage areas was done using the stormwater infrastructure maps, along with satellite imagery, Digital Elevation Models (DEMs), and topographic maps. These data sources were used to approximate where the land area within each municipality was draining to; as well as where the high points were that divided the sub-drainage areas. The completed maps show the drainage coverage for essentially the entire municipality, but with a focus on areas with more impervious cover. Combining the drainage polygons with an effective impervious connectivity rating (Sutherland, 1995) of the stormwater subwatersheds was the first step in determining potential locations for the best cost/benefit stormwater retrofits.

Impervious cover layers were created using a method of raster pixel calculation, with ArcGIS spatial analyst extension, to create a vegetation index from the National Agricultural Imagery Program (NAIP) 08 orthophotos. The area which contrasted with the vegetation represents impervious surfaces and was then modified with buffered water and roads layers to make it as accurate as possible. A detailed explanation of this process is available in a separate document. The impervious layer was used to calculate the percent of each delineated drainage area that would generate stormwater runoff. This percentage of impervious surface area for each subwatershed was then adjusted with the connectivity rating. This rating depended upon existing stormwater treatment practices for the area and how directly connected the area was to the outfall (Sutherland, 1995), for example whether it went directly into a pipe versus flowing over a grassy area where it would infiltrate.

The drainage areas were selected generally by size and percentage of impervious of the subwatershed, which correlates with the sediment, phosphorus, or nitrogen loads produced. Larger areas that have a greater percentage of their areas as impervious cover were the focus. These subwatershed selections were then modified depending on knowledge gained through field visits, or other available information. After the drainage areas were chosen they were prioritized based on the relative amounts of sediment and phosphorus they could potentially produce. These subwatersheds were given an Action List number ranging from 1 (highest priority) to 3 (lower priority)/ A potential retrofit treatment structure/practice was suggested for each Action List subwatershed, the type of treatment varied depending on availability of potentially “open” land where a treatment structure could be put in place. Availability of “open” land was based solely upon ortho photos and does not indicate land ownership or actual availability.

Water Quality Volume (WQv – the amount of storage needed to treat stormwater from a 0.9 inch storm) and Channel Protection Volume (CPv – the volume of storage that is needed to hold and slowly release stormwater for a 2.1 inch rain event) were also calculated for delineated subwatershed areas. CPv calculations are only applicable if the receiving water is not a large body of water and is therefore susceptible to channel erosion. These numbers were used in the retrofit recommendation process because the volume of water to be treated was a key factor in determining the type of retrofit.

Project References

Schueler, T. 1987. Technical Documentation of a Simple Method for Estimating Urban Storm Pollutant Export. Controlling Urban Runoff: A Practical Manual for Planning and Designing Urban BMPs. Appendix A.

Schueler, T. et.al., 2007. Urban Stormwater Retrofit Practices, Version 1.0. Manual 3, Center for Watershed Protection, August 2007.

Sutherland, R. 1995. Methodology for Estimating the Effective Impervious Area of Urban Watersheds. Technical Note 58 – Pervious Area Management. Watershed Protection Techniques. Vol. 2, No. 1


***All data was created in a ArcGIS 9.3.1 Geodatabase format and is available from VTDEC.**

Long Island Sound – Connecticut River Watershed Nitrogen Overview




- This map shows an overview of the extent of the Connecticut River watershed including areas of Vermont, New Hampshire, Massachusetts, and Connecticut.

New England SPARROW model -- Predicted Sources of Nitrogen Loading in Connecticut River Watershed to LIS

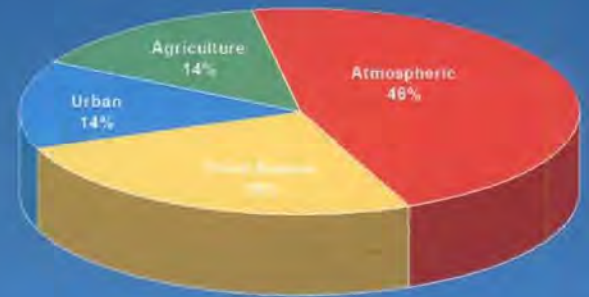

- This figure shows the modeled nitrogen loading contribution per year from the Connecticut River basin to the Long Island Sound.

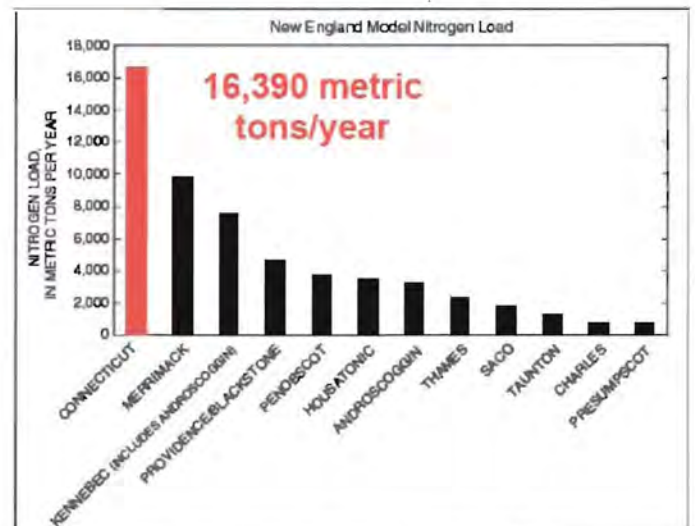

- This graph shows the breakdown of the modeled nitrogen load from the Connecticut River watershed to the Long Island Sound from various sources.

Subwatershed Data

***Tables showing calculations and
Priority drainage area retrofit possibilities***

This is a key showing the abbreviations of the different stormwater treatment structures or practices listed in the calculation sheets.

Abbreviation Key	
Code	Structure Type
BB	Baffle Box
BFCB	Baffled Catchbasin
BR	Bioretention Area (aka Bioretention Filter)
BS	Buffer Strip (25' Min.)
CB	Catch Basin
CBI	Catch Basin Insert
CD	Check Dam
DG	Detention Gallery
DI	Drop Inlet
DP	Dry Pond
DS	Dry Swale
DW	Drywell
EDPMP	Ext.Det.Pond with Micropool (aka Micropool ED Pond)
GS	Grass Swale (aka Open Channel)
IB	Infiltration Basin
IG	Infiltration Gallery
IP	Infiltration Pipe
OF	Overland Flow
OGF	Organic Filter
POP	Pocket Pond
PP	Perforated Pipe Attenuator
RDD	Roof Drain Disconnect
RR	Rock RipRap
RS	RipRap Swale
SB	Sediment Basin (10 YR OR >)
SF	Sand Filter (aka Surface Sand Filter)
SS-SF	Swirl Separator – Sand Filter
ST	Septic Tank
TT	Treatment Tank
WL	Wetland (Constructed)
WP	Wet Pond (Retention)
WS	Wet Swale

Brattleboro - Subwatershed Prioritization and Recommendations (p1)

Watershed Number	Action List #	Proposed Action	Proposed or Existing Stormwater Treatment Practice	Permit Number	Watershed Area (Acres)	Percent Mapped Impervious Area (MIA)	EIA Equation (RANK)	Percent Effective Impervious Area	Water Quality Volume (Acre-Feet)	Channel Protection (Acre-Feet)	# LID-Roof Raingardens to equal WQv	# LID-Roof Raingardens to equal CPv
67	1	CB Cleaning	CB		61.8	61	2	56	2.55	4.15	1275	2074
177	1	EDP	EDP/CB/SW/GS/SB	3987-9010 5116-9003 3415-9010 3693-9010 6339-9003 4859-9003	119.6	54	1	39	3.62	7.06	1811	3530
82	1	Shallow extended detention in I-91 median	EDP/CB/OF		110.3	28	2	21	2.01	3.36	1007	1678
6	1	Maintenance of Kettle Pond for stormwater management	CB/GS/OF/Kettle Pond	5954-9010	135.5	38	5	15	1.84	5.69	922	2847
9	3	Swirl Separator/Sand Filter	SS-SF/CB/DS/IP	3423-9010.A	104.1	45	2	38	3.09	5.14	1546	2572
152	1	EDP	EDP/CB/DW	3255-9010 3022-9010 3022-9003 3291-9010	29.0	73	3	73	1.54	2.33	768	1163
5	3	Swirl Separator/Sand Filter	SS-SF/CB		41.6	43	3	43	1.37	1.98	685	990
4	1	EDP	EDP/CB		40.5	40	2	33	1.07	1.78	534	892
68	1	EDP	EDP/CB/OF		57.4	27	2	21	1.03	1.72	516	860
84	3	Swirl Separator/Sand Filter	SS-SF/CB		57.5	26	2	20	1.01	1.68	504	838
175	3	Swirl Separator/Sand Filter	SS-SF/CB	5604-9003	16.6	82	3	82	0.98	1.50	491	750
36	1	CB Cleaning	CB/OF	4560-9003	26.1	47	2	41	0.82	1.35	408	677
21	3	SWPPP-mostly roof runoff	SWPPP/DI/OF		10.1	94	3	94	0.68	1.05	340	524
173	1	Swirl Separator/Sand Filter / reroute to Conn River	SS-SF/CB	5130-9003	18.1	59	2	53	0.72	1.17	359	586
30	1	CB Cleaning	CB		16.2	59	2	53	0.64	1.05	322	525
14	2	Swirl Separator/Sand Filter	SS-SF/CB/SB	3423-9010.A	59.5	32	2	25	1.24	2.08	622	1042
22	2	SWPPP	SWPPP/CB/OF/W L (natural)		22.3	54	4	35	0.61	1.32	307	661
155	2	Retrofit infiltration system at time of redevelopment	IB/CB		11.4	76	2	72	0.59	0.95	297	473
176	3	Enhanced SWPPP-mostly roof runoff	SWPPP/CB	4432-9003	10.0	90	3	90	0.65	0.99	324	497
57			CB		15.2	57	2	51	0.58	0.95	291	476
209			CB/GS		34.5	32	1	18	0.55	1.21	275	606
69			CB		36.5	22	2	16	0.54	0.89	271	444
178			CB/SB	3987-9010 4845-9003	20.4	76	5	58	0.87	1.70	435	852
88			CB		14.5	44	3	44	0.49	0.70	243	352
196			CB		67.5	8	2	5	0.49	0.62	243	309
184			GS/OF		12.9	62	1	48	0.47	0.87	235	437
171			OF/CB		12.8	52	2	46	0.44	0.73	222	366
153			CB		8.0	79	2	76	0.44	0.70	222	351
24			CB/GS/OF/DS		34.9	28	4	11	0.40	1.07	200	533
61			CB/OF		16.4	37	2	30	0.40	0.66	198	331
190			CB/OF		21.1	22	3	22	0.39	0.50	193	251

Brattleboro - Subwatershed Prioritization and Recommendations (p1) cont.

Watershed Number	Action List #	Proposed or Existing Stormwater Treatment Practice	Landuse	IF Landuse is Residential: number of Raingardens needed to treat WQv	Raingarden Cost	IF Landuse is residential AND receiving water is small: number of raingardens needed to treat CPv	Raingarden Cost	IF Landuse is Commercial, Industrial, Residential, or Transportation: WQv retrofit cost (1)	IF Landuse is Commercial, Industrial, Residential, or Transportation AND receiving water is small: CPv retrofit cost (2)
67	1	CB	Residential	1275	\$586,286			To be determined	
177	1	EDP/CB/SW/GS/SB	Industrial					\$1,104,448	
82	1	EDP/CB/OF	Trans					\$614,196	
6	1	CB/GS/OF/Kettle Pond	Commercial					To be determined	
9	3	SS-SF/CB/DS/IP	Residential	1546	\$711,346			\$6,129,973	
152	1	EDP/CB/DW	Commercial					\$468,509	
5	3	SS-SF/CB	Residential	685	\$315,219	990	\$455,247	\$5,432,746	\$7,846,110
4	1	EDP/CB	Commercial					\$325,425	
68	1	EDP/CB/OF	Residential	516	\$237,496	860	\$395,481	\$314,863	\$524,312
84	3	SS-SF/CB	Residential	504	\$231,724			\$1,996,862	
175	3	SS-SF/CB	Industrial					\$3,895,897	
36	1	CB/OF	Residential	408	\$187,817			To be determined	
21	3	SWPPP/DI/OF	Industrial					\$2,500	
173	1	SS-SF/CB	Industrial					\$2,847,814	
30	1	CB	Residential	322	\$147,912				
14	2	SS-SF/CB/SB	Residential	622	\$286,265			\$2,466,863	
22	2	SWPPP/CB/OF/WL (natural)	Industrial					\$2,500	
155	2	IB/CB	Commercial					\$102,465	
176	3	SWPPP/CB	Industrial					\$2,500	
57		CB							
209		CB/GS							
69		CB							
178		CB/SB							
88		CB							
196		CB							
184		GS/OF							
171		OF/CB							
153		CB							
24		CB/GS/OF/DS							
61		CB/OF							
190		CB/OF							

Brattleboro - Subwatershed Prioritization and Recommendations (p2)

Watershed Number	Action List #	Proposed Action	Proposed or Existing Stormwater Treatment Practice	Permit Number	Watershed Area (Acres)	Percent Mapped Impervious Area (MIA)	EIA Equation (RANK)	Percent Effective Impervious Area	Water Quality Volume (Acre-Feet)	Channel Protection (Acre-Feet)	# LID-Roof Raingardens to equal WQv	# LID-Roof Raingardens to equal CPv
186			SB/CB/OF	4859-9003	76.3	26	1	13	0.96	2.17	482	1085
29			CB		7.3	69	3	69	0.37	0.56	185	279
72			OF		23.2	32	1	18	0.37	0.81	183	404
19			OF/WP/WL(natural)	4387-9003	15.1	78	4	65	0.72	1.29	362	645
164			OF		7.0	79	1	71	0.36	0.61	181	307
106			CB/GS		13.1	48	1	33	0.34	0.69	170	344
81			OF		22.7	30	1	17	0.34	0.76	170	378
132	2	Bioretention	BR/CB/GS		12.7	49	1	34	0.34	0.68	169	340
143			DW/IIG/CB	3027-9010	16.6	74	5	55	0.68	1.35	338	676
96			CB		6.3	73	3	73	0.34	0.51	169	255
104			CB		7.0	68	2	63	0.32	0.52	162	262
111			CB/OF		15.3	31	2	24	0.31	0.52	155	259
198			CB		22.9	20	2	14	0.31	0.49	153	247
39	1	Expanded Detention Basin/Combine with 40, 37	EDP/CB		8.0	51	3	51	0.30	0.44	151	222
194			CB		29.4	14	2	9	0.30	0.45	150	227
204			OF/GS/WP	3304-9010	114.7	8	5	1	0.48	1.06	242	531
110			CB/OF		13.7	32	2	26	0.29	0.49	145	243
189			OF		13.3	41	1	26	0.29	0.60	144	302
97			CB		4.4	88	3	88	0.28	0.43	139	213
128			CB/OF		6.2	64	2	59	0.27	0.44	135	219
101			CB		5.9	66	2	61	0.27	0.43	133	214
141			CB	3293-9010	12.7	61	2	56	0.52	0.85	261	425
125			CB/OF		24.1	21	1	10	0.25	0.57	125	283
91			CB		5.0	66	3	66	0.24	0.36	121	181
119			CB/GS/OF		14.4	24	2	19	0.23	0.39	117	193
151			DW/SB/OF	3957-9010.1	26.2	45	5	21	0.46	1.31	231	654
134			CB/OF		3.9	85	2	82	0.23	0.36	115	181
23			CB/OF/WL(natural)		5.0	75	4	62	0.23	0.42	114	208
99			CB/OF		5.6	67	1	55	0.23	0.41	114	206
83			OF		42.9	8	1	2	0.22	0.36	111	179
26			OF		8.3	48	1	33	0.22	0.44	110	221
156			CB		5.8	55	2	49	0.22	0.35	108	177
37	1	Extended Detention Basin/Combine with 39, 37	EDP/CB/OF	4560-9003	4.8	70	2	65	0.23	0.37	116	186
121			CB/OF		39.4	8	1	2	0.20	0.33	102	167
192			CB/SS		7.2	77	4	65	0.34	0.61	170	304
43			CB		3.1	88	3	88	0.20	0.31	100	153
166			CB		9.2	33	2	26	0.20	0.33	99	166
207			CB/GS		22.3	18	1	8	0.20	0.44	99	220
185			CB/SB		35.7	19	1	8	0.33	0.74	165	368
16			CB		11.8	33	1	19	0.20	0.43	98	215
27			CB		4.9	57	2	51	0.19	0.31	94	154
75			OF		15.9	21	1	10	0.16	0.37	82	185
7			CB		3.4	70	2	66	0.16	0.26	81	131
202			CB/GS		14.5	23	1	11	0.16	0.37	81	184

Brattleboro - Subwatershed Prioritization and Recommendations (p2) cont.

Watershed Number	Action List #	Proposed or Existing Stormwater Treatment Practice	Landuse	IF Landuse is Residential: number of Raingardens needed to treat WQv	Raingarden Cost	IF Landuse is residential AND receiving water is small: number of raingardens needed to treat CPv	Raingarden Cost	IF Landuse is Commercial, Industrial, Residential, or Transportation: WQv retrofit cost (1)	IF Landuse is Commercial, Industrial, Residential, or Transportation AND receiving water is small: CPv retrofit cost (2)
186		SB/CB/OF							
29		CB							
72		OF							
19		OF/WP/WL(natural)							
164		OF							
106		CB/GS							
81		OF							
132	2	BR/CB/GS	Commercial					\$77,904	
143		DW/G/CB							
96		CB							
104		CB							
111		CB/OF							
198		CB							
39	1	EDP/CB	Commercial					\$179,023	
194		CB							
204		OF/GS/WP							
110		CB/OF							
189		OF							
97		CB							
128		CB/OF							
101		CB							
141		CB							
125		CB/OF							
91		CB							
119		CB/GS/OF							
151		DW/SB/OF							
134		CB/OF							
23		CB/OF/WL(natural)							
99		CB/OF							
83		OF							
26		OF							
156		CB							
37	1	EDP/CB/OF							
121		CB/OF							
192		CB/SS							
43		CB							
166		CB							
207		CB/GS							
185		CB/SB							
16		CB							
27		CB							
75		OF							
7		CB							
202		CB/GS							

Brattleboro - Subwatershed Prioritization and Recommendations (p3)

Watershed Number	Action List #	Proposed Action	Proposed or Existing Stormwater Treatment Practice	Permit Number	Watershed Area (Acres)	Percent Mapped Impervious Area (MIA)	EIA Equation (RANK)	Percent Effective Impervious Area	Water Quality Volume (Acre-Feet)	Channel Protection (Acre-Feet)	# LID-Roof Raingardens to equal WQv	# LID-Roof Raingardens to equal CPv
2			CB/GS/OF/IB	5954-9010	10.3	58	4	40	0.32	0.66	159	331
47			OF	4384-9003	2.5	100	3	100	0.18	0.27	88	136
38			CB		7.0	33	2	27	0.15	0.26	76	128
46			OF	4384-9003	2.4	98	3	98	0.17	0.26	84	129
31			CB		5.8	40	2	33	0.15	0.25	75	126
78			CB/GS		11.3	27	1	14	0.15	0.34	75	168
17			CB/WL(natural)		8.2	40	4	22	0.15	0.36	75	181
59			CB		4.4	48	2	42	0.14	0.23	70	116
18			CBWS/OF	6182-9010	9.0	39	4	20	0.16	0.38	78	192
208			OF/GS		31.4	5	1	1	0.14	0.16	70	81
80	1	RS/erosion	RS/CB		4.7	44	2	38	0.14	0.23	69	115
154			OF		11.6	24	1	12	0.14	0.31	69	156
188			OF/GS		8.8	31	1	17	0.13	0.30	67	149
34			CB/GS		7.4	35	1	21	0.13	0.29	66	143
115			OF		11.4	23	1	11	0.13	0.29	64	144
180			CB/WP	4299-9010	8.3	63	5	40	0.25	0.57	126	286
20			OF/GS/WL(natural)		3.1	70	4	54	0.12	0.24	62	118
35			CB		4.4	43	2	36	0.12	0.21	62	103
73			CB		5.6	33	2	26	0.12	0.20	60	100
120			CB/GS/IP/SB/DP		42.6	16	5	3	0.24	0.77	119	385
44			CB		2.5	63	3	63	0.11	0.17	57	86
191			IG/CB		3.1	86	2	83	0.19	0.29	94	147
50			CB		1.7	90	3	90	0.11	0.17	55	84
116			OF		9.9	22	1	11	0.11	0.24	54	122
205			GS/OF	3244-9010	8.3	51	5	26	0.18	0.47	89	234
51			CB		1.5	99	3	99	0.11	0.16	53	81
107			CB/OF		7.7	28	1	15	0.11	0.24	53	118
15			CB/SB	3423-9010.A	6.3	65	5	42	0.20	0.45	102	225
41			CB		2.4	62	2	56	0.10	0.16	51	82
206			GS/WP	3244-9010 6044-9003 3742-9010 3303-9003 3303-9010 3801-9010	58.8	27	5	7	0.50	1.73	252	865
163			CB		2.1	67	2	62	0.10	0.15	48	77
49			OF	4384-9003	1.6	94	2	93	0.10	0.16	52	81
52			OF		2.6	61	1	48	0.09	0.17	46	87
203			CB		7.5	25	1	13	0.09	0.21	46	105
126			OF		2.2	58	3	58	0.09	0.14	46	68
13			CB/DS/IG	3423-9010.A	3.7	80	5	63	0.17	0.32	86	162
137			OF		13.3	12	1	4	0.09	0.17	43	85
129			OF		5.1	33	1	19	0.09	0.19	43	94
146			DW/OF		2.9	91	5	82	0.17	0.29	85	143
12			RD/DW/IP		2.5	98	5	96	0.17	0.27	85	133
138			OF		4.6	35	1	21	0.08	0.18	41	89

Brattleboro - Subwatershed Prioritization and Recommendations (p3) cont.

Watershed Number	Action List #	Proposed or Existing Stormwater Treatment Practice	Landuse	IF Landuse is Residential: number of Raingardens needed to treat WQv	Raingarden Cost	IF Landuse is residential AND receiving water is small: number of raingardens needed to treat CPv	Raingarden Cost	IF Landuse is Commercial, Industrial, Residential, or Transportation: WQv retrofit cost (1)	IF Landuse is Commercial, Industrial, Residential, or Transportation AND receiving water is small: CPv retrofit cost (2)
2		CB/GS/OF/IB							
47		OF							
38		CB							
46		OF							
31		CB							
78		CB/GS							
17		CB/WL(natural)							
59		CB							
18		CB/WS/OF							
208		OF/GS							
80	1	RS/CB	Residential	69	\$31,801			\$5,000	
154		OF							
188		OF/GS							
34		CB/GS							
115		OF							
180		CB/WP							
20		OF/GS/WL(natural)							
35		CB							
73		CB							
120		CB/GS/IP/SB/DP							
44		CB							
191		IG/CB							
50		CB							
116		OF							
205		GS/OF							
51		CB							
107		CB/OF							
15		CB/SB							
41		CB							
206		GS/WP							
163		CB							
49		OF							
52		OF							
203		CB							
126		OF							
13		CB/DS/IG							
137		OF							
129		OF							
146		DW/OF							
12		RD/DW/IP							
138		OF							

Brattleboro - Subwatershed Prioritization and Recommendations (p4)

Watershed Number	Action List #	Proposed Action	Proposed or Existing Stormwater Treatment Practice	Permit Number	Watershed Area (Acres)	Percent Mapped Impervious Area (MIA)	EIA Equation (RANK)	Percent Effective Impervious Area	Water Quality Volume (Acre-Feet)	Channel Protection (Acre-Feet)	# LID-Roof Raingardens to equal WQv	# LID-Roof Raingardens to equal CpV
8			OF/GS		1.6	79	1	70	0.08	0.14	40	69
1			GS/DS/CB/DP/DG	5953-9010	12.7	36	5	13	0.16	0.50	79	251
183			OF		2.6	52	1	38	0.08	0.15	38	75
109			OF		5.0	31	1	17	0.08	0.17	38	84
25			CB		3.0	38	2	31	0.07	0.13	37	63
92			CB/GS		6.7	23	1	11	0.07	0.17	37	84
157			DW/SB/OF		4.9	62	5	39	0.15	0.34	74	169
79			OF		3.8	36	1	21	0.07	0.15	35	75
182			CB		1.1	87	3	87	0.07	0.11	35	53
187			OF		2.9	43	1	28	0.07	0.14	33	69
95			OF		2.2	51	1	36	0.06	0.12	31	61
90			CB		1.7	55	2	49	0.06	0.10	31	50
172			OF		8.9	13	1	5	0.06	0.13	30	63
140			CB/OF		9.5	10	1	3	0.06	0.11	29	55
127			CB/OF		1.1	72	3	72	0.06	0.09	29	43
168			OF		1.2	76	1	67	0.06	0.10	28	49
66			OF		5.1	22	1	11	0.06	0.13	28	63
169			OF		4.6	24	1	12	0.05	0.12	27	61
114			OF		3.7	26	1	13	0.05	0.11	23	53
133			DW/OF		2.0	78	5	61	0.09	0.17	46	87
65			CB		1.5	45	2	39	0.04	0.07	22	37
135	2	Extended Detention Basin	EDP/CB/SB		4.1	52	5	27	0.09	0.23	44	116
105			OF		3.2	28	1	15	0.04	0.10	22	49
148			DW/CB/SB	3257-9010	1.7	85	5	72	0.09	0.16	44	79
131			OF		8.4	7	1	2	0.04	0.06	21	31
150			OF/SB	3816-9010	4.4	47	5	22	0.08	0.23	41	114
42			OF		3.5	23	1	11	0.04	0.09	20	45
102			DW		1.5	85	5	73	0.08	0.14	40	71
117	3	Modify existing permitted basin to extended detention	EDP/CB/GS/OF/R	3375-9010	8.6	28	5	8	0.08	0.27	39	133
98			S/DP		0.6	92	3	92	0.04	0.06	19	30
89			OF		2.7	29	1	16	0.04	0.08	19	42
195			CB		4.8	10	2	6	0.04	0.05	19	26
32			CB/GS		1.1	50	2	44	0.04	0.06	19	31
112			CB		0.7	71	3	71	0.04	0.06	18	28
70			CB/GS/OF/RS	4040-9010	1.7	62	2	57	0.07	0.11	35	57
77			GS		5.2	12	1	4	0.03	0.07	17	35
113			CB		0.6	77	3	77	0.03	0.05	17	26
199			IG/PP/GS	3596-9015	41.8	6	5	0	0.17	0.28	84	139
71			CB		0.8	63	2	58	0.03	0.05	17	27
48			OF	4384-9003	0.6	82	2	79	0.04	0.06	18	28
118			CB		0.7	72	2	68	0.03	0.05	16	26
130			DW		1.8	68	5	47	0.06	0.13	31	67
174			DW/IB		4.0	73	5	53	0.16	0.32	78	159
103			DW		1.1	88	5	77	0.06	0.11	31	54
94			CB/GS	5108-9015	4.8	55	1	41	0.15	0.29	75	145

Brattleboro - Subwatershed Prioritization and Recommendations (p4) cont.

Watershed Number	Action List #	Proposed or Existing Stormwater Treatment Practice	Landuse	IF Landuse is Residential: number of Raingardens needed to treat WQv	Raingarden Cost	IF Landuse is residential AND receiving water is small: number of raingardens needed to treat CPv	Raingarden Cost	IF Landuse is Commercial, Industrial, Residential, or Transportation: WQv retrofit cost (1)	IF Landuse is Commercial, Industrial, Residential, or Transportation AND receiving water is small: CPv retrofit cost (2)
8		OF/GS							
1		GS/DS/CB/DP/DG							
183		OF							
109		OF							
25		CB							
92		CB/GS							
157		DW/SB/OF							
79		OF							
182		CB							
187		OF							
95		OF							
90		CB							
172		OF							
140		CB/OF							
127		CB/OF							
168		OF							
66		OF							
169		OF							
114		OF							
133		DW/OF							
65		CB							
135	2	EDP/CB/SB	Commercial					\$27,132	
105		OF							
148		DW/CB/SB							
131		OF							
150		OF/SB							
42		OF							
102		DW							
117	3	EDP/CB/GS/OF/RS/	Residential	39	\$17,935	133	\$61,072	\$13,452	\$45,804
98		OF							
89		OF							
195		CB							
32		CB/GS							
112		CB							
70		CB/GS/OF/RS							
77		GS							
113		CB							
199		IG/PP/GS							
71		CB							
48		OF							
118		CB							
130		DW							
174		DW/IB							
103		DW							
94		CB/GS							

Brattleboro - Subwatershed Prioritization and Recommendations (p5)

Watershed Number	Action List #	Proposed Action	Proposed or Existing Stormwater Treatment Practice	Permit Number	Watershed Area (Acres)	Percent Mapped Impervious Area (MIA)	EIA Equation (RANK)	Percent Effective Impervious Area	Water Quality Volume (Acre-Feet)	Channel Protection (Acre-Feet)	# LID-Roof Raingardens to equal WQv	# LID-Roof Raingardens to equal CPv
33			GS/OF		3.0	20	1	9	0.03	0.07	15	33
181			CB/IG		3.0	81	5	66	0.15	0.27	73	134
60			OF		1.7	33	1	19	0.03	0.06	14	31
197			CB		6.4	5	1	1	0.03	0.03	14	17
167			OF/SD		0.7	63	2	58	0.03	0.05	14	23
64			CB		0.8	49	2	43	0.03	0.05	14	23
45			CB		0.4	88	3	88	0.03	0.04	14	21
201			IG/PP/GS	3596-9015 5768-9015	30.0	11	5	1	0.14	0.35	68	175
40	I	Complete with 39, 37	EDP/OF/CB/WP		3.1	38	4	20	0.05	0.13	26	66
136			DW		2.4	51	5	26	0.05	0.14	26	68
62			CB		0.5	75	3	75	0.03	0.04	13	19
139			CB/SB		1.6	64	5	41	0.05	0.11	25	56
162			SB/DW		1.3	72	5	52	0.05	0.10	25	50
142			DW		1.9	56	5	32	0.05	0.12	23	58
53			OF		0.9	47	1	33	0.02	0.05	11	23
122			DW		1.8	56	5	31	0.04	0.11	22	55
149			OF/SB	3816-9010	4.3	31	5	9	0.04	0.14	22	72
11			CB/DW/IB		1.9	53	5	29	0.04	0.11	21	55
108			DW		2.3	46	5	22	0.04	0.12	21	58
58			OF		0.5	65	1	53	0.02	0.04	10	19
147			DW	3291-9010	0.6	96	5	92	0.04	0.06	20	32
165			CB/IG	4021-9015	2.7	69	5	48	0.10	0.20	48	101
193			OF/SD		0.8	43	1	28	0.02	0.04	9	19
145			DW/CB		0.6	91	5	83	0.04	0.06	18	30
161			CB/IG		1.0	67	5	45	0.04	0.08	18	38
123			DW		0.5	103	5	105	0.03	0.05	17	26
76			OF		1.6	22	1	10	0.02	0.04	8	19
158			DW		1.8	47	5	22	0.03	0.09	17	46
159			DW		0.7	82	5	68	0.03	0.06	17	30
179			DW		0.8	74	5	54	0.03	0.06	16	32
74			CB		0.7	34	2	28	0.02	0.03	8	13
200			IG/PP/GS	3596-9015 6233-9015	13.6	16	5	3	0.08	0.25	38	123
54			CB/BR	NOT BUILT	1.1	92	2	91	0.07	0.11	35	55
93			CB/GS/DP/IB	5108-9015	9.6	22	5	5	0.07	0.24	34	119
144			EDP/DW/CB	3946-9010 3946-9015	2.2	59	5	35	0.06	0.14	30	72
160			DW/SB/OF		1.9	36	5	13	0.02	0.07	12	37
56			CB/BR	6233-9015 NOT BUILT	0.7	91	3	91	0.05	0.07	24	37
10			CB/DW		0.5	71	5	50	0.02	0.04	9	19
63			CB/DW		0.9	50	5	25	0.02	0.05	9	24
28			CB/DW		1.0	46	5	21	0.02	0.05	9	25
86			OF/WP		1.8	30	5	9	0.02	0.06	9	29
87			DW		1.4	34	5	12	0.02	0.05	8	27

Brattleboro - Subwatershed Prioritization and Recommendations (p5) cont.

Watershed Number	Action List #	Proposed or Existing Stormwater Treatment Practice	Landuse	IF Landuse is Residential: number of Raingardens needed to treat WQv	Raingarden Cost	IF Landuse is residential AND receiving water is small: number of raingardens needed to treat CPv	Raingarden Cost	IF Landuse is Commercial, Industrial, Residential, or Transportation: WQv retrofit cost (1)	IF Landuse is Commercial, Industrial, Residential, or Transportation AND receiving water is small: CPv retrofit cost (2)
33		GS/OF							
181		CB/IG							
60		OF							
197		CB							
167		OF/SD							
64		CB							
45		CB							
201		IG/PP/GS							
40	1	EDP/OF/CB/WP	Forest						
136		DW							
62		CB							
139		CB/SB							
162		SB/DW							
142		DW							
53		OF							
122		DW							
149		OF/SB							
11		CB/DW/IB							
108		DW							
58		OF							
147		DW							
165		CB/IG							
193		OF/SD							
145		DW/CB							
161		CB/IG							
123		DW							
76		OF							
158		DW							
159		DW							
179		DW							
74		CB							
200		IG/PP/GS							
54		CB/BR							
93		CB/GS/DP/IB							
144		EDP/DW/CB							
160		DW/SB/OF							
56		CB/BR							
10		CB/DW							
63		CB/DW							
28		CB/DW							
86		OF/WP							
87		DW							

Brattleboro - Subwatershed Prioritization and Recommendations (p6)


Watershed Number	Action List #	Proposed Action	Proposed or Existing Stormwater Treatment Practice	Permit Number	Watershed Area (Acres)	Percent Mapped Impervious Area (MIA)	EIA Equation (RANK)	Percent Effective Impervious Area	Water Quality Volume (Acre-Feet)	Channel Protection (Acre-Feet)	# LID-Roof Raingardens to equal WQv	# LID-Roof Raingardens to equal CPv
170			OF		0.9	16	1	6	0.01	0.02	4	8
85			DW		0.3	77	5	59	0.01	0.02	6	11
3			CB/GS/OF/IB	5954-9010	1.3	26	5	7	0.01	0.04	5	18
55			OF/BR	6233-9015 NOT BUILT	0.5	65	3	65	0.02	0.03	11	16
100			DW		0.1	79	5	63	0.01	0.01	3	6
124			DW		0.1	38	5	15	0.00	0.00	1	2
3000					3.4	76	0		0.00	0.29	0	144
TOTALS					2,675.3				57.11	106.63		

Target Maps

***Showing Priority Action List
Drainage Areas***

And Potential Retrofit Locations

Brattleboro: Action List Drainage Area #4

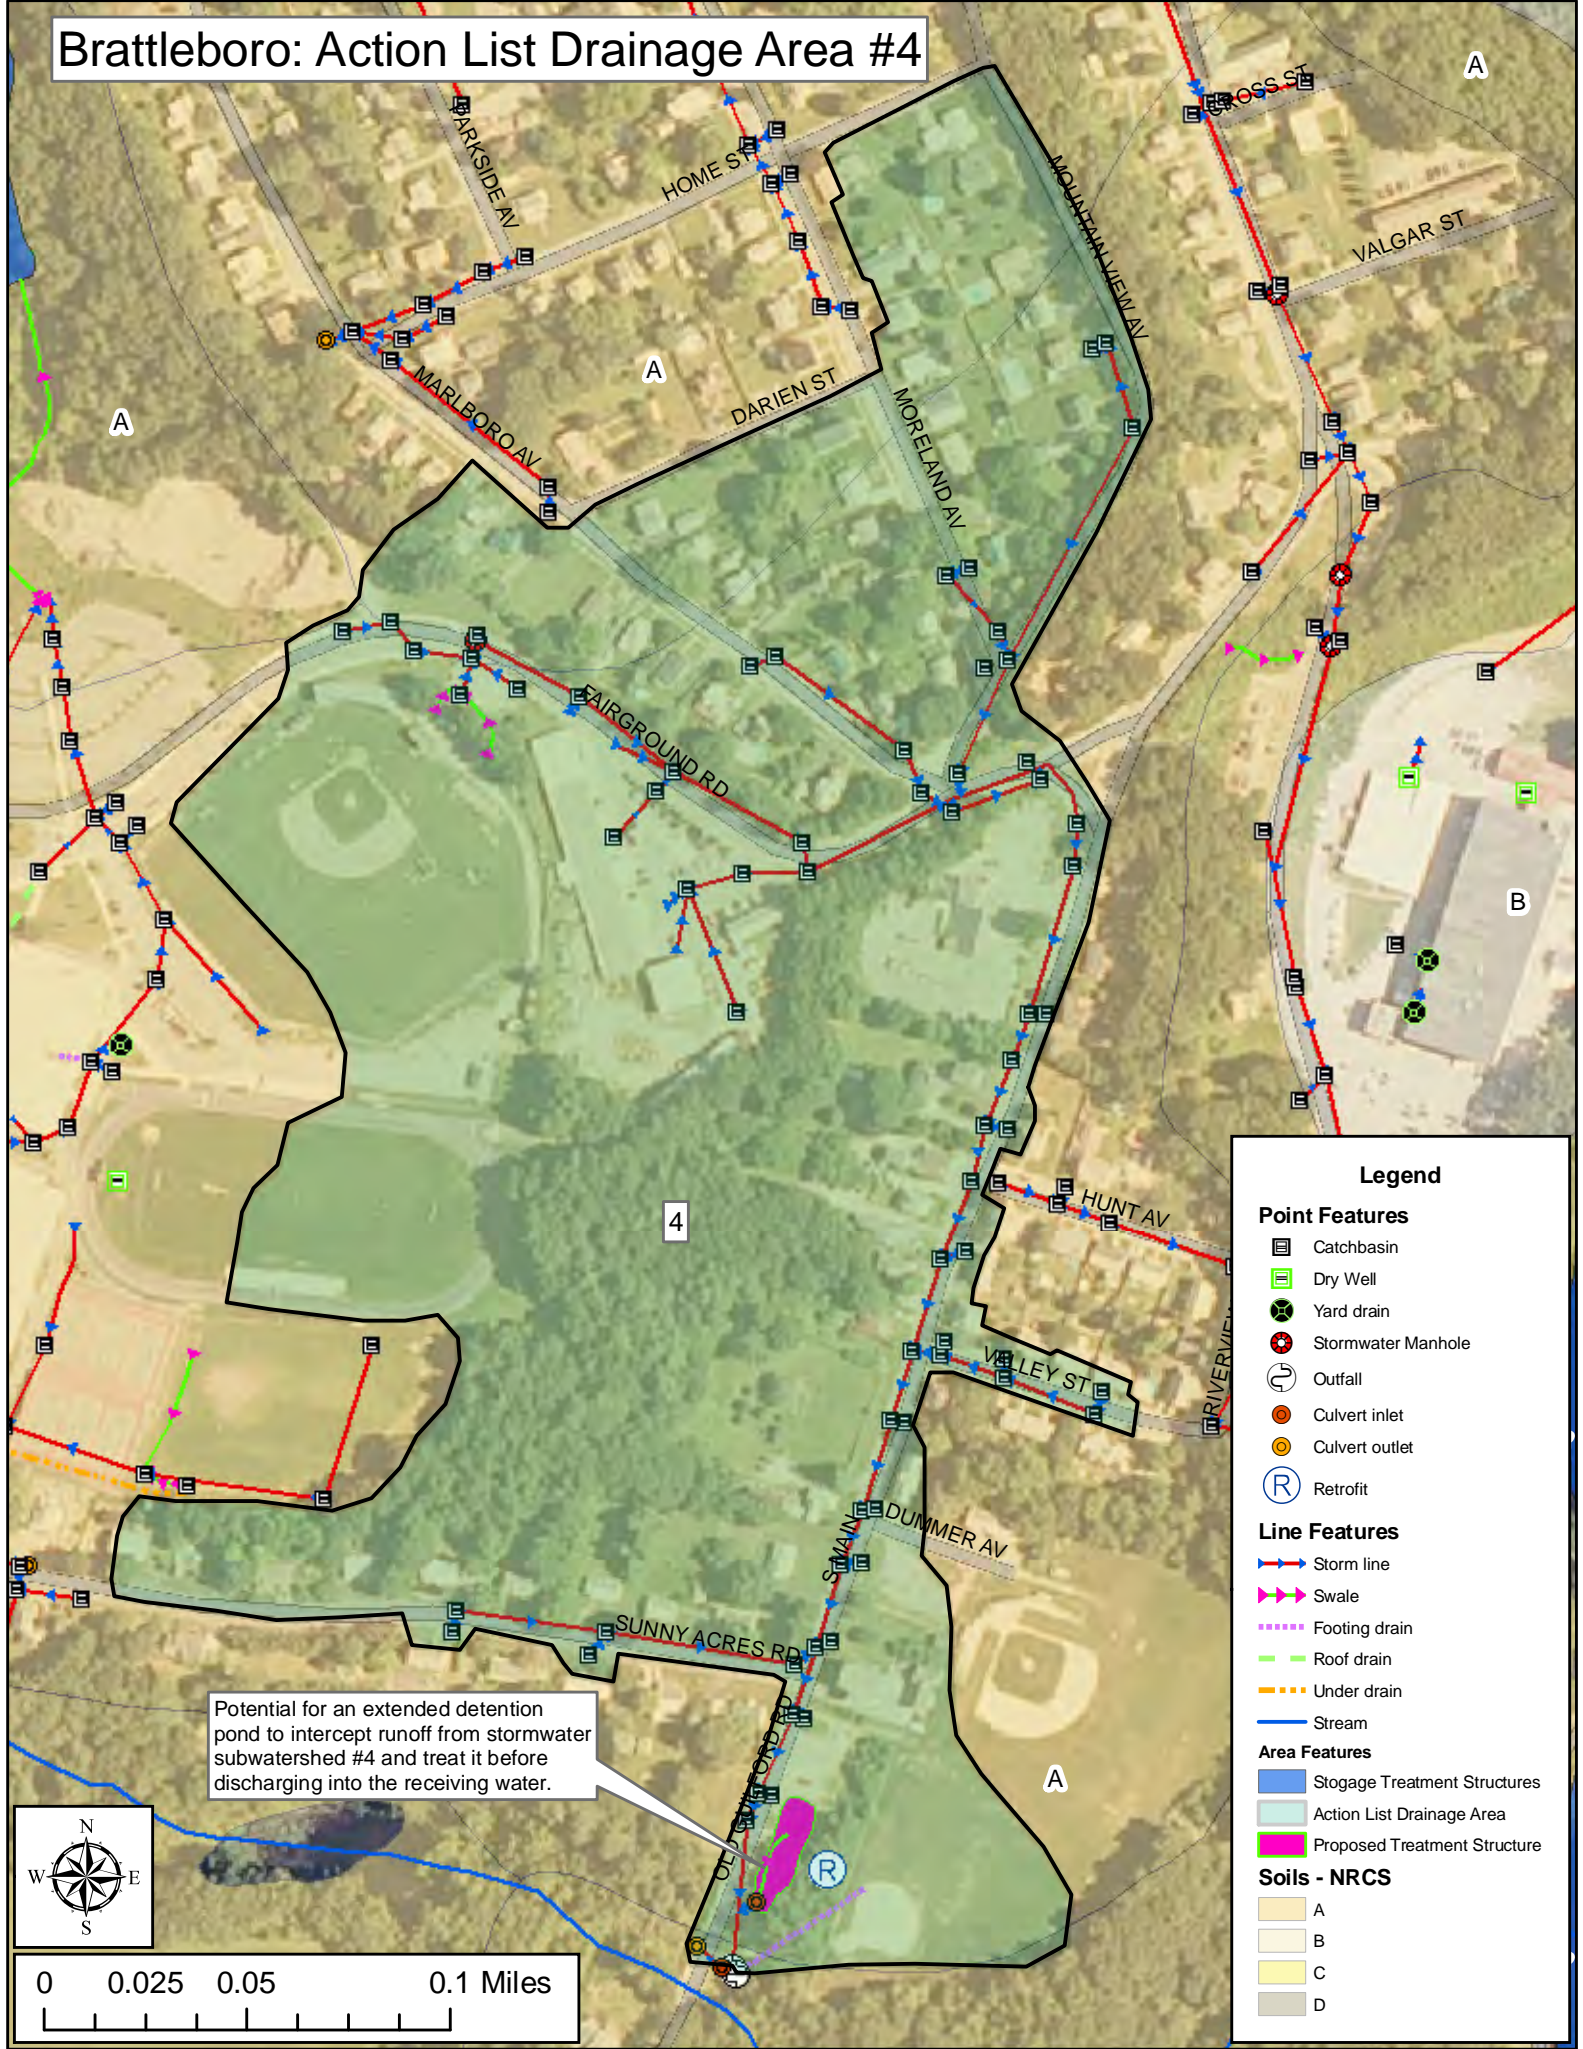

Potential for an extended detention pond to intercept runoff from stormwater subwatershed #4 and treat it before discharging into the receiving water.

Legend

Point Features

- Catchbasin
- Dry Well
- Yard drain
- Stormwater Manhole
- Outfall
- Culvert inlet
- Culvert outlet
- Retrofit

Line Features


- Storm line
- Swale
- Footing drain
- Roof drain
- Under drain
- Stream

Area Features

- Stogage Treatment Structures
- Action List Drainage Area
- Proposed Treatment Structure


Soils - NRCS

- A
- B
- C
- D



Brattleboro: Action List Drainage Area #6

Potential for maintenance of Kettle Pond to enhance stormwater management capabilities.

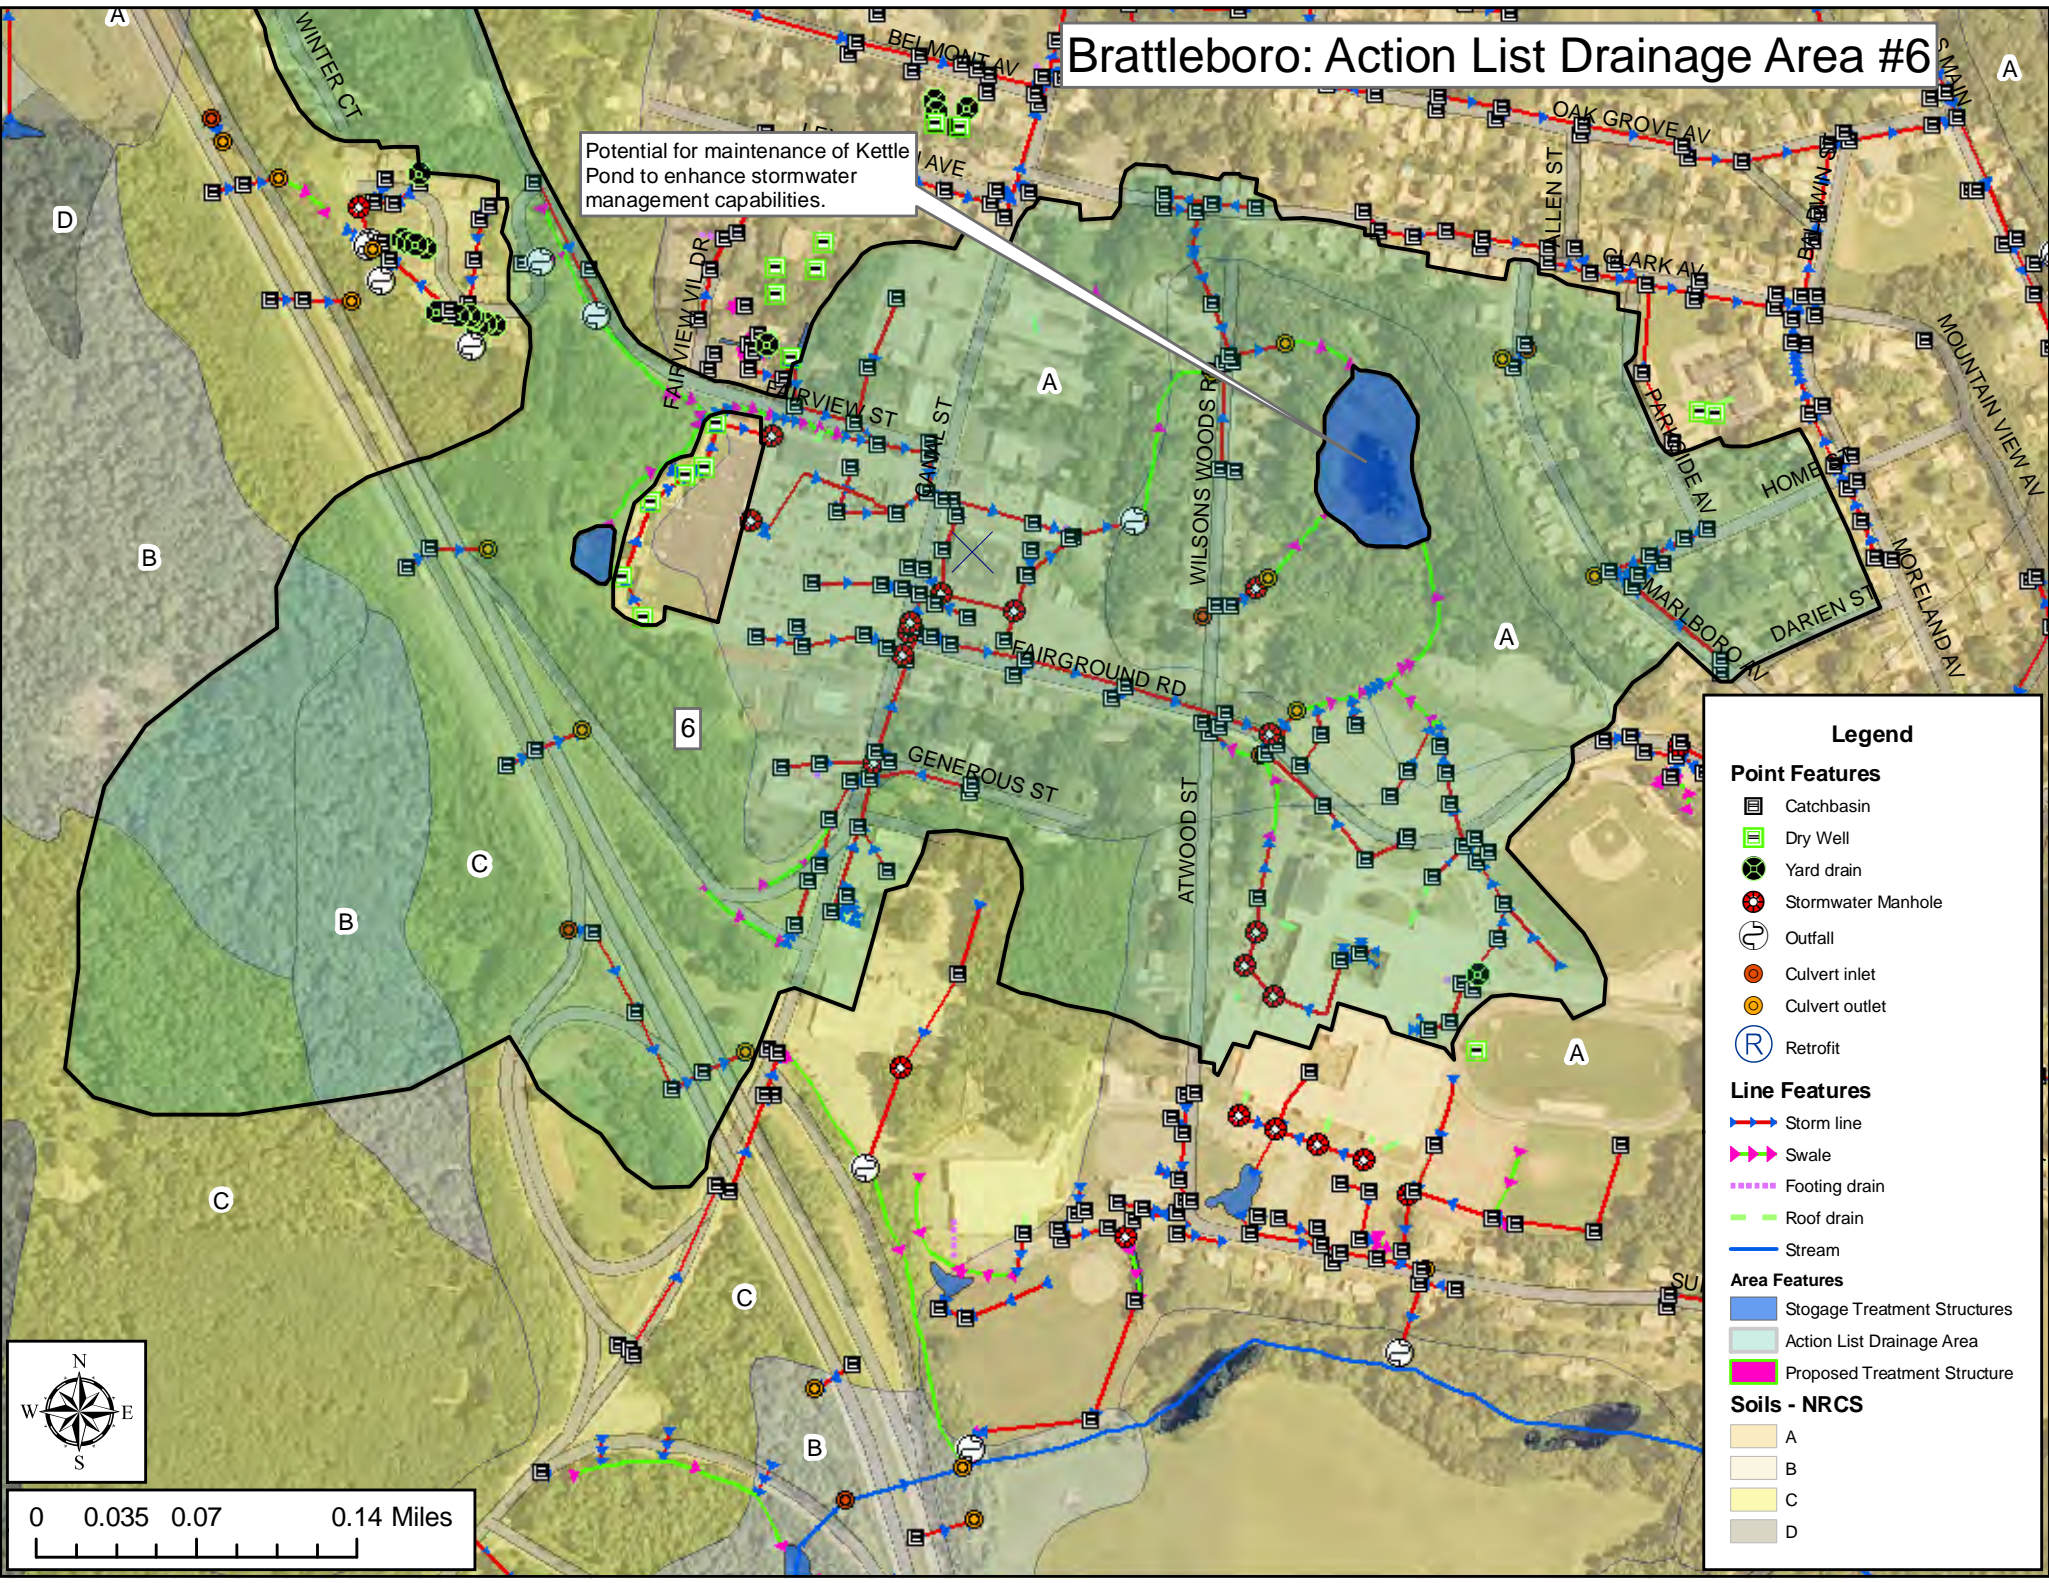

Legend

Point Features

- Catchbasin
- Dry Well
- Yard drain
- Stormwater Manhole
- Outfall
- Culvert inlet
- Culvert outlet
- Retrofit

Line Features

- Storm line
- Swale
- Footing drain
- Roof drain
- Stream

Area Features

- Stogage Treatment Structures
- Action List Drainage Area
- Proposed Treatment Structure


Soils - NRCS

- A
- B
- C
- D

0 0.035 0.07 0.14 Miles

Brattleboro: Action List Drainage Areas #39, #40

Potential to combine subwatersheds #39 and #40 and to modify existing wet pond/wetland area to an extended detention pond for improved stormwater treatment before discharge into the receiving water.

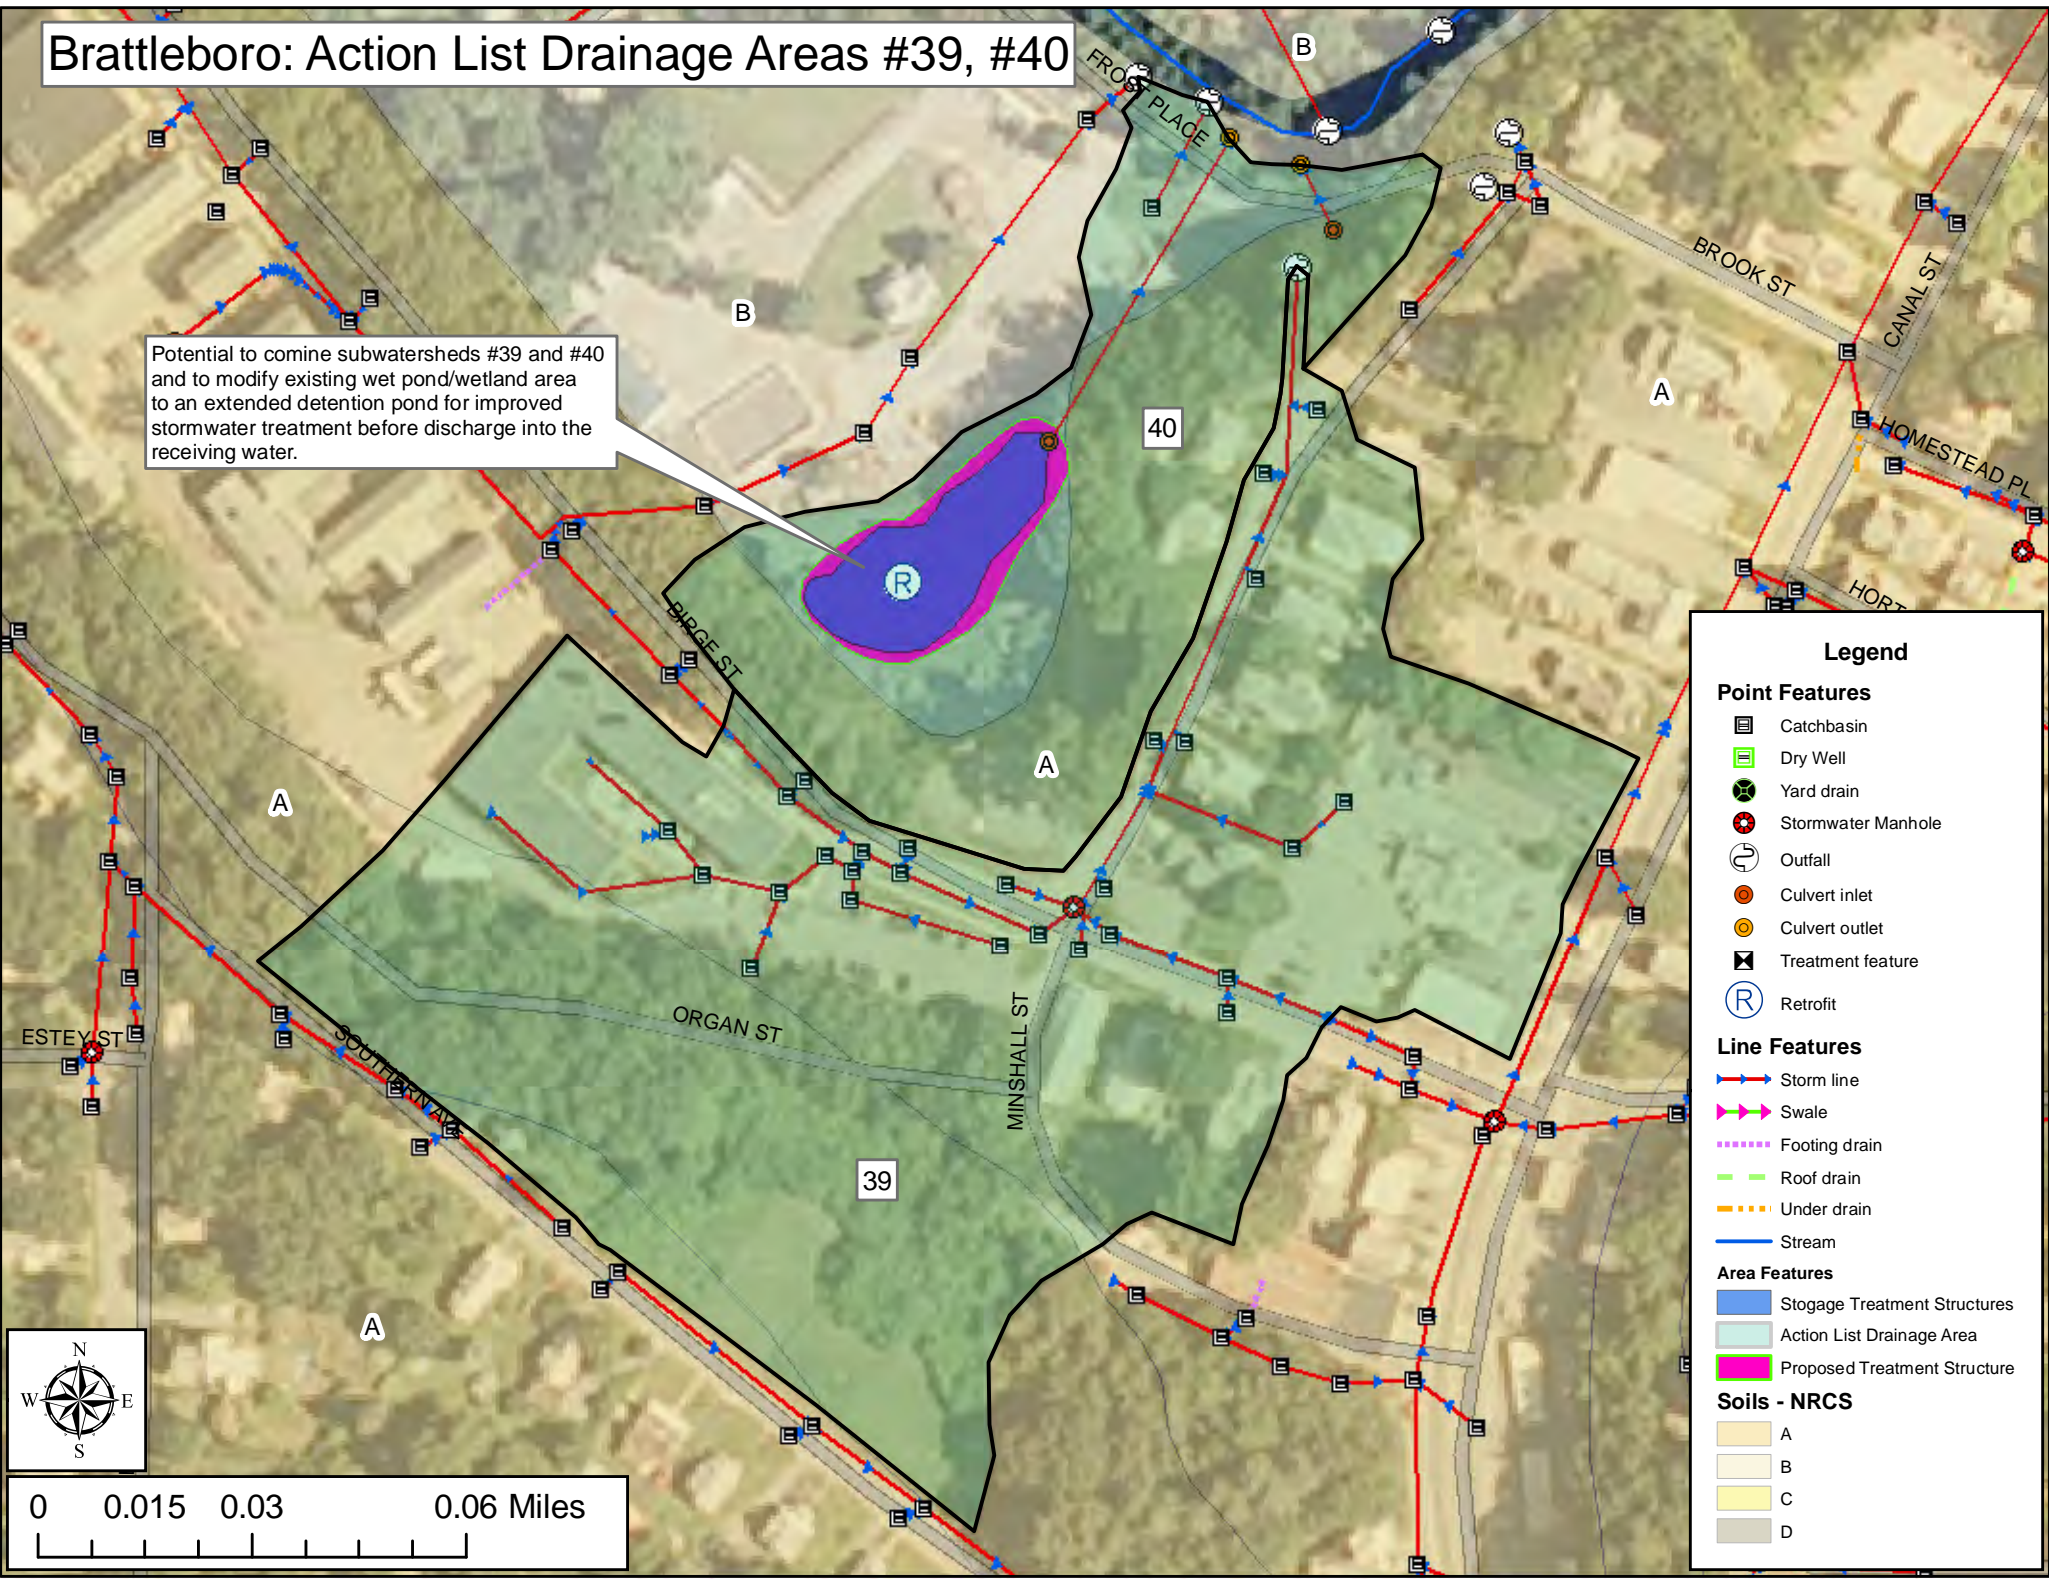

Legend

Point Features

- Catchbasin
- Dry Well
- Yard drain
- Stormwater Manhole
- Outfall
- Culvert inlet
- Culvert outlet
- Treatment feature
- Retrofit

Line Features

- Storm line
- Swale
- Footing drain
- Roof drain
- Under drain
- Stream

Area Features


- Storage Treatment Structures
- Action List Drainage Area
- Proposed Treatment Structure

Soils - NRCS

- A
- B
- C
- D

Brattleboro: Action List Drainage Area #68

Potential for an extended detention pond to treat runoff from stormwater subwatershed #68 before discharging into the receiving water.

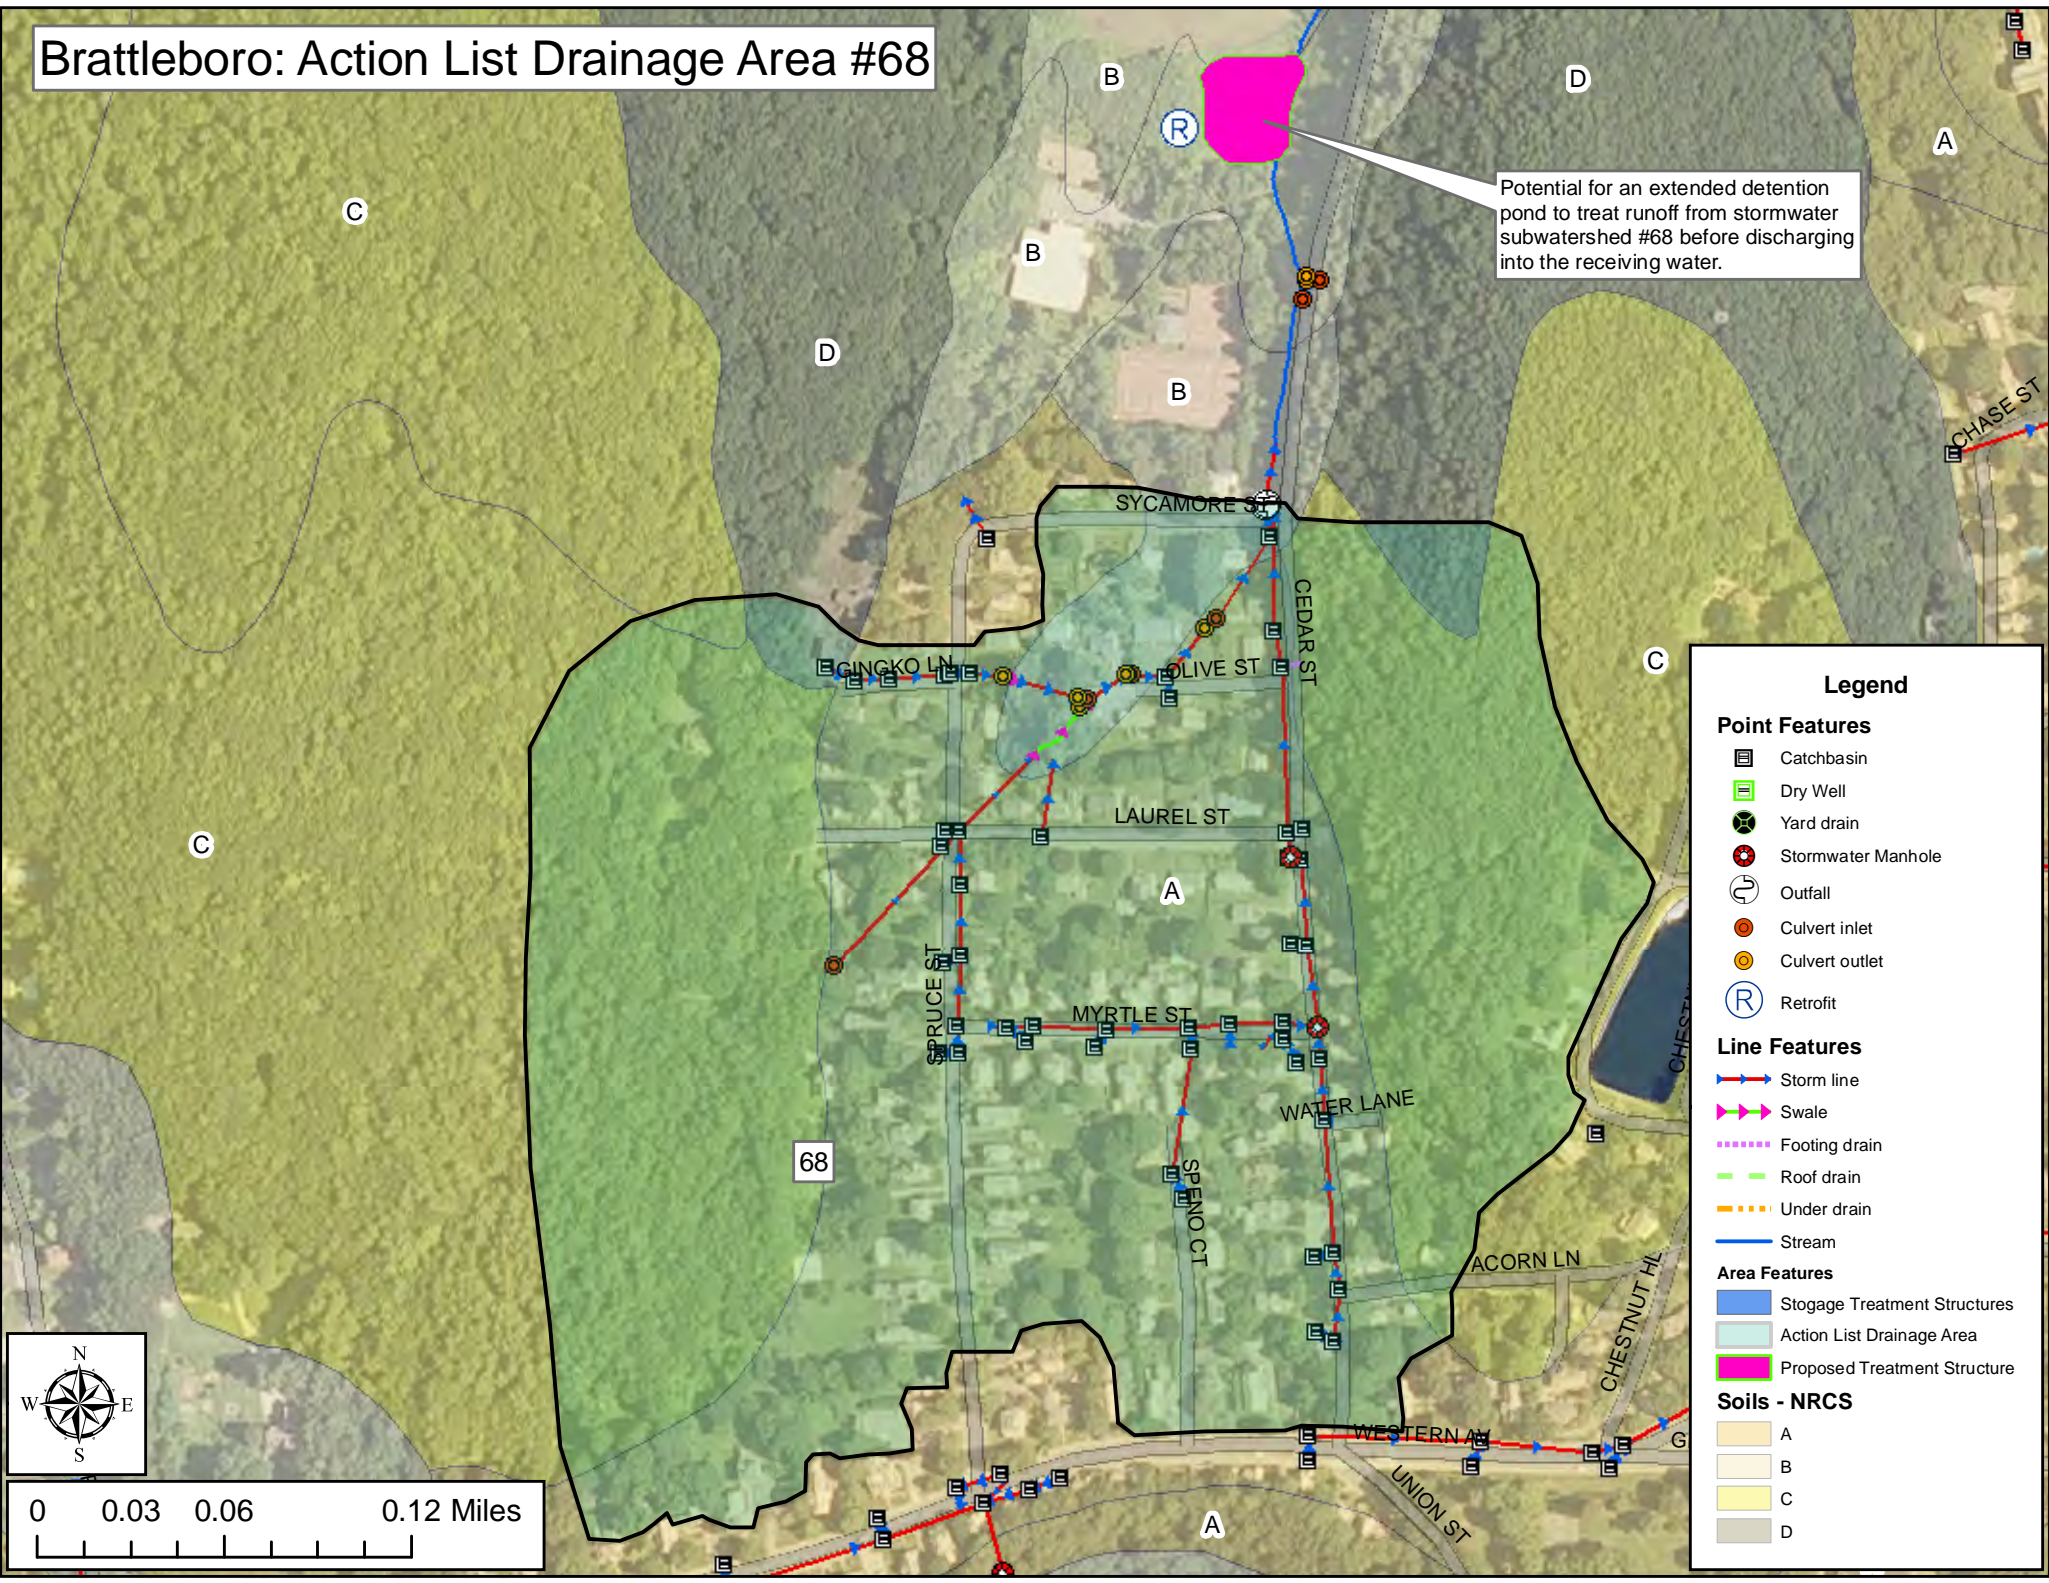

Legend

Point Features

- Catchbasin
- Dry Well
- Yard drain
- Stormwater Manhole
- Outfall
- Culvert inlet
- Culvert outlet
- Retrofit

Line Features

- Storm line
- Swale
- Footing drain
- Roof drain
- Under drain
- Stream

Area Features


- Stogage Treatment Structures
- Action List Drainage Area
- Proposed Treatment Structure

Soils - NRCS

- A
- B
- C
- D

0 0.03 0.06 0.12 Miles

Brattleboro: Action List Drainage Area #80

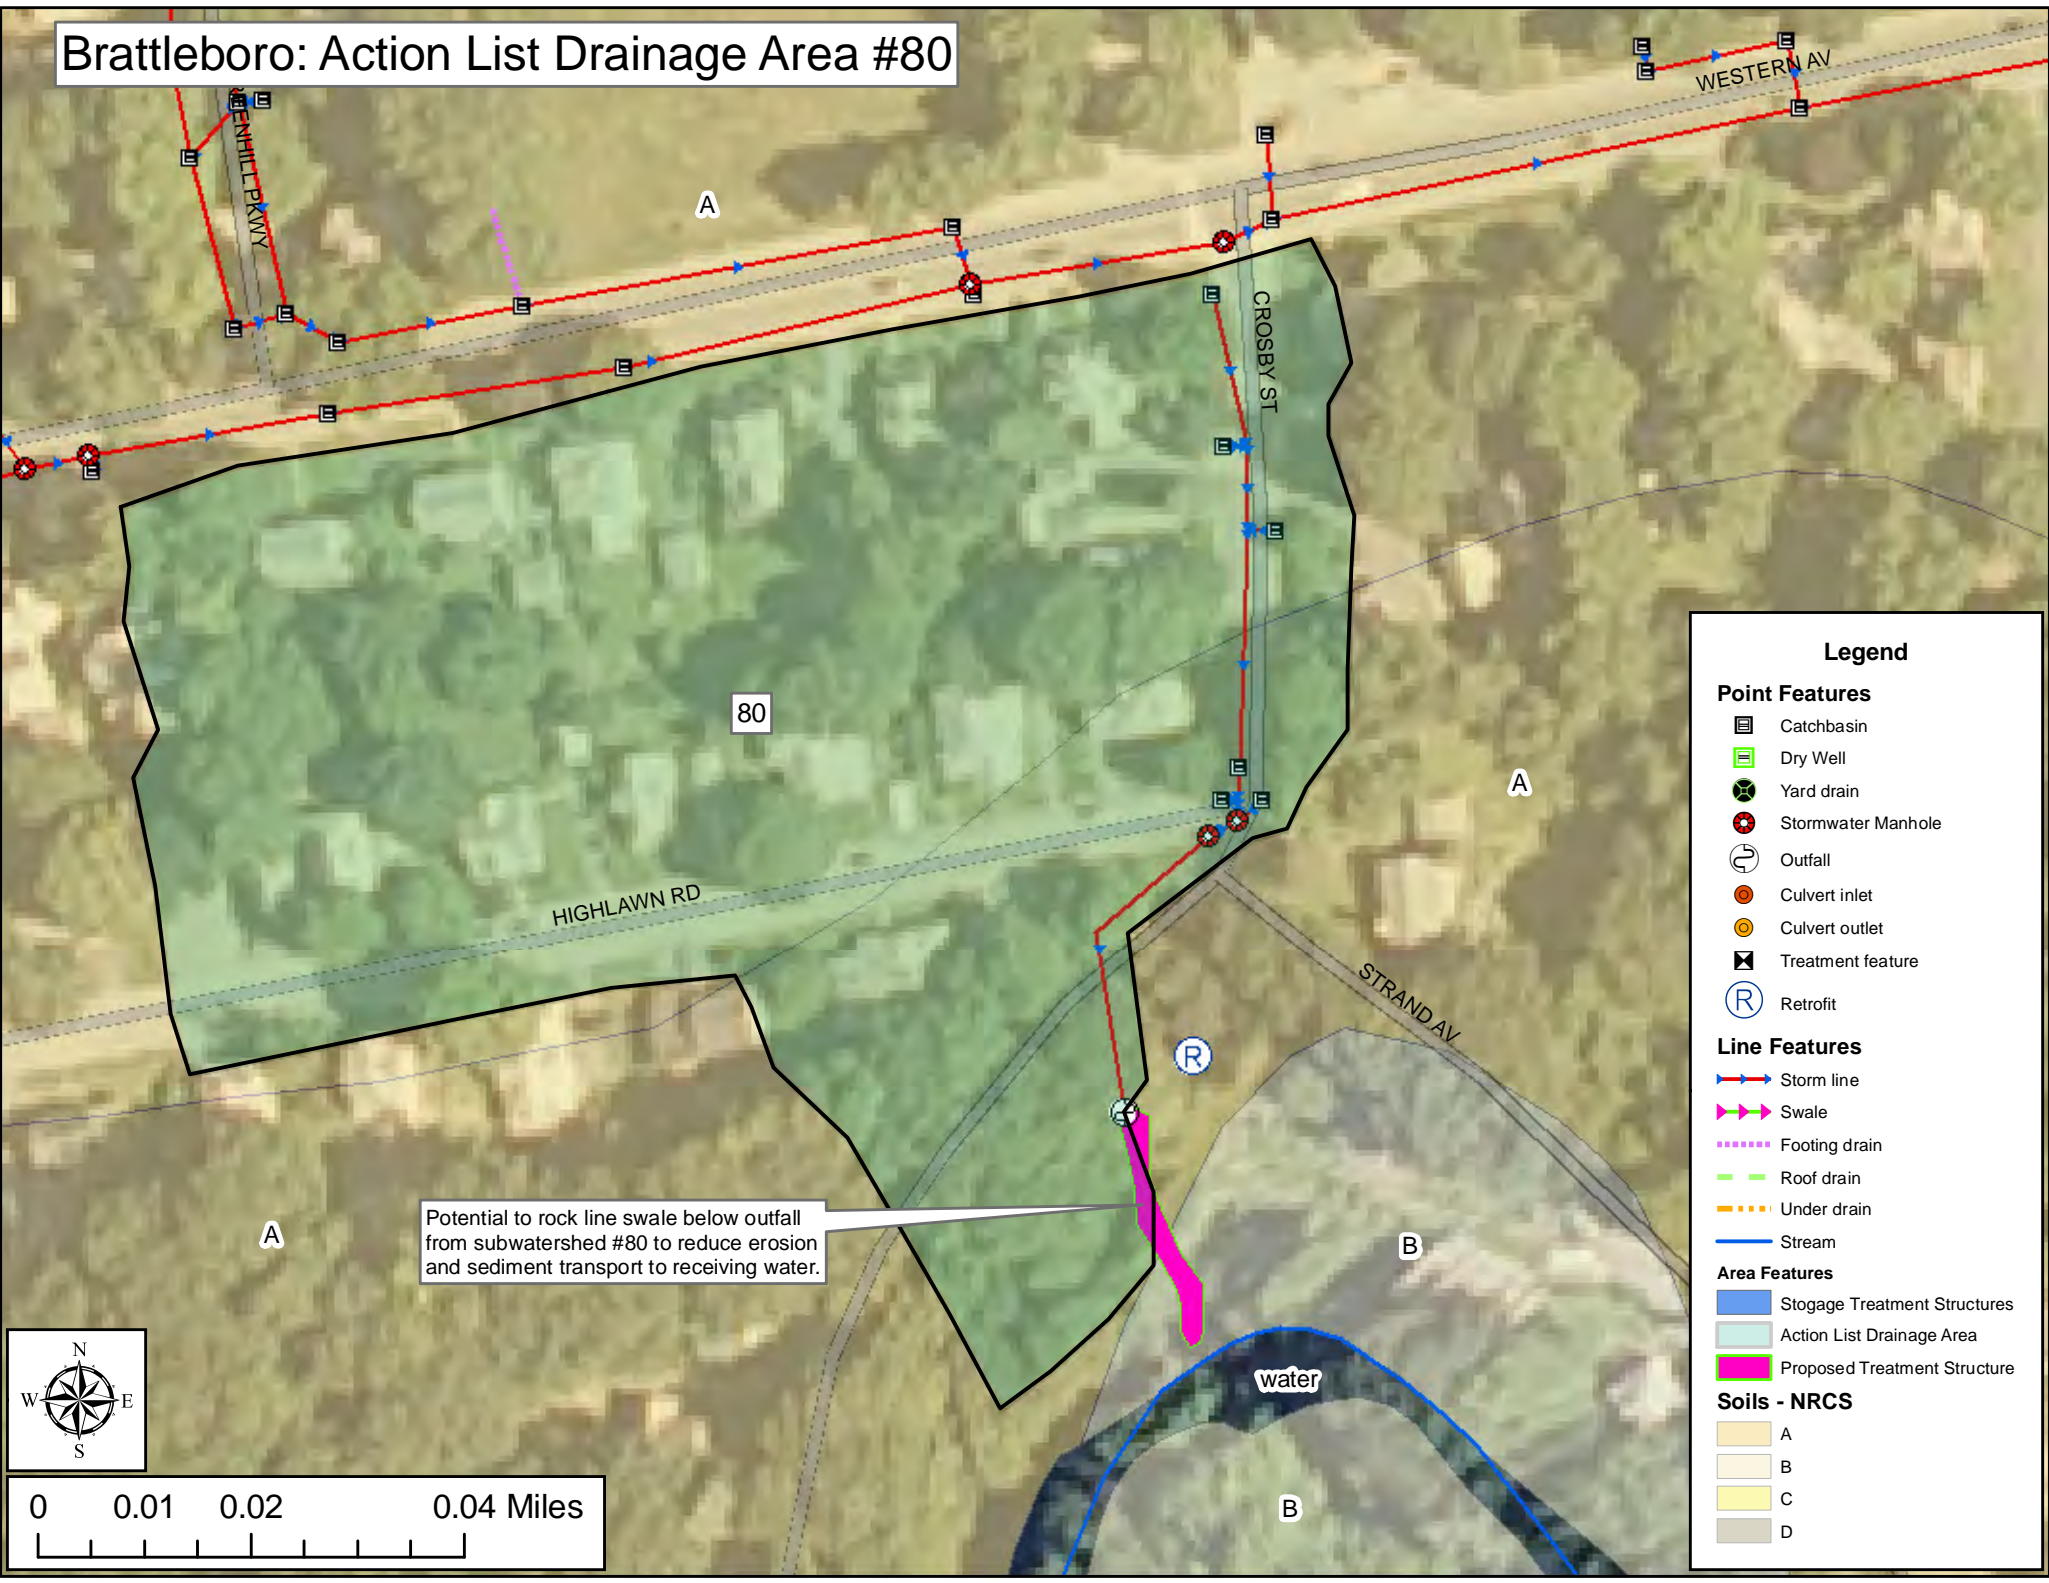

Potential to rock line swale below outfall from subwatershed #80 to reduce erosion and sediment transport to receiving water.

Legend

Point Features

- Catchbasin
- Dry Well
- Yard drain
- Stormwater Manhole
- Outfall
- Culvert inlet
- Culvert outlet
- Treatment feature
- Retrofit

Line Features

- Storm line
- Swale
- Footing drain
- Roof drain
- Under drain
- Stream


Area Features

- Storage Treatment Structures
- Action List Drainage Area
- Proposed Treatment Structure


Soils - NRCS

- A
- B
- C
- D

0 0.01 0.02 0.04 Miles



Brattleboro: Action List Drainage Area #82

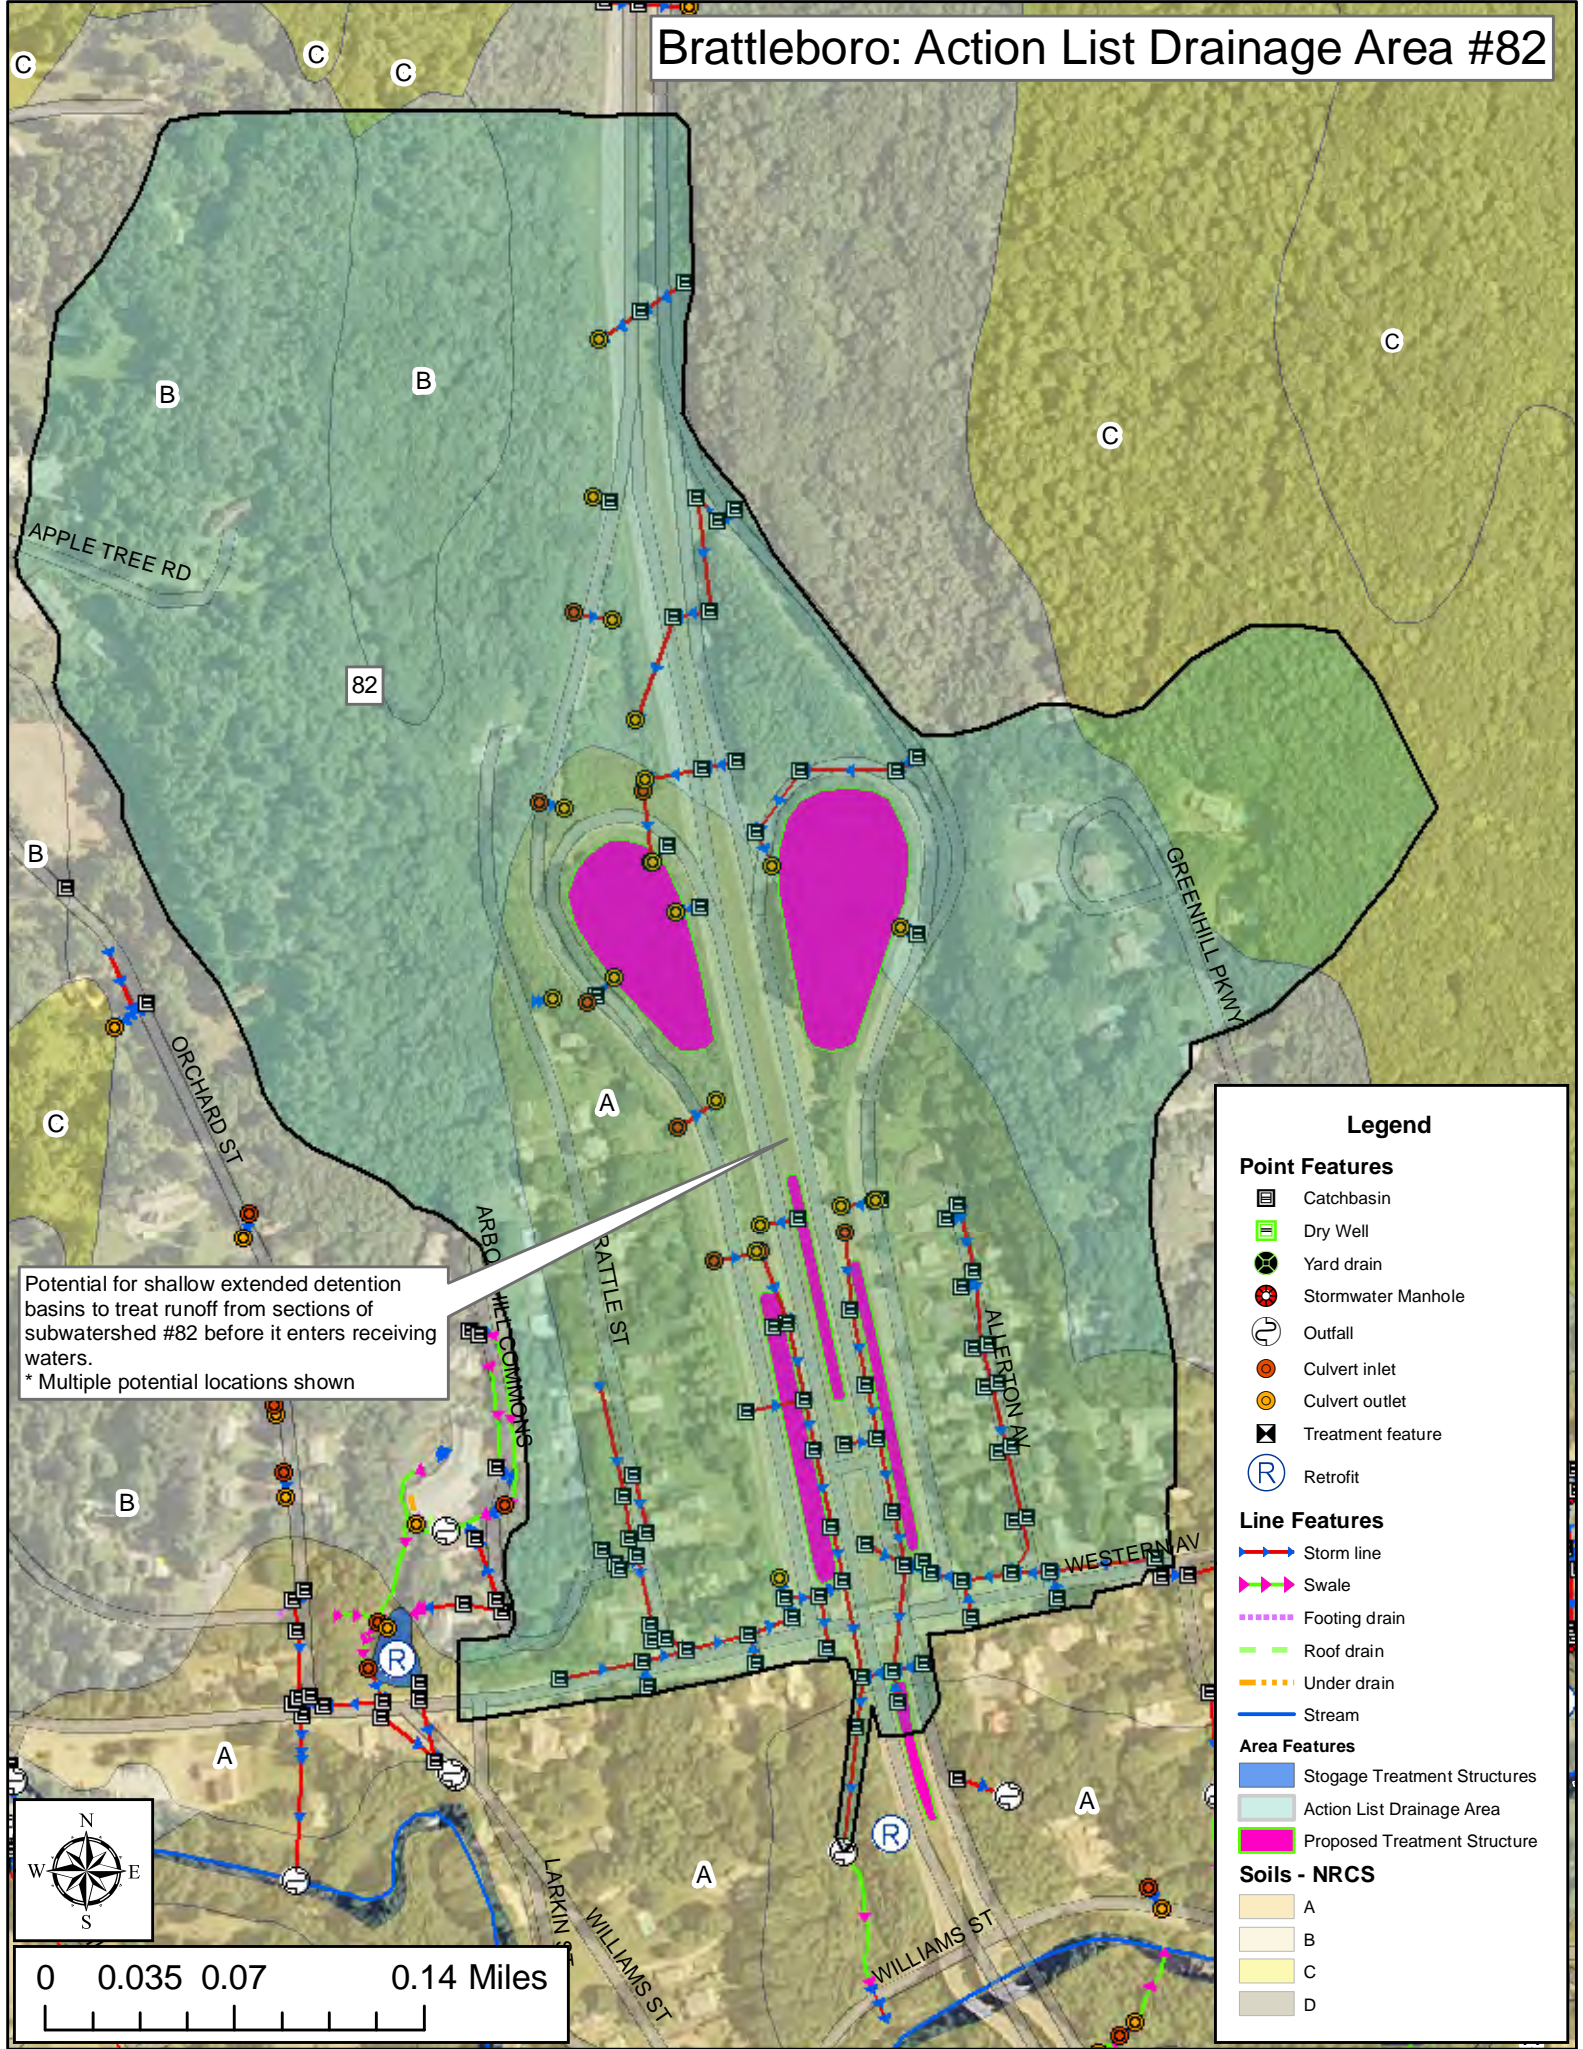

Potential for shallow extended detention basins to treat runoff from sections of subwatershed #82 before it enters receiving waters.
 * Multiple potential locations shown

Legend

Point Features

- Catchbasin
- Dry Well
- Yard drain
- Stormwater Manhole
- Outfall
- Culvert inlet
- Culvert outlet
- Treatment feature
- Retrofit

Line Features

- Storm line
- Swale
- Footing drain
- Roof drain
- Under drain
- Stream

Area Features


- Storage Treatment Structures
- Action List Drainage Area
- Proposed Treatment Structure

Soils - NRCS

- A
- B
- C
- D



Brattleboro: Action List Drainage Area #152

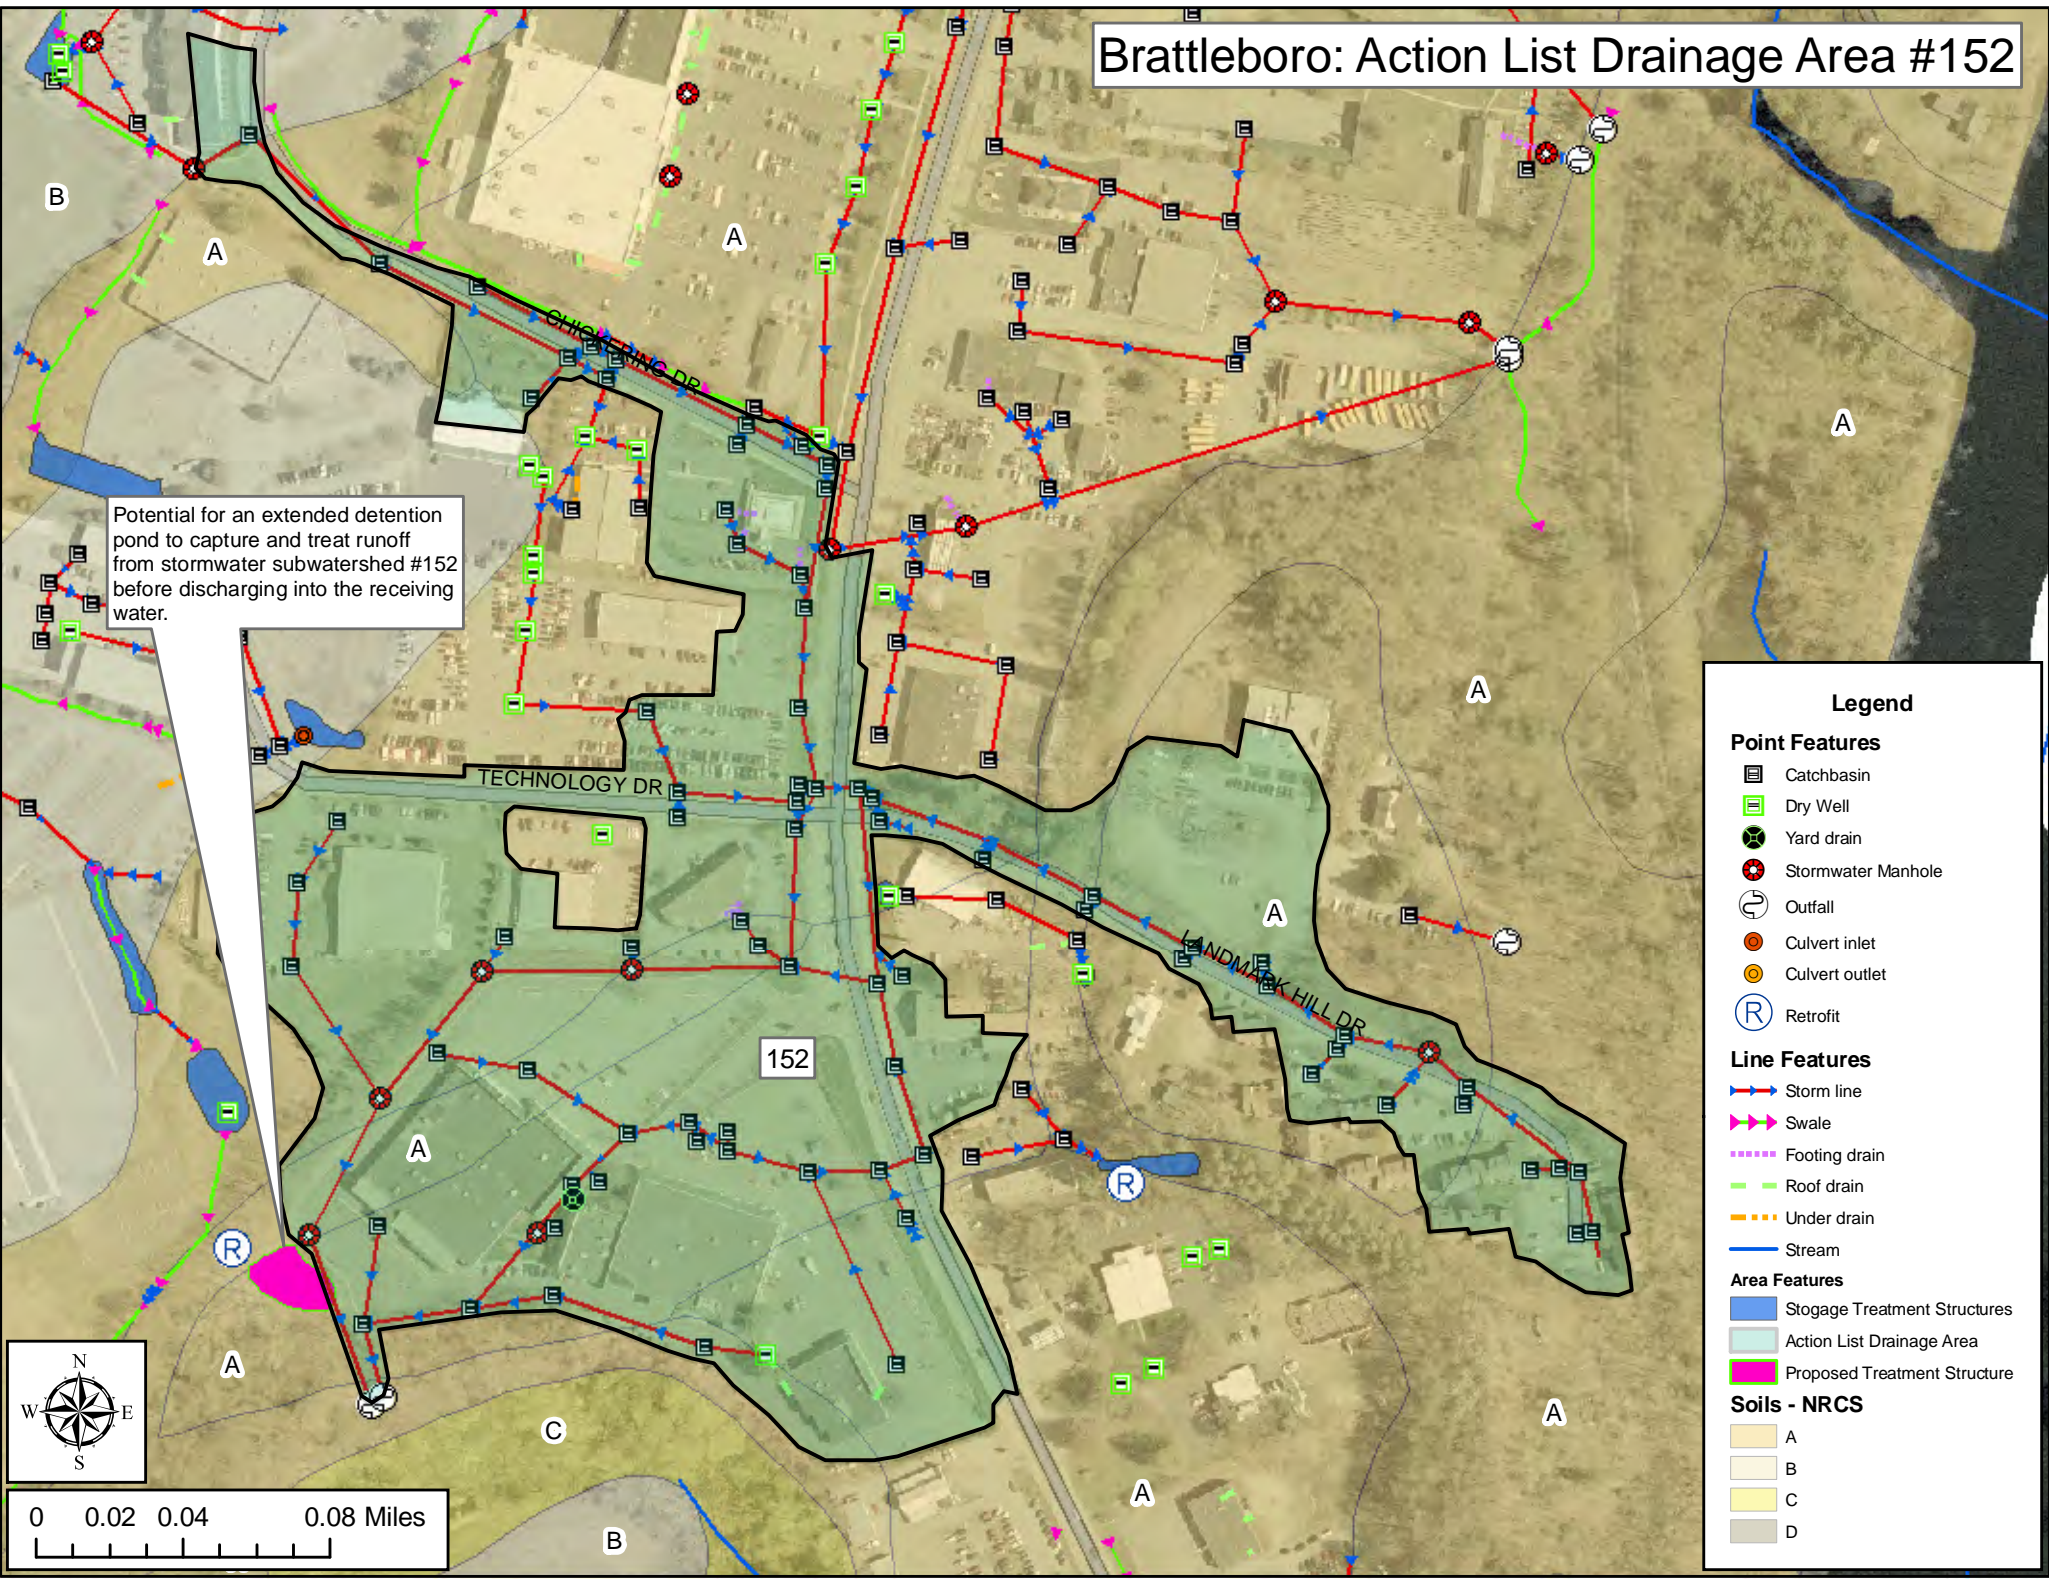

Potential for an extended detention pond to capture and treat runoff from stormwater subwatershed #152 before discharging into the receiving water.

Legend

Point Features

- Catchbasin
- Dry Well
- Yard drain
- Stormwater Manhole
- Outfall
- Culvert inlet
- Culvert outlet
- Retrofit

Line Features

- Storm line
- Swale
- Footing drain
- Roof drain
- Under drain
- Stream

Area Features


- Stogage Treatment Structures
- Action List Drainage Area
- Proposed Treatment Structure

Soils - NRCS

- A
- B
- C
- D

0 0.02 0.04 0.08 Miles

Brattleboro: Action List Drainage Area #173

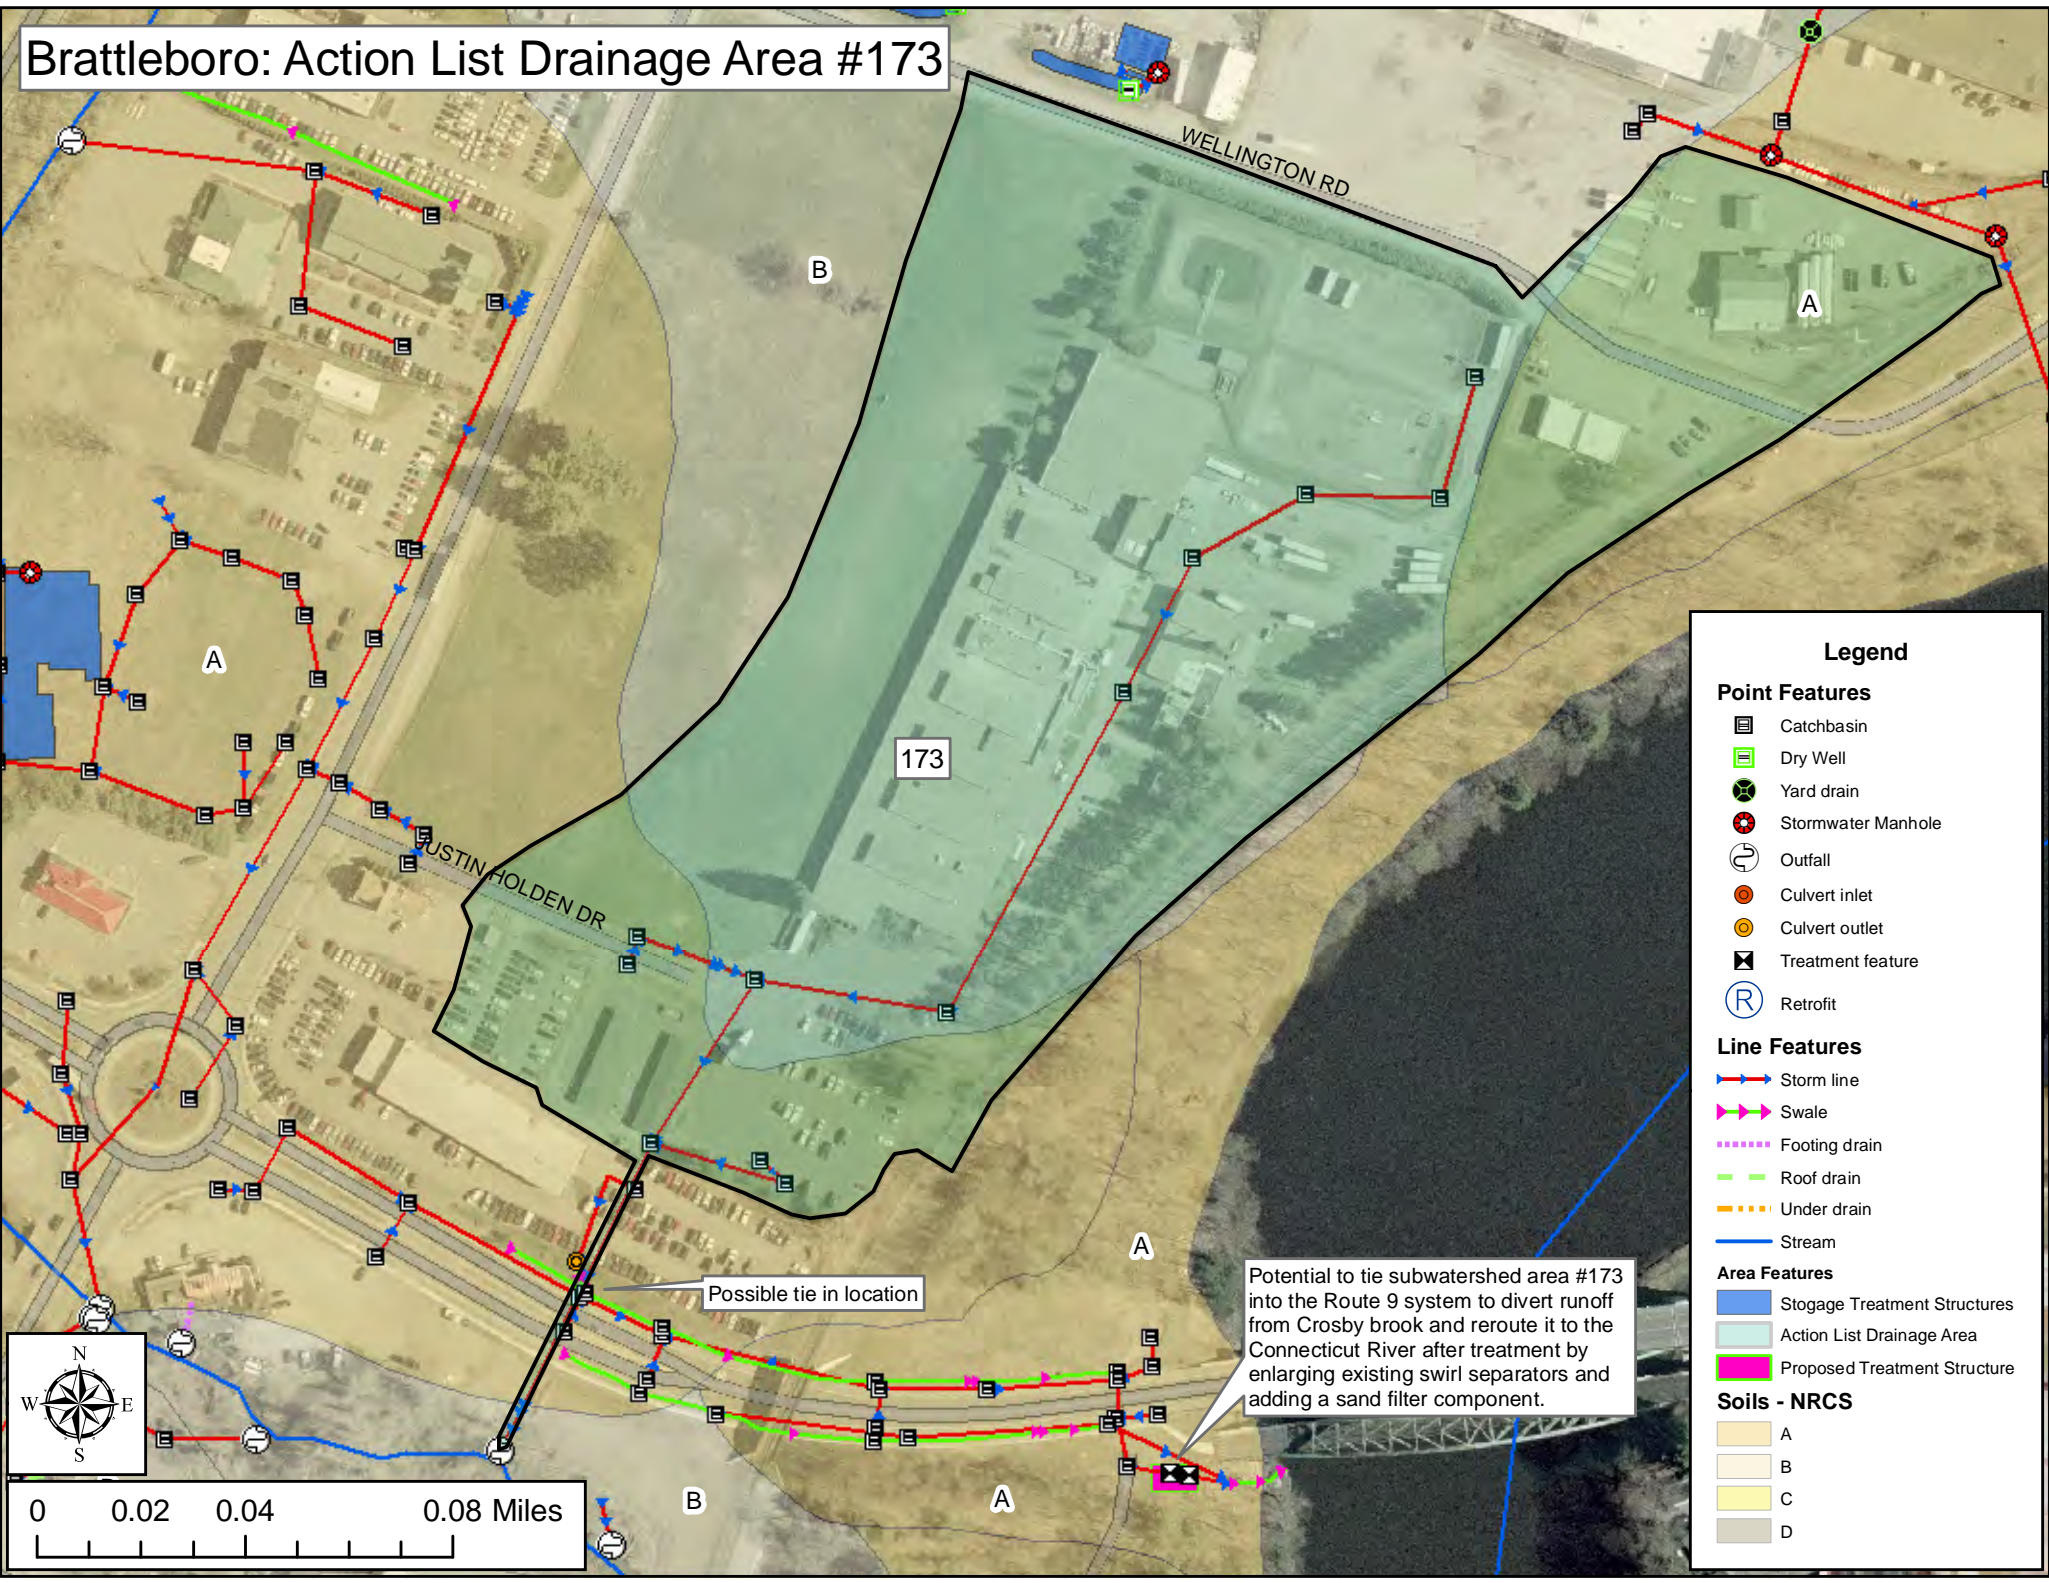

Legend

Point Features

- Catchbasin
- Dry Well
- Yard drain
- Stormwater Manhole
- Outfall
- Culvert inlet
- Culvert outlet
- Treatment feature
- Retrofit

Line Features

- Storm line
- Swale
- Footing drain
- Roof drain
- Under drain
- Stream

Area Features


- Storage Treatment Structures
- Action List Drainage Area
- Proposed Treatment Structure

Soils - NRCS


- A
- B
- C
- D

Possible tie in location

Potential to tie subwatershed area #173 into the Route 9 system to divert runoff from Crosby brook and reroute it to the Connecticut River after treatment by enlarging existing swirl separators and adding a sand filter component.

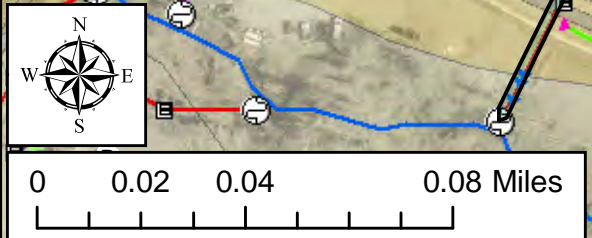

Brattleboro: Action List Drainage Area #177

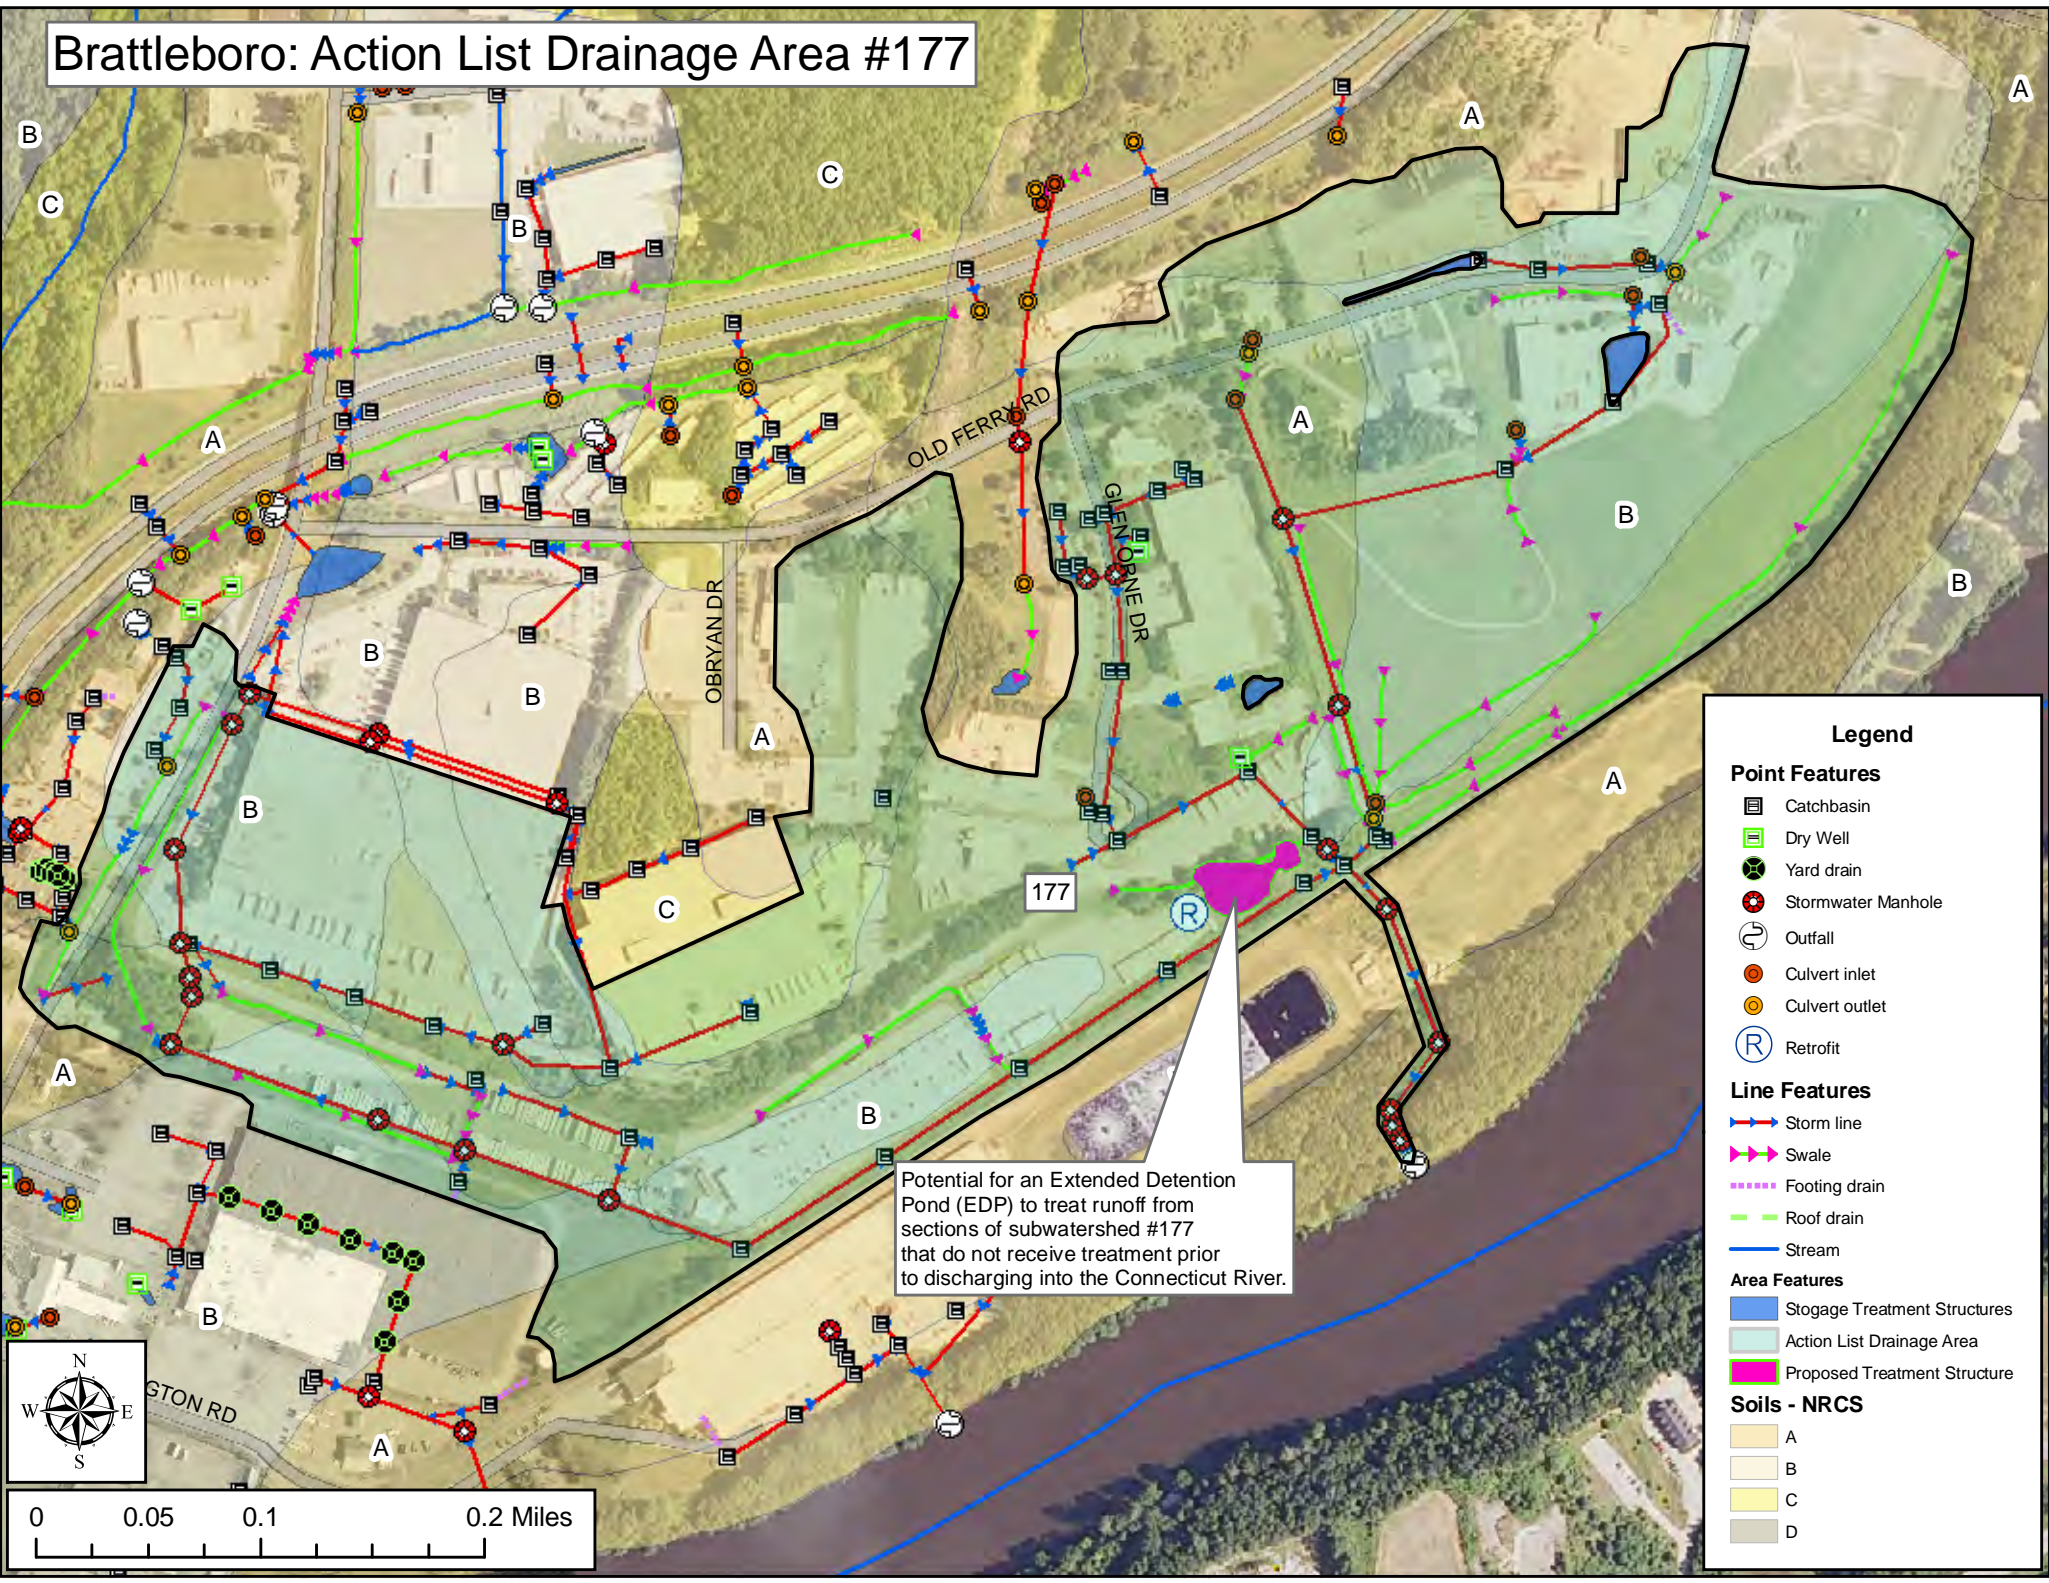

Legend

Point Features

- Catchbasin
- Dry Well
- Yard drain
- Stormwater Manhole
- Outfall
- Culvert inlet
- Culvert outlet
- Retrofit

Line Features

- Storm line
- Swale
- Footing drain
- Roof drain
- Stream


Area Features

- Stogage Treatment Structures
- Action List Drainage Area
- Proposed Treatment Structure

Soils - NRCS

- A
- B
- C
- D

Potential for an Extended Detention Pond (EDP) to treat runoff from sections of subwatershed #177 that do not receive treatment prior to discharging into the Connecticut River.



Spill Control

and

***Vermont Hazardous Waste Management
Regulations***

Have a spill control plan for accidental spills at municipal facilities and on municipal streets

These stormwater infrastructure maps show the connectivity of the stormwater system for the municipality as accurately as it could be determined with the collected and existing data. In the event of a spill this can be a valuable tool for controlling spills and in spill response.

Towns should be equipped with suitable equipment to contain and clean up spills of hazardous materials. Accidental spills of materials can be sources of runoff pollution if not addressed appropriately. If possible Towns should be prepared to address spills on municipal streets while at the same time contacting the state Waste Management Division. DPW managers should be aware of all applicable requirements and should contact regulatory authorities if requirements are not known.

All spills should be cleaned up immediately after they occur. For municipal facilities the creation of a site specific spill control and response plan in combination with spill response training for designated on-site personnel can be effective in dealing with accidental spills and preventing the contamination of soil, water, and runoff. Preparation of a spill containment, control, and countermeasures (SPCC) plan might be required to meet regulatory requirements (e.g., requirements regarding storage of specified chemicals above certain volume thresholds).

Even if a formal plan is not required, preparing one is a good idea. In general, an SPCC plan should include guidance to site personnel on the following:

- Proper notification when a spill occurs;
- Site responsibility with respect to addressing the cleanup of a spill;
- Stopping the source of a spill;
- Cleaning up a spill;
- Proper disposal of materials contaminated by the spill;
- Location of spill response equipment programs; and
- Training for designated on-site personnel.


A periodic spill “fire drill” should be conducted to help prepare Town personnel in the event of a spill.

Spill Prevention and Response Measures

Catch Basin Inserts

Catch Basin Inserts (Drain Guards / Sediment Traps) protect our rivers and streams by capturing sediment, debris, oil and grease at storm water catch basins. Catch Basin Inserts are an economical and effective method to protect you from costly clean-up work.

The standard filter material is a non-woven geotextile with built-in overflow ports for cases of abnormally high water flow or over-filled filter bags. Catch Basin Inserts are available with a replaceable 5" x 15" oil absorbent boom that floats to absorb any oil, gas or diesel entering a storm water catch basin.

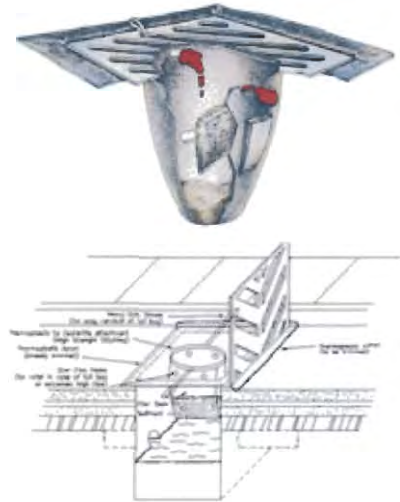

Urethane Drain Protector

Urethane Drain Protectors are positive sealing drain covers that ensure spills do not enter drains. Drain Protectors are environmentally safe and resistant to chemicals, solvents and hydrocarbons. After use, the Drain Protector can be washed and stored in its tube storage container.



Absorbent Socks

Absorbent socks are flexible tubes used to contain and clean-up spilled fluids. Socks are widely used in industrial applications and are ideal for Spill Kits. Fast spreading spills are quickly stopped with a sock.



Drums & Intermediate Bulk Containers (IBC's)

New and reconditioned steel drums are ideal for storing solid and liquid waste. Poly drums available for durable outdoor storage or for building your own spill kits. Steel and poly drums are available in both tight-head (TH) and full open-head styles (FOH).



Pads & Rolls

Absorbent pads and rolls made from polypropylene fibers are the most popular form of absorbents on the market. Various types of absorbent pads and rolls can be used for different liquids and site applications.

The most widely used absorbent pads and rolls are oil-only (white) and universal (grey). Pads and rolls are great for spills on water or land, easily absorbing 20 to 25 times their own weight in recovered liquid. Rolls can easily be cut to the exact size required.



Booms

Linkable Absorbent Booms

Absorbent booms are ideal for containing and cleaning up spills on water. Booms repel water and float even when completely saturated.

Absorbent booms are constructed with a strong mesh outer skin encasing non-linting and highly absorbent polypropylene filler. Linkable booms come complete with end rings and clips attached to nylon rope running the length of the boom.



Collection basins

Collection basins are permanent structures in which large spills or contaminated storm water is contained and stored before cleanup or treatment. Collection basins are designed to receive spills, leaks, etc., and to prevent pollutants from being released into the environment. Unlike containment dikes, collection basins can receive and contain materials from many locations across a facility.

Containment diking

Containment dikes are temporary or permanent earth or concrete berms or retaining walls that are designed to hold spills. Diking can be used at any industrial facility, but is most common for controlling large spills or releases from liquid storage and transfer areas. Diking can provide one of the best protective measures against the contamination of storm water because it surrounds the area of concern and keeps spilled materials separated from the storm water outside of the diked area.

Curbing

Similar to containment diking, a curb is a barrier that surrounds an area of concern. Unlike diking, curbing is unable to contain large spills and is usually implemented on a small-scale basis. However, curbing is common at many facilities and in small areas where liquids are handled and transferred.

Granular Absorbents

A variety of granular and powdered absorbents are available for the effective clean-up of spills on streets, construction sites and in repair shops. These products absorb spilled liquids of various kinds to greatly lower the viscosity, aiding in the clean-up of the spill.

Sorbents, Gels, and Foams

Sorbents are compounds that immobilize materials by surface absorption or adsorption in the sorbent bulk. Gelling agents interact with the spilled chemical(s) by concentrating and congealing to form a rigid or viscous material more conducive to a mechanical cleanup. Foams are mixtures of air and aqueous solutions of proteins and surfactant-based foaming agents. The primary purpose of foams is to reduce the vapor concentration above the spill surface, thereby controlling the rate of evaporation.

VERMONT HAZARDOUS WASTE MANAGEMENT REGULATIONS

§ 7-105 EMERGENCY AND CORRECTIVE ACTIONS

(a) Emergency actions

(1) In the event of a discharge of hazardous waste or a release of a hazardous material, the person in control of such waste or material shall:

(A) Take all appropriate immediate actions to protect human health and the environment including, but not limited to, emergency containment measures and notification as described below; and

(B) Take any further clean up actions as may be required and approved by federal, state, or local officials, or corrective actions as specified under **subsection (b)** of this section so that the discharged waste or released material and related contaminated materials no longer present a hazard to human health or the environment.

(2) Reporting

(A) All discharges and/or releases that meet any of the following criteria shall be immediately reported to the Secretary by the person or persons exercising control over such waste by calling the Waste Management Division at **(802) 241-3888**, Monday through Friday, 7:45 a.m. to 4:30 p.m. or the Department of Public Safety, Emergency Management Division at **(800) 641-5005**, 24 hours/day:

(i) A discharge of hazardous waste, or release of hazardous material that exceeds 2 gallons;

(ii) A discharge of hazardous waste, or release of hazardous material that is less than or equal to 2 gallons and poses a potential or actual threat to human health or the environment; or

(iii) A discharge of hazardous waste, or release of hazardous material that equals or exceeds its corresponding reportable quantity under CERCLA as specified under **40 CFR § 302.4**.

Note: Under the Federal Water Pollution Control Act, certain spills of “oil” and/or “hazardous substances” are prohibited and must be reported pursuant to the requirements of **40 CFR Part 110 / Discharge of Oil**. Certain spills of hazardous substances must also be reported pursuant to CERCLA. In both

VERMONT HAZARDOUS WASTE MANAGEMENT REGULATIONS

(B) A written report shall be submitted to the Secretary within ten (10) days following any discharge or release subject to **subsection (a)(1)** of this section. The report should be sent to: The Vermont Department of Environmental Conservation, Waste Management Division, 103 South Main Street, Waterbury, VT 05671-0404. The person responsible for submitting the written report may request that it not be submitted for small discharges and/or releases that were reported pursuant to subsection (a)(2)(A) of this section, and that have been entirely remediated within the ten (10) day period immediately following the discharge and/or release

(3) If the discharge or release occurred during transportation, the transporter shall, in addition to notifying the Secretary:

(A) Notify the National Response Center at (800) 424-8802 or (202) 426-2675, if required by **49 CFR § 171.15**; and

(B) Report in writing to the Director, Office of Hazardous Materials Regulations, Materials Transportation Bureau, Department of Transportation, Washington, D.C. 20590, if required by **49 CFR § 171.16**; and

(C) A water (bulk shipment) transporter who has discharged hazardous wastes must give the same notice as required by **33 CFR § 153.203** for oil and hazardous substances.

(4) If a discharge or release occurs and the Secretary determines that immediate removal of the waste is necessary to protect human health or the environment, the Secretary may authorize its removal by unpermitted transporters without the preparation of a manifest. Such hazardous waste may be transported to a site authorized by the Secretary under the provisions of **§ 7-503** to temporarily accept hazardous waste generated during an emergency cleanup of a discharge or release.

(5) In the case of an explosives or munitions emergency response, if a Federal, State, Tribal or local official acting within the scope of his or her official responsibilities, or an explosives or munitions emergency response specialist, determines that immediate removal of the material or waste is necessary to protect human health or the environment, that official or specialist may authorize the removal of the material or waste by transporters who do not have EPA identification numbers or hold Vermont hazardous waste transportation permits and without the preparation of a manifest. In the case of emergencies involving military munitions, the responding military emergency response specialist's organizational unit must retain records for three years identifying the dates of the response, the responsible persons responding, the type and description of material addressed, and its disposition.

VERMONT HAZARDOUS WASTE MANAGEMENT REGULATIONS

(6) All clean up debris and residues that are hazardous waste must be transported ultimately to either:

(A) A designated facility;

(B) A person authorized by the Secretary to use such waste if the waste has been delisted pursuant to § 7-218;

(C) Some other location specified and authorized by the Secretary to receive clean up debris and residues if the waste has been delisted pursuant to § 7-218; or

(D) For hazardous waste not defined as hazardous in 40 CFR Part 261 (i.e., waste regulated as hazardous by Vermont), to a facility, that is not a designated facility, located in a state other than Vermont provided the facility can receive such waste under applicable state and local laws, regulations and ordinances.

(b) Corrective actions

(1) If a discharge of hazardous waste, or a release of hazardous material has not been adequately addressed under **subsection (a)(1)(A)** of this section the Secretary may require that the person or persons responsible pursuant to **10 V.S.A. § 6615** complete the following:

(A) Engage the services of an environmental consultant experienced in the investigation and remediation of hazardous waste-contaminated sites; and

(B) Within thirty (30) days from either the date of the discharge/release or the date that the release was discovered if the date of discharge/release is not known, or within a period of time established by an alternative schedule approved by the Secretary, submit for approval by the Secretary a work plan for an investigation of the contaminated site (i.e., site investigation) prepared by the environmental consultant. The site investigation shall define the nature, degree and extent of the contamination; and shall assess potential impacts to human health and the environment (refer to the document titled: "Site Investigation Procedure" which is available from the Secretary upon request); and

(C) Perform the site investigation within either ninety (90) days of receiving written approval of the work plan by the Secretary, or a period of time established by an alternative schedule approved by the Secretary. A report detailing the findings of the site investigation shall be sent to the Secretary for review; and

(D) Within either thirty (30) days from the date of final acceptance of the site investigation report by the Secretary, or a period of time established by an alternative schedule approved by the Secretary, submit a corrective action plan prepared by the environmental consultant (refer to the document titled: "Corrective Action Guidance" which is available from the Secretary upon request); and

(E) Implement the corrective action plan within either ninety (90) days of receiving written approval of the plan by the Secretary, or a period of time established by an alternative schedule approved by the Secretary. The corrective action activity shall continue until the contamination is remediated to levels approved by the Secretary; and

(F) Submit to the Secretary all investigative, corrective action and monitoring reports, and all analytical results related to **subsections (b)(1)(C) through (E) of this section**, as they become available.

(2) A used or fired military munition is a waste and is potentially subject to corrective action authorities pursuant to **10 V.S.A. § 6615**, and the process described by **subsection (b)(1) of this section** if the munition lands off-range and is not promptly rendered safe or retrieved. Any imminent and substantial threats associated with any remaining material must be addressed. If remedial action is infeasible, the operator of the range must maintain a record of the event for as long as any threat remains. The record must include the type of munition and its location (to the extent the location is known).

§ 7-106 LAND DISPOSAL RESTRICTIONS

(a) Certain hazardous wastes shall not be disposed of in or on the land. **40 CFR Part 268**, which is hereby incorporated by reference, except for **40 CFR §§ 268.5, 268.6, and 268.42(b)**, identifies those wastes which shall not be land disposed and describes the limited circumstances under which an otherwise prohibited waste may continue to be land disposed. The authority for implementing the CFR sections not incorporated by reference remains with the EPA.

Note: A copy of 40 CFR Part 268 (the Land Disposal Restrictions rule), as incorporated by these regulations, is available from the Secretary upon request.

VERMONT HAZARDOUS WASTE MANAGEMENT REGULATIONS

(b) In addition to the prohibitions of **40 CFR Part 268**, the Secretary may restrict the land disposal of any hazardous waste in the State of Vermont:

- (1) Which may present an undue risk to human health or the environment, immediately or over a period of time; or
- (2) Which would be incompatible with the **groundwater protection rule and strategy** of chapter 12 of the environmental protection rules.

(c) Dilution of hazardous waste subject to the land disposal restrictions of **40 CFR Part 268** is prohibited pursuant to **40 CFR § 268.3**.

§ 7-107 ENFORCEMENT

(a) Information that the generation, transportation, treatment, storage or disposal of hazardous waste may present an actual or potential threat to human health or the environment, or is a violation of the 10 V.S.A. chapter 159, or these regulations, or any term or condition of certification, order, or assurance, may serve as grounds for an enforcement action by the Secretary, including, but not limited to:

(1) After notice and opportunity for hearing, issuing an order directing any person to take such steps as are necessary to:

- (A) Immediately cease and desist any operation or practice;
- (B) Correct or prevent environmental damage likely to result from any deficiency in operation or practice;
- (C) Suspend or revoke any certification and require temporary or permanent cessation of the operation of such facility;

(2) A request that the Attorney General or appropriate State's Attorney commence an action for injunctive relief, the imposition of penalties and fines provided in **10 V.S.A. § 6612** and other relief as may be appropriate.

(3) An order for reimbursement to any agency of federal, state, or local government from any person whose act caused governmental expenditures under **10 V.S.A § 1283**.

(4) All other powers of enforcement available to the Secretary through **10 V.S.A., chapter 201**.

VERMONT HAZARDOUS WASTE MANAGEMENT REGULATIONS

(b) The hearing by the Secretary identified under **subsection (a)(1)** of this section shall be conducted as a contested case. Pursuant to **10 V.S.A. § 6610(b)**, the Secretary may issue an emergency order without a prior hearing when an ongoing violation presents an immediate threat of substantial harm to the environment or an immediate threat to public health. An emergency order shall be effective upon actual notice to the person against whom the order is issued. Any person to whom an emergency order is issued shall be given the opportunity for a hearing within five (5) business days of the date the order is issued.

(c) Inspections, investigations, and property access (**10 V.S.A. § 8005**)

(1) Inspections and investigations

(A) An investigator may perform routine inspections to determine compliance.

(B) An investigator may investigate upon receipt or discovery of information that an activity is being or has been conducted that may constitute or cause a violation.

(C) An investigator, upon presentation of credentials, may seek permission to inspect or investigate any portion of the property, fixtures, or other appurtenances belonging to or used by a person whose activity is required to be in compliance. The investigator shall state the purpose of the inspection or investigation. An inspection or investigation may include monitoring, sampling, testing, and copying of any records, reports, or other documents relating to the purposes to be served by compliance.

(D) If permission for an inspection or investigation is refused, the investigator may seek an access order from the district or superior court in whose jurisdiction the property is located enabling the investigator to perform the inspection or investigation.

(2) Access orders

(A) If access has been refused, an access order may be sought pursuant to either **10 V.S.A. § 8005** or **10 V.S.A. § 6609**.

(B) Issuance of an access order shall not negate the Secretary's authority to initiate criminal proceedings in the same matter by referring the matter to the office of the attorney general or a state's attorney.

VERMONT HAZARDOUS WASTE MANAGEMENT REGULATIONS

(d) In an action to enforce these regulations, anyone raising a claim that a certain material is not a hazardous waste, or is exempt from regulation as hazardous waste, must demonstrate that there is a known market or disposition for the material, and that they meet the terms of the exclusion or exemption. Appropriate documentation (such as contracts showing that a second person uses the material as an ingredient in a production process) to demonstrate that the material is not a waste, or is exempt from regulation, must be provided. Owners and operators of facilities claiming that they are actually recycling materials must show that they have the necessary equipment to do so.