



Vermont Department of Environmental Conservation  
Drinking Water and Groundwater Protection Division

*Agency of Natural Resources*

## **Annual Report on Public Water System Violations**

### **Vermont Drinking Water & Groundwater Protection Division DWGPD**

**Calendar Year 2023  
January 1, 2023 - December 31, 2023**

**Prepared June 30, 2024**

**Drinking Water and Groundwater Protection Division  
Vermont Department of Environmental Conservation  
1 National Life Drive - Davis 4  
Montpelier, VT 05620-3521  
802-828-1535  
[dec.vermont.gov/water](https://dec.vermont.gov/water)**

## OBTAINING A COPY OF THE 2023 REPORT

As required by the Safe Drinking Water Act, the State of Vermont has made the 2023 Public Water System report available to the public. Interested individuals can obtain a copy of the 2023 Annual Report on Public Water System Violations for the State of Vermont by accessing:

State Websites: <https://dec.vermont.gov/drinking-water-and-groundwater-protection>  
<https://dec.vermont.gov/water/drinking-water/water-quality-monitoring>

Telephone: (802) 828-1535

FAX Number: (802) 828-1541

Mailing Address: Drinking Water and Groundwater Protection Division  
Vermont Department of Environmental Conservation  
1 National Life Drive - Davis 4  
Montpelier, VT 05620-3521

Contact Person: Janelle Wilbur  
Compliance Section Supervisor, Public Drinking Water Program  
Drinking Water and Groundwater Protection Division  
Vermont Department of Environmental Conservation  
1 National Life Drive – Davis 4  
Montpelier, VT 05620-3521  
(802) 585-4898  
[janelle.wilbur@vermont.gov](mailto:janelle.wilbur@vermont.gov)

## INTRODUCTION

Vermont's Department of Environmental Conservation (DEC) is authorized by the U.S. Environmental Protection Agency (EPA) to administer the Public Water Supply System program in the state. DEC's Drinking Water and Groundwater Protection Division (Division) implements the program. The Division's primary goal is to ensure that citizens and visitors of the Green Mountain State have drinking water that is safe for human consumption. To maintain the authority to administer the program (also called primacy), the state has to implement and enforce rules that are at least as stringent as the federal drinking water regulations.

To comply with federal regulations, DEC promulgated the State's Water Supply Rule (Chapter 21 of the Environmental Protection Rules) on September 24, 1992. The rule was revised in 1996, 1999, 2002, 2005, 2010, 2019, and 2020. The 2005 revisions incorporated the 1996 amendments to the federal Safe Drinking Water Act (SDWA). The 2010 revisions included adoption and incorporated by reference federal drinking water regulations promulgated after the 2005 revisions and minor revisions to the rule. This includes the January 4, 2006, Stage 2 Disinfectants and Disinfectant Byproducts Rule; January 5, 2006, Long Term 2 Enhanced Surface Water Treatment Rule; October 10, 2007 Lead and Copper Short-Term Regulatory Revisions and Clarifications; and the November 8, 2009 Ground Water Rule. The 2019 revision was to remove references to the regional wastewater program which is now regulated under a separate state rule. The 2020 revision was to include new Vermont-specific regulations relating to Per- and Polyfluoroalkyl Substances (PFAS) in drinking water and bottled water regulation in Vermont. The Vermont Water Supply Rule and subsequent revisions are found at: <https://dec.vermont.gov/drinking-water-and-groundwater-protection/laws-and-regulations>.

One important aspect of the Safe Drinking Water Act (SDWA) is for government and water system accountability as well as public awareness and involvement. The "Right-to-know" provisions (e.g., Consumer Confidence Reports for community public water systems) give citizens the information they need to make their own health decisions, allow increased participation in drinking water decision-making, and promote accountability at the water system, state, and federal levels.

One of the "Right-to-know" provisions requires states with primacy to prepare an annual Public Water System Compliance Report. The report must include the name and Water System Identification (WSID) number of each public water system that violated SDWA regulations during the year. The nature of each violation must also be reported, as well as the total number of violations that occurred in the state. The report for the previous calendar year must be submitted to EPA and available to the public by July 1st. Then, EPA must summarize and evaluate the reports submitted by the states in an annual national report.

This document is the State of Vermont's annual Public Water System Compliance Report for the calendar year 2023. In addition to information on SDWA violations, the report includes an overview of the drinking water program and the state's compliance and technical assistance and enforcement activities.

## OVERVIEW OF THE DRINKING WATER PROGRAM

### *Drinking Water Program Regulations*

The SDWA aims to ensure that public water supplies meet national standards that protect citizens from harmful contaminants in drinking water. EPA regulations under the SDWA apply to public water systems. Public water systems, which can be publicly or privately owned, provide drinking water to at least 25 people or 15 service connections for at least 60 days per year. The regulations divide public water systems into three categories (Figure 1.) based on 2 characteristics; such as where they serve customers and how often they serve the same people. Water systems with different characteristics are then subject to different regulations.

Figure 1. The 3 types of public water systems

1. **Community Water Systems** provide drinking water to year-round residents.
2. **Non-Transient Non-Community Water Systems** serve the same people for at least 6 months in a year (e.g., schools or factories with their own water source).
3. **Transient Non-Community Water Systems** provide water to different people who do not remain for long periods of time (e.g., campgrounds, restaurants, hotels with their own water source) and are open for at least 60 days.

The National Primary Drinking Water Regulations (NPDWR) require public water systems to meet limits for contaminants in drinking water, use specific treatment techniques, and monitor, report, and keep records to ensure that drinking water provided is safe for human consumption. The limits on contaminant levels, known as Maximum Contaminant Levels (MCLs), set the maximum permitted level of a contaminant in drinking water delivered to a user of a public water system. EPA has set MCLs for more than 90 contaminants. There are MCLs both for contaminants that can cause acute health effects from short-term exposure, and for contaminants that can cause chronic health effects from long-term exposure. Additional information on the health effects of specific contaminants can be found on the federal EPA website (<https://www.epa.gov/ground-water-and-drinking-water>). An MCL violation occurs when monitoring results indicate that the level of a contaminant in finished water is above the MCL (Figure 2. lists the main types of violations) using EPA prescribed determination methods.

For some regulations, EPA establishes a treatment technique requirement instead of an MCL. Treatment techniques protect drinking water where it is impractical to monitor and determine the level of a particular contaminant. The required treatment techniques are

designed to prevent known or anticipated health effects. Treatment technique requirements have been established under the Surface Water Treatment Rules, the Lead and Copper Rule, the Ground Water Rule, and the Revised Total Coliform Rule. A violation of a treatment technique indicates that the system failed to treat water or perform necessary follow-up directives specified to minimize the presence of potentially harmful contaminants.

EPA also sets monitoring, reporting, and record keeping requirements that public water systems must follow. A monitoring or reporting violation can occur when a public water system either fails to take the required number of samples, perform a required analysis, or fails to report the results of an analysis performed in a timely manner as required by law. The SDWA requires the state to report only significant monitoring and reporting violations in their annual Public Water System Compliance Report. A significant monitoring or reporting violation occurs when a public water system collects none of the samples or submits none of the reports required by a particular regulatory provision. A significant monitoring or reporting violation can also occur if a public water system collects fewer than 90% of the samples or submits fewer than 90% of the reports required by the Surface Water Treatment Rules. Public water systems are required to report all monitoring results to the state. The state analyzes the monitoring results, determines compliance, and reports violations to EPA on a quarterly basis.

**Figure 2. The 4 main types of drinking water regulation violations.**

*Maximum contamination level (MCL) violation* - occurs when a test indicates that the level of a contaminant in finished water is above EPA or the state's legal limit (states may set standards equal to, or more protective than, EPA's). These violations indicate a potential health risk, which may be immediate (i.e., acute) or long term.

*Treatment technique (TT) violation* - occurs when a water system fails to treat its water in the way prescribed by the state or EPA (e.g., by not applying corrosion control if lead levels are too high) or fails to take action to identify and eliminate sanitary defects. Treatment technique violations indicate a potential health risk to consumers.

*Monitoring violation* - occurs when a system fails to test its water for certain contaminants during the required monitoring period. If a water system does not properly monitor its drinking water, no one can know whether or not it poses a health risk to consumers.


*Reporting violations* - occurs when a system performs required monitoring, assessment, or public notice, but fails to submit the monitoring or assessment report, or public notice certification in a timely fashion.

The state may grant a public water system a variance or exemption from national primary drinking water standards, provided that the terms of the variance or exemption adequately protect public health. As provided by the SDWA, variances are available to public water systems that cannot comply with national primary drinking water regulations. Variances generally allow a public water system to comply with less stringent, but still protective standards based on a specific EPA approved technology available to the system. An exemption allows the public water system with compelling circumstances (including economic considerations) additional time to achieve compliance with applicable SDWA requirements. An exemption is limited to three years, although extensions of up to six additional years are available to very small public water systems under certain defined conditions. Currently, no SDWA variances or exemptions have been granted in Vermont.

### *Vermont's Public Water Systems*

The 1350 active public water systems in Vermont include 404 community (CWS), 252 non-transient non-community (NTNC), and 689 transient non-community (NC – also commonly referred to as TNC) systems (Figure 3.). There are also 5 in-state permitted bulk/bottled water facilities.

**Figure 3.**

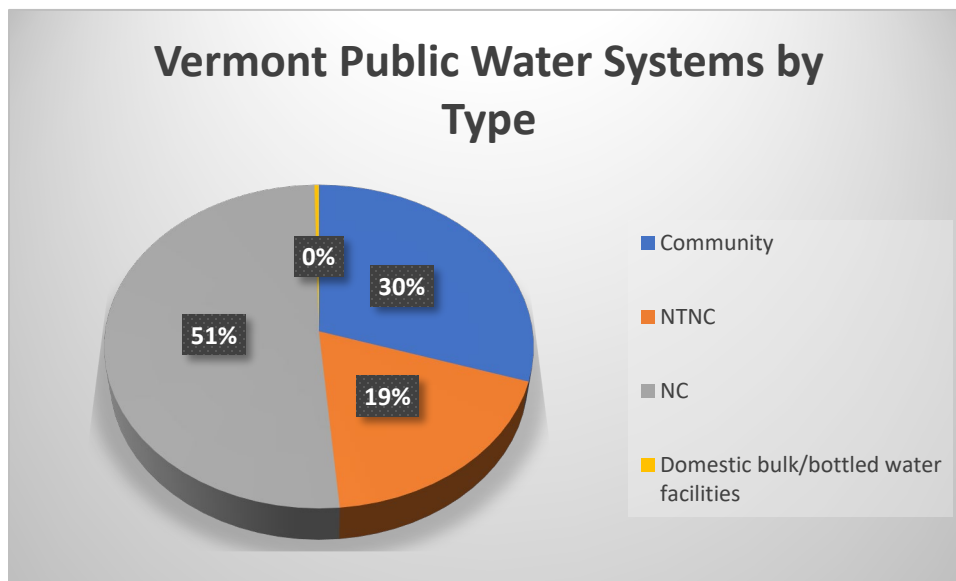

The NC (i.e., TNC) systems represent the largest number of systems in the state. Most NC systems are small businesses (e.g., service stations and restaurants) or recreational areas (i.e., campgrounds, ski areas, and parks) that can serve a large number of people for a short time. Although NCs serve a large population across the state, they provide water to the same people for only a limited time.

Because people consume most of their drinking water at their places of residence, community systems are the primary focus of the state drinking water program. Between 60

- 70% of the population of Vermont is served by community water systems. Nationally, the statistic is that roughly 95% of the U.S. population receive water from a community water system (based on the U.S. Census Bureau, 2021). The State of Vermont is unique in that, compared with the entire nation; a large percentage of the state population is served by small community systems (i.e., serving less than 3,300 people). The small community systems in Vermont supply water to 37% of the total population served by community systems.

## **COMPLIANCE AND TECHNICAL ASSISTANCE**

The Drinking Water and Groundwater Protection Division's (Division) primary goal is to protect public health, retain primacy under the federal SDWA, and apply an enforcement strategy designed to encourage compliance with the law. One of the greatest challenges for the state's drinking water program is related to the smaller water systems (those serving 3,300 or fewer people). These systems are faced with increasing complexity and costs related to increasing regulatory requirements, as well as the need for basic infrastructure repairs and replacements. Many of Vermont's smaller systems lack a sufficient customer base among which to spread costs and cannot find enough volunteers to run the water systems and track regulatory compliance. The smaller systems typically serve rural communities, often comprised of residential customers that are less able to pay substantial amounts for their water (compared to industrial and commercial customers) or afford consultants.

Vermont's smaller water systems are developing an increased awareness of the components necessary to provide safe drinking water today and into the future. These components can be grouped into technical, managerial, and financial (i.e., TMF) capabilities. To assist systems, the state has a capacity development program as required by the 1996 amendments to the SDWA. The program's goal is to ensure that no new systems are created that lack adequate TMF capacity to meet drinking water standards now and, in the future, and to help existing systems develop sufficient capacity.

In addition to system capacity, the SDWA includes an emphasis on contamination prevention through an expanded ground water protection strategy and efforts to assess and protect surface water sources of drinking water. The Division implemented a source water assessment program to assess the susceptibility to contamination of each public water system. Each assessment provided information to serve as the foundation for a source water protection program. Specifically, the assessment inventoried the significant potential sources of contamination within each delineated source water protection area and helped to gain a better understanding of the source's susceptibility to contamination. Having updated Source Protection Plans is an on-going requirement for public community and non-transient non-community systems to ensure new sources are adequately protected and new potential sources of contamination are identified.

The Division also provides other types of technical assistance for public water systems, including the efforts listed in Figure 4. These efforts are designed to help with the

successful operation of public water systems including compliance with the many requirements to avoid violations and enforcement actions.

**Figure 4.**

**Types of Assistance the Drinking Water & Groundwater Protection Division (DWGPD) provides to help water systems remain in and/or return to compliance.**

- conducting sanitary surveys every 3-5 years
- issuing chemical monitoring waivers, when appropriate
- providing on-site assistance and technical support
- providing electronic communications for changing/new regulations
- contributing articles to newsletters and publications
- sending compliance reminders and pre-violation warnings
- developing a coordinated training calendar
- targeted telephone reminders for systems with yearly compliance requirements
- operator training
- holding public information meetings
- reviewing water system plans and specifications
- issuing Operating Permits which identify system deficiencies and include compliance schedules
- providing financial assistance for various system improvements through the State Revolving Fund (SRF) and connecting water systems with available federal compliance and technical assistance programs
- using non-profit groups, such as Vermont Rural Water Association (VRWA) and Rural Community Assistance Partnership (RCAP) , to assist water systems
- coordinating with the Waste Management and Prevention Division for on-site investigation/cleanup
- coordinating with state and federal emergency management personnel
- conducting source water assessments and reviewing source protection plans

## **VIOLATIONS AND ENFORCEMENT ACTIVITIES**

The goals of enforcement actions are to deter future violations and to protect public health. If a public water system violates a federal or state regulation, notification of the violation is sent to the system. The notification typically requires the system to inform the public (i.e., water system users) of the violation and how to return to compliance. If the system does not comply, the state will take appropriate enforcement actions.

In most cases, sending a Notice of Alleged Violation (NOAV) is the first step in the enforcement process. An NOAV serves as formal notification to the water system that the Division believes a violation is occurring or has occurred. If a system fails to comply with



the conditions in the NOAV, the Division will evaluate the compliance status and decide whether further enforcement action is necessary.

The next enforcement action may be to refer the case to the Agency of Natural Resources Office of General Council, Enforcement and Litigation Section or the Environmental Protection Agency (EPA). The Division works closely with litigation staff and/or EPA until a final action has been completed. Typically, issuance of a Civil Complaint or an Assurance of Discontinuance (AOD) is the first course of action taken by litigation staff.

Litigation staff may issue a Civil Complaint which includes a monetary penalty when it is determined that a violation exists, however these complaints do not direct or mandate action on behalf of the system. A list of environmental citations for federal or state public drinking water regulatory violations and penalty amounts is provided at: <https://dec.vermont.gov/enforcement/final>. The Civil Complaint process is being streamlined to allow for more efficient and uniform application across all DEC programs.

Once a Civil Complaint is filed with the Vermont Superior Court, Environmental Division (Environmental Court) and mailed to the respondent, respondents must deliver a plea to the Court (admitted, no contest, or denied) within 15 days of the issuance of the Complaint, otherwise a default judgment will be entered against the respondent. If a respondent requests a hearing on the Civil Complaint, the Environmental Court will schedule the matter for trial.

By issuing a Civil Complaint, the Secretary cannot seek an additional penalty for the violation specified in the complaint if the waiver penalty is paid, judgment is entered after trial or appeal, or a default judgment is entered. However, the Secretary may issue additional civil complaints or take other enforcement actions authorized by law, including a monetary penalty when a violation is continuing or is repeated. It may also bring an enforcement action to obtain injunctive relief or remediation and may recover the costs of bringing that action and any economic benefit the respondent obtained as a result of the underlying violation as authorized by law.

An AOD is an agreement signed by the owner of the water system and the Commissioner of the Department of Environmental Conservation which sets milestones and schedules for the system to achieve compliance. The final step in the process is for the AOD to be signed by the Vermont Environmental Court Judge. Once signed by the judge, the AOD assumes the authority of a court order. The agreement generally includes a penalty for the economic benefit of noncompliance plus a penalty for the actual violation and a schedule under which the water system will return to compliance.


If litigation staff, in consultation with the Division, are unable to settle a violation with an AOD, further enforcement action may include issuance of an Administrative Order (AO). If litigation staff determine that defending an AO will require more resources than are available within the ANR, it may refer the case to the Attorney General's office for further action. AOs are heard by the Environmental Court, with the final decision being provided as a Judgment Order by the Court. AOs also often contain a penalty for the violations.

The Division’s enforcement historically has concentrated on group enforcement actions for specific types of violations. While this approach is still used (e.g., enforcing against NCs failing to do both coliform and nitrate monitoring), the Division also uses tracking of compliance schedules with the Operating Permit as an all-encompassing approach for individual water systems. On-going enforcement efforts focus on systems that failed to: complete coliform or chemical monitoring and public notification requirements; reduce disinfection byproducts; install corrosion control; install radium, uranium or arsenic treatment; use permitted sources; install disinfection; obtain necessary source, construction, or operating permits; and comply with milestones to correct deficiencies outlined in their permit to operate.

***Violations Issued In 2023***


In 2023, the Division issued 842 violations, (i.e., Notices of Alleged Violation or NOAVs) to 410 water systems comprised of: 211 transient non-community systems (NCs), 141 community systems, 57 non-transient non-community systems (NTNCs), and 1 currently classified as Non-Public (NP). This includes 16 water systems with 41 violations that ceased operation as a public water system during 2023, including 1 violation for an NP water system that received a monitoring & reporting violation before being reclassified. The NOAVs issued to water systems include failure to conduct water quality monitoring; meet treatment techniques; meet MCLs; correct system deficiencies identified in a sanitary survey; meet the compliance schedule in the Operating Permit; issue public notice; complete RTCR assessments; resolve sanitary defects; complete seasonal start-ups (NCs); or issue the annual CCR (community systems). Figure 5 shows the distribution of the 842 violations by water systems by type (Community, NTNC, NC, NP) in each category.

**Figure 5.**

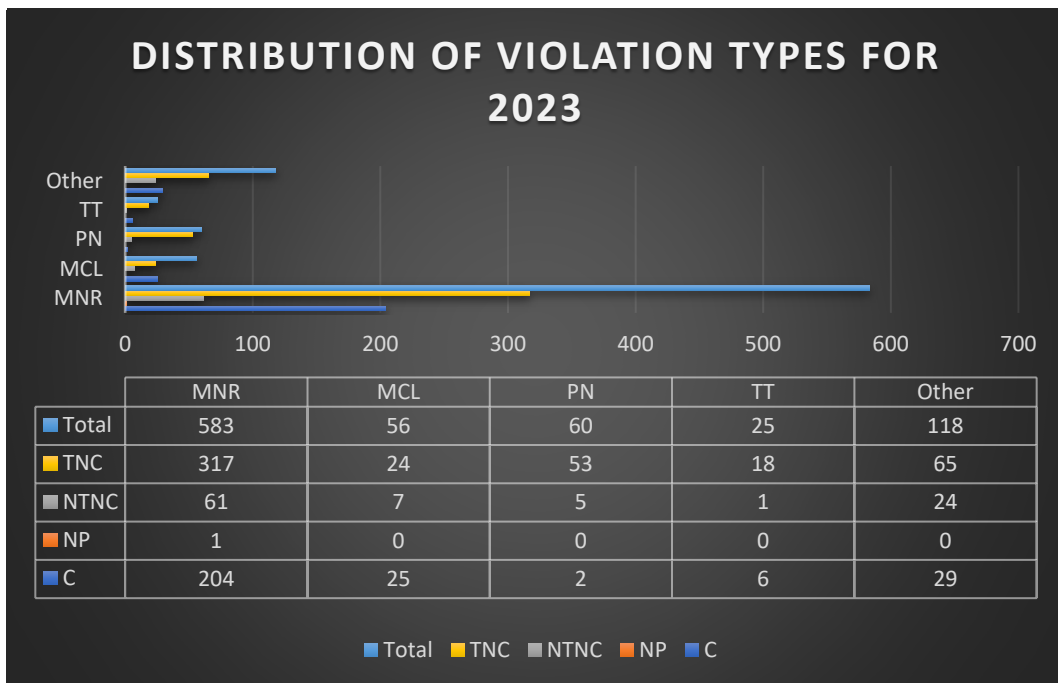

The majority of violations incurred in 2023 were for monitoring and reporting, which follows suit with previous years' data. Figure 6. below, shows a comparison of the total number of violations issued each year from 2017 through 2023, respectively. The total number of reported violations issued in 2020 was significantly lower than previous years mostly due to the impacts of covid-19. The number reported did not accurately reflect the actual quantity of violations incurred. Due to workload demands and many water systems opening/closing or active during non-routine operating periods as a result of the pandemic, Division staff were delayed in issuing timely violations, so many of the 2020 violations weren't issued until early 2021. The average of violations issued for both 2020 and 2021 is consistent with the number of violations issued each of the previous years following the implementation of the Revised Total Coliform Rule (RTCR) in 2016. The slightly increased number of violations during 2023 compared to 2022, is that there were significantly more violations issued for failure to complete public notice than previous years, largely due to a new position and increased capacity to track compliance with public notice requirements.

**Figure 6.**

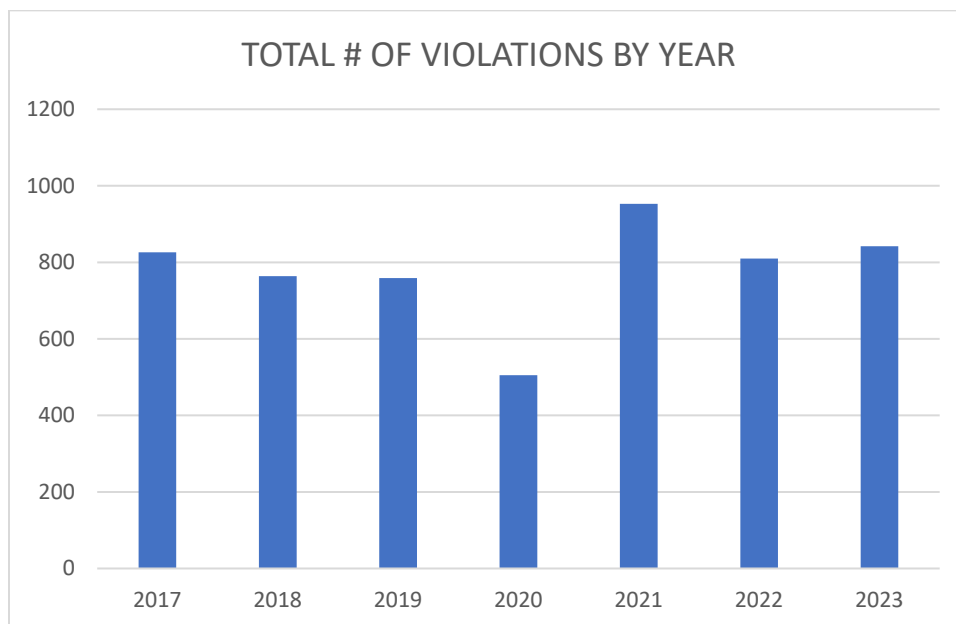

Four systems were referred to the Agency of Natural Resources litigation staff in 2023 for enforcement action. This is in addition to three other systems with enforcement actions in progress that have been referred in previous years. Three referral cases were fully resolved in 2023.

The Division does not yet have primacy to fully implement the RTCR. Water systems with ongoing violations including RTCR will be referred to EPA for enforcement. No systems were referred to EPA for enforcement in 2023.

## ***Violation Reporting***

The state reports violation and enforcement information to EPA quarterly. These reports include public water system inventory information, updates on new and existing enforcement actions, as well as Maximum Contaminant Level (MCL), monitoring, reporting, treatment technique, and public notice violations. In addition, the state prepares this annual compliance report by July 1st for the previous calendar year. This report provides the total numbers of violations during the year for each of the categories required in the Safe Drinking Water Act: 1) MCLs, 2) Treatment Techniques, and 3) Monitoring, Reporting & Public Notification violations.

In 2023, 38 Water Supply Rule Violations (vio code WS) were issued to 14 systems due to the exceedance of the state MCL for Per- and Polyfluoroalkyl Substances (PFAS). Although these violations do not count toward the total MCLs with a federal violation code in Figure 5 above, it is important to note the large number.

When reviewing the number of systems with MCL violations for type 01, 02, or M&R violations of type 03 assessed during calendar year 2023, for any water system that had previously exceeded an MCL and received a violation, but then failed to monitor and report results the following quarter, the system does not incur both an MCL and M&R violation during the same respective quarter.

Figure 7. provides a description of each violation category. The annual report also includes the name and WSID number of the systems with violations.

### **Figure 7. Description of the violation categories.**

#### **1. Maximum Contaminant Level (MCL)**

Under the SDWA the EPA sets national standards on contaminant levels in drinking water to ensure that the water is safe for human consumption. States can be more but not less stringent on setting new standards (e.g., Uranium has a lower standard in Vermont than the federal standard). These standards are known as Maximum Contaminant Levels (MCLs). This report includes MCL violations for the regulated chemical/radiological contaminants and the microbiological contaminants under the Revised Total Coliform Rule.

#### **2. Treatment Techniques (TT)**

For some regulations, the EPA establishes treatment techniques in lieu of an MCL to control unacceptable levels of certain contaminants. For example, treatment techniques have been established for viruses, bacteria, and turbidity under the Surface Water Treatment Rule. This report includes treatment technique violations for the Surface Water Treatment Rule, the Lead and Copper Rule, the Ground Water Rule, and the Revised Total Coliform Rule.

### **3. Significant Monitoring & Reporting (M&R) Violations**

A PWS is required to monitor and verify that the levels of contaminants present in the water do not exceed the MCL. Generally, the larger the population served by a water system, the more frequent the M&R requirements. If a PWS fails to have its water tested as required, then a monitoring violation occurs. An M&R violation also includes failure to report test results correctly to the primacy agency (except for the Revised Total Coliform Rule).

For this report, significant monitoring and reporting violations are defined as any major monitoring violation that has occurred during the specified report interval. A major monitoring violation (except for the Surface Water Treatment Rule) occurs when no samples were collected, or no results were reported during a compliance period. A major Surface Water Treatment Rule M/R violation occurs when fewer than 90 % of the required samples are taken or no results are reported during a reporting interval. A minor violation occurs when some but not all of the required numbers of samples are taken. This report includes both major and minor monitoring violations for chemical monitoring, the Revised Total Coliform Rule, the Surface Water Treatment Rule, the Groundwater Rule and the Lead and Copper Rule.

### **4. Reporting Violations**

Under the Revised Total Coliform Rule, monitoring and reporting violations were broken out into separate categories rather than under one M&R violation. This allows for reporting violations to have their own directives and apply more stringent directives for monitoring violations. If a PWS completes required work (e.g., required monitoring or assessment) but fails to submit the monitoring or assessment report to the state within the required timeframe, a reporting violation has occurred.

### **5. Significant Consumer Notification Violations**

Every Community Water System is required to deliver to its customers a consumer confidence report (CCR), which is a brief annual water quality report. This report is to provide information on source water, the levels of any detected contaminants, and compliance with drinking water regulations, as well as include some educational material. A community water system that completely fails to provide customers with the required annual water quality report will incur a significant consumer notification violation.

### **6. Public Notification Violations**

Public notification is required when a PWS receives a violation or in certain emergency situations such as a boil water notice. If a PWS fails to notify customers and provide certification within the specified time frames, the system will incur a violation for failing to public notice. Should the situation warrant an immediate response, such as a Boil Water Notice or Do Not Drink Notice, the Division may step in and distribute the notice to system users, then issue a violation for the system's failure to do so.

The attached table titled “2023 Violations – Vermont Public Water Systems” reports the total number of violations and each type of violation incurred in all of the public water systems with a determination date that occurred between January 1, 2023 and December 31, 2023. Note that subtotals indicating the number of systems with violations may not equal the sum of the number of violations because some systems incurred multiple violations.

Definitions for table headings in the 2023 Violation – Vermont Public Water Systems attachment are as follows:

Violation: A failure to meet any state or federal drinking water regulation.

Vio Type: Specific numeric codes from the Safe Drinking Water Information System (SDWIS) that have been assigned to each violation type included in this report. See Figure 8.

Vio Name: This identifies which violation category is assigned to the violation. (e.g., MCL, Monitoring, Reporting, TT, etc.).

**Figure 8. Current EPA/STATE Violation Codes - Violation Name and Type**

Violation Code - Name	Violation Type
01 - MCL, SINGLE SAMPLE	MCL
02 - MCL, AVERAGE	MCL
02 - MCL, AVERAGE (CHLORITE)	MCL
02 - MCL, LRAA	MCL
03 - MONITORING, ROUTINE MAJOR	M&R
03 - MONITORING, ROUTINE MINOR	M&R
04 - MONITORING, CONFIRMATION/CHECK MAJOR	M&R
04 - MONITORING, CONFIRMATION/CHECK MINOR	M&R
05 - NOTIFICATION, STATE	PN
05 - NOTIFICATION, STATE, GWR	PN
06 - NOTIFICATION, PUBLIC (PRE-2003)	PN
07 - TREATMENT TECHNIQUES (OTHER)	TT
08 - VARIANCE/EXEMPTION/OTHER COMPLIANCE	V/E
09 - RECORD KEEPING, WITH RULE CODE	RPT
09 - RECORD KEEPING, WITHOUT RULE CODE	RPT
10 - OPERATIONS REPORT	RPT
11 - MRDL (CHLORINE/CHLORAMINE)	MCL
11 - MRDL, MONITORING (CHL. DIOXIDE)	MCL
11 - MRDL, NON-ACUTE (CHL.DIOXIDE)	MCL
12 - QUALIFIED OPERATOR FAILURE	TT
13 - MRDL, ACUTE (CHL.DIOXIDE)	MCL
19 - MONITORING, (GWR), ASSESSMENT, MAJOR	M&R
19 - MONITORING, (GWR), ASSESSMENT, MINOR	M&R

1A - MCL, E. COLI, POS E COLI (RTCR)	MCL
20 - FAILURE TO CONSULT, GWR	TT
20 - FAILURE TO CONSULT/RESPOND, EPA	TT
20 - FAILURE TO RESPOND, IESWTR	TT
21 - MCL (TCR), ACUTE	MCL
22 - MCL (TCR), MONTHLY	MCL
23 - MONITORING (TCR), ROUTINE MAJOR	M&R
24 - MONITORING (TCR), ROUTINE MINOR	M&R
25 - MONITORING (TCR), REPEAT MAJOR	M&R
26 - MONITORING (TCR), REPEAT MINOR	M&R
27 - FAILURE TO HAVE MONITORING PLAN (DBP)	M&R
27 - MONITORING, (DBP) (CHL. DIOXIDE)	M&R
27 - MONITORING, ROUTINE (DBP), MAJOR	M&R
27 - MONITORING, ROUTINE (DBP), MINOR	M&R
28 - SANITARY SURVEY COOPERATION FAILURE	OTHER
29 - CPE FAILURE (EI/LT1 SWTR)	M&R
29 - FAILURE TO PRODUCE FILTER ASSESSMENT	M&R
2A - LEVEL 1 ASSESS, MULTIPLE TC POS (RTCR)	TT
2A - LEVEL 1 ASSESS, TC POS RT NO RPT (RTCR)	TT
2B - LEVEL 2 ASSESSMENT, 2ND LEVEL 1(RTCR)	TT
2B - LEVEL 2 ASSESSMENT, MCL TRIGGERED (RTCR)	TT
2C - CORRECTIVE/EXPEDITED ACTIONS (RTCR)	TT
2D - STARTUP PROCEDURES TT (RTCR)	TT
2E - LSL INVENTORY-INITIAL	TT
2E - LSL INVENTORY-UPDATED	TT
30 - FAILURE TO HAVE MONITORING PLAN (IDSE)	M&R
30 - MONITORING, ROUTINE (IDSE), MAJOR	M&R
30 - MONITORING, ROUTINE (IDSE), MINOR	M&R
31 - MONITORING, RT MAJOR (LT2-UNFILTERED)	M&R
31 - MONITORING, RT MINOR (LT2-UNFILTERED)	M&R
31 - MONITORING, RTN/RPT MAJOR (GWR)	M&R
31 - MONITORING, RTN/RPT MAJOR (SWTR-UNFILT)	M&R
31 - MONITORING, RTN/RPT MINOR (GWR)	M&R
31 - MONITORING, RTN/RPT MINOR (SWTR-UNFILT)	M&R
32 - FAILURE SUBMIT MICROBIAL TOOLBOX REPORT	RPT
32 - FAILURE TO HAVE MONITORING PLAN (LT2)	RPT
32 - MONITORING, SOURCE (LT2), MAJOR	M&R
32 - MONITORING, SOURCE (LT2), MINOR	M&R
33 - FAILURE SUBMIT BIN/TREAT REQUIRE (LT2)	RPT
34 - MONITOR GWR TRIGGERED/ADDITONAL, MAJOR	M&R
34 - MONITOR GWR TRIGGERED/ADDITONAL, MINOR	M&R
35 - FAILURE SUBMIT IDSE/SUBPT V PLAN (DBPR2)	M&R
35 - FAILURE SUBMIT OEL REPORT FOR HAA5	M&R
35 - FAILURE SUBMIT OEL REPORT FOR TTHM	M&R
35 - FAILURE SUBMIT SUBPART V PLAN, ESCALATED	M&R
36 - MONITORING, RT MAJOR (LT2-FILTERED)	M&R

36 - MONITORING, RT MINOR (LT2-FILTERED)	M&R
36 - MONITORING, RTN/RPT MAJOR (SWTR-FILTER)	M&R
36 - MONITORING, RTN/RPT MINOR (SWTR-FILTER)	M&R
37 - FAILURE TO PROFILE/CONSULT	TT
38 - MONITORING, ROUTINE (IESWTR/LT1), MAJOR	M&R
38 - MONITORING, ROUTINE (IESWTR/LT1), MINOR	M&R
39 - FAILURE TO SUBMIT PLANT SCHEMATIC (FBR)	M&R
3A - MONITORING, ROUTINE, MAJOR (RTCR)	M&R
3A - MONITORING, ROUTINE, MINOR (RTCR)	M&R
3B - MONITORING, ADD. ROUTINE, MAJOR (RTCR)	M&R
3B - MONITORING, ADD. ROUTINE, MINOR (RTCR)	M&R
3C - MONITOR COLIFORM TURBIDITY TRIGGER RTCR	M&R
3D - MONITORING, LAB CERT/METHOD ERROR (RTCR)	M&R
40 - FAILURE TO PROPERLY RECYCLE (FBR)	TT
41 - FAILURE MAINTAIN MICROBIAL TREAT.(GWR)	TT
41 - FAILURE MAINTAIN MICROBIAL TREAT.(LT2)	TT
41 - MONTHLY COMB. FILTER EFFLUENT (SWTR)	TT
41 - RES DISINFECT CONCENTRATION (SWTR)	TT
41 - SINGLE COMB. FILTER EFFLUENT (SWTR)	TT
42 - FAILURE TO FILTER (SWTR)	TT
42 - FAILURE TO PROVIDE GWR TREATMENT	TT
42 - FAILURE TO PROVIDE LT2 TREATMENT	TT
43 - SINGLE COMB FLTR EFFLUENT (IESWTR/LT1)	TT
44 - MONTHLY COMB FLTR EFFLUENT (IESWTR/LT1)	TT
45 - FAILURE ADDRESS DEFICIENCY (EPA SURVEY)	TT
45 - FAILURE ADDRESS DEFICIENCY (GWR)	TT
45 - FAILURE ADDRESS DEFICIENCY (IESWTR)	TT
46 - INADEQUATE DBP PRECURSOR REMOVAL	TT
47 - COVER OR TREAT STORAGE FACILITY (LT2)	TT
47 - UNCOVERED STORAGE FACILITY (IESWTR/LT1)	TT
48 - FAILURE TO ADDRESS CONTAMINATION (GWR)	TT
4A - REPORTING, ASSESSMENT FORMS (RTCR)	RPT
4B - REPORT SAMPLE RESULT/FAIL MONITOR RTCR	RPT
4C - REPORT STARTUP PROCEDURES CERT FORM RTCR	RPT
4D - NOTIFICATION, E COLI POSITIVE (RTCR)	RPT
4E - NOTIFICATION, E. COLI MCL (RTCR)	RPT
4F - NOTIFY L1/L2 TT VIO, CORRECT ACTION RTCR	RPT
4G - LSL REPORTING	RPT
51 - INITIAL TAP SAMPLING (LCR)	M&R
52 - FOLLOW-UP OR ROUTINE TAP M/R (LCR)	M&R
53 - WATER QUALITY PARAMETER M/R (LCR)	M&R
56 - INITIAL/FOLLOW-UP/ROUTINE SOWT M/R (LCR)	M&R
57 - OCCT/SOWT RECOMMENDATION/STUDY (LCR)	RPT
58 - OCCT/SOWT INSTALL DEMONSTRATION (LCR)	TT
59 - WQP LEVEL NON-COMPLIANCE (LCR)	TT



5A - SAMPLE SITING PLAN ERRORS (RTCR)	RPT
5B - RECORDKEEPING VIOLATIONS (RTCR)	RPT
63 - MPL LEVEL NON-COMPLIANCE (LCR)	TT
64 - LEAD SERVICE LINE REPLACEMENT (LCR)	TT
65 - PUBLIC EDUCATION (LCR)	RPT
66 - LEAD CONSUMER NOTICE (LCR)	RPT
71 - CCR REPORT	RPT
72 - CCR ADEQUACY/AVAILABILITY/CONTENT	RPT
73 - FAILURE TO NOTIFY OTHER PWS	RPT
75 - PUBLIC NOTICE RULE LINKED TO VIOLATION	PN
76 - PUBLIC NOTICE RULE NOT LINKED VIOLATION	PN
SL - STATE LEVEL VIOLATION	STATE
SM - STATE MONITORING/REPORTING VIOLATION	STATE
WD - SYSTEM DEFICIENCIES	STATE
WG - FAILURE TO MAKE GWUDI DETERMINATION	STATE
WN - OPERATING WITHOUT A PERMIT	STATE
WO - WSR VIO. - NO OPERATOR	STATE
WP - TEMPORARY OPERATING PERMIT - PN FAILURE	STATE
WS - WATER SUPPLY RULE VIOLATIONS	STATE
WT - TEMPORARY OPERATING PERMIT VIOLATION	STATE
WU - UNPERMITTED SOURCE	STATE

Analyte/Group Code: Four-digit SDWIS Codes have also been included in the summary below for each specific contaminant with a violation of an MCL or M&R.

Analyte/Group Name: Identifies the specific contaminant or contaminant group involved in the violation. This name typically corresponds with the water system's routine compliance monitoring schedule.

System Type: This indicates whether the public water system is a community (C), a non-community non-transient (NTNC) or a transient non-community (NC). Examples of NTNCs are schools and businesses. Examples of NCs are campgrounds, parks, restaurants, or inns.

Compliance Period: The period in which the water system is in violation.

Maximum Contaminant Level (MCL): The standard set for a contaminant or the highest amount of a contaminant that the EPA allows in drinking water. MCLs ensure that drinking water does not pose either a short-term or long-term health risk. MCLs are defined in milligrams per liter (parts per million) unless otherwise specified.

Significant Monitoring/Reporting Violations (M&R/SM): All public water systems are required to sample their water for drinking water contaminants. EPA specifies which water testing methods the water systems must use and the state or EPA set the frequency of testing [CFR Part 141]. A water system that does not follow the required monitoring schedule or methodology is in violation. States must report monitoring violations that are significant

as determined by the EPA Administrator and in consultation with the states. For purposes of this report, significant monitoring violations are major violations, and they occur when no samples are collected, or no results are reported during a compliance period. A major monitoring violation for the surface water treatment rule occurs when at least 90% of the required samples are not taken or results are not reported during the compliance period. An SM violation code indicates a violation of state required monitoring such as Iron and Manganese and PFAS.

Treatment Techniques (TT): A water treatment process that EPA requires instead of an MCL for contaminants that laboratories cannot adequately measure. Failure to meet other operational and system requirements under the Surface Water Treatment Rule, Groundwater Rule, Revised Total Coliform Rule, and the Lead and Copper Rule have also been included in this category of violation for purposes of this report.

### ***Contaminant-Specific Information***

#### Organic Contaminants (VOCs and SOCs)

Organic Contaminants are man-made carbon-based compounds, such as industrial solvents and pesticides. These contaminants generally get into water through improperly cured sealant, runoff from crop land, discharge from factories, or contamination from underground fuel storage tanks. EPA has set standards for over 50 organic contaminants that are to be reported [40 CFR 141.61]. Individual organic contaminants are classified as being either volatile organic compounds (VOCs) or synthetic organic compounds (SOCs). Some of these constituents may have a state action level that is lower than the EPA standard.

A statewide waiver has been approved for the following chemicals by the EPA: Dibromochloropropane (DBCP), Dalapon, Diquat, Endothall, Glyphosate, and Dioxin. However, a Vermont Action Level (VAL) exists for DBCP and therefore, monitoring is required for all C and NTNC water systems.

Ethylene Dibromide testing is required for only groundwater systems. A statewide waiver has been approved for surface water systems by the EPA.

Public water systems are required to certify annually in writing to the Drinking Water and Groundwater Protection Division that the combination of percent monomer and treatment chemical dosage does not exceed certain levels when coagulant aids, which contain the monomers Acrylamide and Epichlorohydrin, are used to treat drinking water [CFR 141.111].

SDWIS Analyte Codes, the contaminant name, and the corresponding MCL (mg/l) are given below for the organic contaminants (VOC and SOC groups).

2981 1,1,1-Trichloroethane 0.2  
2977 1,1-Dichloroethylene 0.007  
2985 1,1,2-Trichloroethane 0.005  
2378 1,2,4-Trichlorobenzene 0.07  
2931 1,2-Dibromo-3-chloropropane (DBCP) 0.0002  
2980 1,2-Dichloroethane 0.005  
2983 1,2-Dichloropropane 0.005  
2063 2,3,7,8-TCDD (Dioxin) 3x10-8  
2110 2,4,5-TP 0.05  
2105 2,4-D 0.07  
2265 Acrylamide 0.05% dose at 1  
2051 Alachlor 0.002  
2050 Atrazine 0.003  
2990 Benzene 0.005  
2306 Benzo[a]pyrene 0.0002  
2046 Carbofuran 0.04  
2982 Carbon tetrachloride 0.005  
2959 Chlordane 0.002  
2380 cis-1,2-Dichloroethylene 0.07  
2031 Dalapon 0.2  
2035 Di(2-ethylhexyl)adipate 0.4  
2039 Di(2-ethylhexyl)phthalate 0.006  
2964 Dichloromethane 0.005  
2041 Dinoseb 0.007  
2032 Diquat 0.02  
2033 Endothall 0.1  
2005 Endrin 0.002  
2257 Epichlorohydrin 0.01% dose at 20  
2992 Ethylbenzene 0.7  
2946 Ethylene dibromide 0.00005  
2034 Glyphosate 0.7  
2065 Heptachlor 0.0004  
2067 Heptachlor epoxide 0.0002  
2274 Hexachlorobenzene 0.001  
2042 Hexachlorocyclopentadiene 0.05  
2010 Lindane 0.0002  
2015 Methoxychlor 0.04  
2989 Monochlorobenzene 0.1  
2968 o-Dichlorobenzene 0.6  
2969 para-Dichlorobenzene 0.075  
2383 Total polychlorinated biphenyls 0.0005  
2326 Pentachlorophenol 0.001  
2987 Tetrachloroethylene 0.005  
2984 Trichloroethylene 0.005  
2996 Styrene 0.1  
2991 Toluene 1

2979 trans-1,2-Dichloroethylene 0.1  
2955 Xylenes (total) 10  
2020 Toxaphene 0.003  
2036 Oxamyl (Vydate) 0.2  
2040 Picloram 0.5  
2037 Simazine 0.004  
2976 Vinyl chloride 0.002

SDWIS Codes MCL - Total disinfectant by-products (DBP)  
2950 Total Trihalomethanes 0.080  
2456 Total Haloacetic Acids 0.060

### Per- and Polyfluoroalkyl Substances (PFAS)

PFAS are a group of thousands of human-made (they do not occur naturally) organic chemicals that have been widely used in industry and consumer products worldwide since at least the 1950s. They do not break down easily and are widespread in the environment. These chemicals are used to make household and commercial products that resist heat and chemical reactions and repel oil, stains, grease, and water. Some common products that may contain PFAS include non-stick cookware, water-resistant clothing and materials, cleaning products, cosmetics, food packaging materials, and some personal care products.

In March of 2020, the Vermont Water Supply Rule was revised to incorporate a state MCL and regulations for per- and polyfluoroalkyl substances (PFAS) in drinking water. The regulated PFAS are as follows: **PFOA** (perfluorooctanoic acid), **PFOS** (perfluorooctanesulfonic acid), **PFHxS** (perfluorohexane sulfonic acid), **PFHpA** (perfluoroheptanoic acid), **PFNA** (perfluorononanoic acid). The sum of any combination of these five PFAS cannot exceed 20 parts per trillion (ppt).

SDWIS Analyte Codes and contaminant names are given below for the regulated PFAS.

2802 Perfluoroheptanoic acid (PFHpA)  
2803 Perfluorohexane sulfonic acid (PFHxS)  
2804 Perfluorononanoic acid (PFNA)  
2805 Perfluorooctanesulfonic acid (PFOS)  
2806 Perfluorooctanoic acid (PFOA)

### Inorganic Contaminants

Inorganic Contaminants are non-carbon-based compounds such as metals, nitrates, and asbestos. These contaminants can be naturally-occurring but can also make their way into water sources through farming, chemical manufacturing, and other human activities. Vermont has 18 primary inorganic contaminants with MCLs [see Table 6-1 of the [Vermont Water Supply Rule](#)]. Few inorganic chemicals have been detected above the MCL in Vermont's drinking water supplies.

Monitoring for Asbestos is required only for systems that contain asbestos cement, or “AC”, pipes in their distribution system which are considered vulnerable. A statewide waiver for groundwater and surface water sources for Asbestos has been approved by the EPA.

SDWIS Analyte Codes, the contaminant name, and the corresponding MCL (mg/l) are given below for the Inorganic Contaminants (IOCs).

1074 Antimony 0.006  
1005 Arsenic 0.010  
1094 Asbestos 7 million fibers/liter > 10 µm long  
1010 Barium 2  
1075 Beryllium 0.004  
1015 Cadmium 0.005  
1020 Chromium 0.1  
1024 Cyanide (as free cyanide) 0.2  
1025 Fluoride 4.0  
1035 Mercury 0.002  
1036 Nickel 0.1  
1040 Nitrate 10 (as Nitrogen)  
1041 Nitrite 1 (as Nitrogen)  
1045 Selenium 0.05  
1085 Thallium 0.002  
1038 Total nitrate and nitrite 10 (as Nitrogen)

#### Radionuclides

Radionuclides are radioactive particles which can occur naturally in water and soil or result from human activity. The EPA has several radionuclide MCLs including: combined radium-226 and -228, combined uranium, adjusted gross alpha, beta particle and photon radioactivity from man-made radionuclides, gross beta activity, tritium, and strontium. Presently in Vermont, all public community systems are only required to monitor for Combined Radium -226 & -228, Gross Alpha, and Uranium.

Violations for Radionuclides are to be reported using the following Contaminant codes:

4000 Adjusted Gross Alpha 15 pCi/L  
4010 Combined Radium-226 and Radium-228 5 pCi/L  
4006 Combined Uranium 20 µg/L.

Adjusted Gross Alpha: SDWIS Contaminant Code 4000 is used for gross alpha radiation above the MCL of 15 picocuries/liter (pCi/L). The Gross Alpha MCL includes radium-226 but excludes radon and uranium. Laboratories typically report uncorrected gross alpha

results only, and therefore the state calculates the adjusted value, enters into the database, and determines compliance with the MCL.

Combined radium-226 and radium-228: SDWIS Contaminant Code 4010 is for combined radium from these two isotopes above the MCL of 5 pCi/L. Radium results for 226 and 228 are entered individually given they are analyzed by separate analytical methods and SDWIS CDS Setups sums the values and creates that number as contaminant code 4010 to compare with the MCL.

Combined Uranium: SDWIS Contaminant Code 4006 is for uranium above the MCL. In Vermont, the MCL is 20 µg/L. The EPA has an MCL of 30 µg/L. Confirmed exceedance of the Vermont MCL of 20 µg/L requires the distribution of a “Do Not Drink” public notice to system users due to the potential short-term health effects. This is de-coupled from compliance with the MCL which is calculated based on the Running Annual Average as explained below.

Beta particle and photon radioactivity: SDWIS Contaminant Code 4101 for beta particle and photon radioactivity from man-made radionuclides above 4 millirem/year. Only Community Water Systems designated as utilizing waters contaminated by effluents from nuclear facilities or otherwise designated as vulnerable must sample for additional radionuclides [CFR Part 141.26].

The MCL(s) for this group of contaminants is based on a running annual average (RAA) of four consecutive quarters and logged under EPA MCL violation type 02, or type 01 if a single sample causes the running annual average to immediately exceed.

### Revised Total Coliform Rule

The Revised Total Coliform Rule (RTCR), became effective on April 1, 2016, superseding the Total Coliform Rule (TCR). The RTCR, like its predecessor, establishes regulations for microbiological contaminants in drinking water. The RTCR establishes an MCL for E. coli and uses E. coli and total coliforms to initiate a “find and fix” approach to address fecal contamination that could enter into the distribution system. It requires public water systems to perform assessments to identify sanitary defects and subsequently take action to correct them and prevent future contamination. Upon transitioning to the RTCR on April 1, 2016, from the TCR, the violation codes changed. States are to report five categories of violations – MCL, Treatment Technique, Monitoring, Reporting & Other Violations:

#### MCL Violations:

E. coli (EC) MCL Violation: SDWIS Violation Code 1A indicates that the system found fecal coliform, or E. Coli, in its water and at least one other total-coliform-positive sample, thereby violating the rule.

#### Treatment Technique Violations:

Level 1 (L1) Assessment/Assessment Form Treatment Technique Violation: SDWIS Violation Code 2A indicates that a system failed to conduct a L1 assessment or failed to conduct an adequate L1 assessment to identify the possible presence of sanitary defects and defects in distribution system coliform monitoring practices.

Level 2 (L2) Assessment/Assessment Form Treatment Technique Violation: SDWIS Violation Code 2B indicates that a system failed to conduct a L2 assessment or failed to conduct an adequate L2 assessment to identify the possible presence of sanitary defects and defects in distribution system coliform monitoring practices.

Corrective Actions/Expedited Action Treatment Technique Violation: SDWIS Violation Code 2C indicates a system failed to complete corrective actions within the requirement timeframe when a L1 or L2 assessment is triggered or fails to comply with state-required expedited/additional actions when an E.coli MCL is exceeded.

Start-Up Treatment Technique Violation: SDWIS Violation Code 2D indicates a seasonal system (NC) failed to complete seasonal start-up procedures.

#### Monitoring Violations:

Routine Monitoring Violation: SDWIS Violation Code 3A indicates that a system failed to collect routine samples at the appropriate site/frequency or failed to collect replacement samples when the State or lab invalidated one or more routine samples.

Additional Routine Monitoring Violation: SDWIS Violation Code 3B indicates that a system failed to collect additional routine samples required the next month after any TC+ happens. This is only applicable when the system's baseline RTCR monitoring frequency is quarterly.

TC Samples (triggered by turbidity exceedance) Monitoring Violation: SDWIS Violation Code 3C indicates that a system failed to collect required extra total coliform samples due to a turbidity exceedance. This only applies to Subpart H Systems avoiding filtration, which there are currently none in Vermont.

Monitoring Violation due to Lab and/or Analytical Method Errors: SDWIS Violation Code 3D indicates that a system failed to use the required/approved analytical methods, or to follow holding times, or sample preparation or collection methods or failure to use a certified and/or State-approved laboratory.

#### Reporting Violations:

Assessment Forms Reporting Violation: SDWIS Violation Code 4A indicates that a system failed to timely submit a completed assessment form.

Sample Results Reporting Violation: SDWIS Violation Code 4B indicates that a system failed to provide sample results information to the state or failed to provide notification to the state that a monitoring violation happened.

Certification Form (for Start-up Procedures Reporting Violation: SDWIS Violation Code 4C indicates that a system failed to provide the certificate that confirms seasonal system start-up procedures have been completed. This is applicable when the start-up procedures were completed on-time and were adequate but the delivery of the certificate to the state was late.

EC+ Notification Reporting Violation: SDWIS Violation Code 4D indicates that a system failed to notify the State within 24 hours about an EC+ compliance sample result, even if there is no E. coli MCL violation.

EC+ MCL Reporting Violation: SDWIS Violation Code 4E indicates that a system failed to provide notification to the State that an E.coli MCL violation happened.

Assessment, Assessment Forms, Corrective/Expedited Actions Reporting Violation: SDWIS Violation Code 4F indicates that a system failed to notify the State that violations related to Level 1 & Level 2 assessments, assessment forms and corrective actions have happened.

Other Violations:

Errors with Sample Siting Plan (Other) Violation: SDWIS Violation Code 5A indicates that a system failed develop a sample siting plan or to revise a sample siting plant that includes a sample collection schedule and or sample sites or the SOP describing how the sample sites were chosen.

RTCR Recordkeeping Violation: SDWIS Violation Code 5B indicates that a system failed to keep records for L1 and L2 assessments and corrective/expedited actions for 5 years or for failure to keep records for 1 year on repeat samples results that the State approved and extended the time frame for sample collection.

### Surface Water Treatment Rule

The Surface Water Treatment Rule establishes criteria under which water systems supplied by surface water sources, or ground water sources under the direct influence of surface water, must filter and disinfect their water. Filtered Systems are water systems that have installed filtration treatment. Unfiltered Systems are water systems that do not need to filter their water before disinfecting it because the source is very clean. Surface water treatment regulations are contained in 40 CFR 141, Subpart H.

Violations of the "Surface Water Treatment Rule" are to be reported for the following categories:

Monitoring, routine/repeat (for filtered systems): SDWIS Violation Code 36 indicates a system's failure to carry out required tests, or to report the results of those tests.

Treatment techniques (for filtered systems): SDWIS Violation Code 41 shows a system's failure to properly treat its water.



Monitoring, routine/repeat (for unfiltered systems): SDWIS Violation Code 31 indicates a system's failure to carry out required water tests, or to report the results of those tests.

Failure to filter (for unfiltered systems): SDWIS Violation Code 42 shows a system's failure to properly treat its water.

#### Surface Water Treatment Rule – EPA Violation Codes

##### Filtered Systems

36 Monitoring, routine/repeat

41 Treatment techniques

##### Unfiltered systems

31 Monitoring, routine/repeat

42 Failure to filter

#### Lead and Copper Rule

The Lead and Copper Rule's purpose is to ensure that elevated levels of lead (Pb) and copper (Cu) are reduced through corrosion control of a water system. Systems identified as having corrosion problems are required to do follow-up monitoring and reporting. [40 CFR 141, Subpart I].

Violations of the "Lead and Copper Rule" are to be reported for the following categories:

Initial lead and copper tap monitoring/reporting: SDWIS Violation Code 51 indicates a system's failure to carry out an initial test on Pb/Cu.

Follow-up or routine lead and copper tap monitoring/reporting: SDWIS Violation Code 52 indicates that periodic monitoring is not being done as required.

Water quality parameter monitoring/reporting: SDWIS Violation Code 53 indicates that this monitoring was not done as required. Violation Code 59 indicates failure to maintain ranges.

Source water monitoring/reporting: SDWIS Violation Code 56 indicates that this monitoring was not done as required.

Corrosion control treatment recommendation: SDWIS Violation Code 57 indicates that this recommendation was not submitted as required.

Treatment installation: SDWIS Violation Code 58 indicates treatment was not installed to mitigate high levels of Pb/Cu.

Public education: SDWIS Violation Code 65 indicates public education not done.

Consumer Notification: SDWIS Violation Code 66 indicates consumer notification of test results was not done.

#### Lead and Copper Rule – EPA Violation Codes

- 51 Initial lead and copper tap M/R
- 52 Follow-up or routine lead and copper tap M/R
- 53 Water Quality Parameter M/R
- 56 Source water monitoring M/R
- 57 Treatment Recommendation
- 58 Failure to Install CCT
- 59 Failure to Maintain OWQPs
- 63 Failure to meet MPL
- 64 AL Exceedance post CCT/ failure to replace LSLs
- 65 Public Education
- 66 Consumer Notice

#### Ground Water Rule

The Ground Water Rule's purpose is to reduce the risk of illness caused by microbial contamination in public water systems. The rule establishes a risk-targeting approach to identify ground systems susceptible to fecal contamination and requires corrective action to correct significant deficiencies and source water fecal contamination in all public ground water systems including consecutives. [40 CFR 141, Subpart R]

Violations of the "Ground Water Rule" are to be reported for the following categories:

Monitoring & Reporting: SDWIS Violation Codes 31 & 34

Treatment techniques: SDWIS Violation Codes 41, 42, 45 & 48

Other: SDWIS Violation Codes 5, 9, 20, 28 & 73

#### Consumer Confidence Report Rule

The Consumer Confidence Report (CCR) Rule requires Public Community Water Systems to issue an annual water quality report to their customers. The CCR for the previous calendar year must be distributed to customers by July 1st of each year. The reports tell where drinking water comes from, what's in it, and how you can help protect it. EPA classifies violations for failure to provide customers a CCR as a Significant Consumer Notification Violation. [40 CFR 141, Subpart O]

Consumer Confidence Report Rule - EPA Violation Codes:

- 71 CCR Report
- 72 CCR Adequacy/Availability/Content

## Public Notification Rule

Public notification is required when a PWS receives certain violations and must be provided within a specified time frame depending on the type of violation. If a PWS fails to notify customers of the violation and provide certification within the specified time frames, the system will incur a violation for failing to public notice. [40 CFR 141, Subpart Q]

Public Notification Rule – EPA Violations Codes:

75 Public notice linked to violation

76 Public notice not linked to violation

In addition to the EPA public notice violation types above, Vermont may assess public notification violations according to the Section 10.1 of the Vermont Water Supply Rule. In 2023, 8 Water Supply Rule violations (Type 7500) were assessed to 4 public water systems for failure to provide adequate public notice as prescribed.

END OF REPORT

## 2023 Violations - Vermont Public Water Systems

**Vio Type: 01**

**Vio Name: MCL, SINGLE SAMPLE**

**Analyte/Group Code: 1005**

**Analyte/Group Name: ARSENIC**

WSID	WS Name	Active	Population	System Type	Compliance Period Begin	Compliance Period End	City/Town
VT0006408	FARNSWORTH CAMP	A	306	NC	1/1/2023	3/31/2023	THETFORD

**Number of Systems: 1**

**Number of Violations: 1**

**Population: 306**

**Vio Type: 01**

**Vio Name: MCL, SINGLE SAMPLE**

**Analyte/Group Code: 4006**

**Analyte/Group Name: COMBINED URANIUM**

WSID	WS Name	Active	Population	System Type	Compliance Period Begin	Compliance Period End	City/Town
VT0020031	VERNON HALL	A	50	C	4/1/2023	6/30/2023	VERNON

**Number of Systems: 1**

**Number of Violations: 1**

**Population: 50**

**Vio Type: 02**

**Vio Name: MCL, AVERAGE**

**Analyte/Group Code: 1005**

**Analyte/Group Name: ARSENIC**

WSID	WS Name	Active	Population	System Type	Compliance Period Begin	Compliance Period End	City/Town
VT0006408	FARNSWORTH CAMP	A	306	NC	7/1/2023	9/30/2023	THETFORD
VT0020622	LAKEHOUSE PUB AND GRILLE	A	101	NC	4/1/2023	6/30/2023	CASTLETON
VT0020732	CW MULHOLLAND WELL 3	A	75	NC	10/1/2023	12/31/2023	CASTLETON
VT0020732	CW MULHOLLAND WELL 3	A	75	NC	10/1/2022	12/31/2022	CASTLETON
VT0020732	CW MULHOLLAND WELL 3	A	75	NC	1/1/2023	3/31/2023	CASTLETON
VT0020732	CW MULHOLLAND WELL 3	A	75	NC	4/1/2023	6/30/2023	CASTLETON
VT0021195	MTN VIEW SEVENTH DAY ADVENTIST CHURCH	A	269	NC	7/1/2023	9/30/2023	VERNON

**Number of Systems: 4**

**Number of Violations: 7**

**Population: 751**

**Vio Type: 02**

**Vio Name: MCL, AVERAGE**

**Analyte/Group Code: 2456**

**Analyte/Group Name: TOTAL HALOACETIC ACIDS (HAA5)**

WSID	WS Name	Active	Population	System Type	Compliance Period Begin	Compliance Period End	City/Town
VT0005229	RUTLAND CITY WATER DEPT	A	18500	C	10/1/2023	12/31/2023	RUTLAND CITY
VT0005471	GORE ROAD MHP	A	100	C	7/1/2023	9/30/2023	BENNINGTON
VT0005471	GORE ROAD MHP	A	100	C	10/1/2023	12/31/2023	BENNINGTON
VT0021051	HERITAGE HILL ASSOCIATION	A	102	C	10/1/2023	12/31/2023	RUTLAND TOWN
VT0021053	MEADOWS - GABLES I WATER SYSTEM	A	310	C	10/1/2023	12/31/2023	RUTLAND TOWN
VT0021570	GABLES II WATER SYSTEM	A	22	C	10/1/2023	12/31/2023	RUTLAND TOWN

**Number of Systems: 5**

**Number of Violations: 6**

**Population: 19034**

**Vio Type: 02**

**Vio Name: MCL, AVERAGE**

**Analyte/Group Code: 2950**

**Analyte/Group Name: TTHM**

WSID	WS Name	Active	Population	System Type	Compliance Period Begin	Compliance Period End	City/Town
VT0021302	HIGHGATE SPRINGS POE	A	150	NTNC	10/1/2023	12/31/2023	HIGHGATE

**Number of Systems: 1**

**Number of Violations: 1**

**Population: 150**

**Vio Type: 02**

**Vio Name: MCL, AVERAGE**

**Analyte/Group Code: 4000**

**Analyte/Group Name: GROSS ALPHA, EXCL. RADON & U**

WSID	WS Name	Active	Population	System Type	Compliance Period Begin	Compliance Period End	City/Town
VT0002603	BUTTERNUT PROPERTIES	A	36	NTNC	7/1/2022	9/30/2022	KILLINGTON

**Number of Systems: 1**

**Number of Violations: 1**

**Population: 36**

**Vio Type: 02**

**Vio Name: MCL, AVERAGE**

**Analyte/Group Code: 4006**

**Analyte/Group Name: COMBINED URANIUM**

WSID	WS Name	Active	Population	System Type	Compliance Period Begin	Compliance Period End	City/Town
VT0020031	VERNON HALL	A	50	C	1/1/2023	3/31/2023	VERNON
VT0020031	VERNON HALL	A	50	C	10/1/2022	12/31/2022	VERNON
VT0020031	VERNON HALL	A	50	C	7/1/2023	9/30/2023	VERNON

**Number of Systems: 1**

**Number of Violations: 3**

**Population: 50**

**Vio Type: 02**

**Vio Name: MCL, AVERAGE**

**Analyte/Group Code: 4010**

**Analyte/Group Name: COMBINED RADIUM (-226 & -228)**

WSID	WS Name	Active	Population	System Type	Compliance Period Begin	Compliance Period End	City/Town
VT0002603	BUTTERNUT PROPERTIES	A	36	NTNC	7/1/2022	9/30/2022	KILLINGTON
VT0002603	BUTTERNUT PROPERTIES	A	36	NTNC	1/1/2023	3/31/2023	KILLINGTON
VT0002603	BUTTERNUT PROPERTIES	A	36	NTNC	4/1/2023	6/30/2023	KILLINGTON
VT0002603	BUTTERNUT PROPERTIES	A	36	NTNC	10/1/2022	12/31/2022	KILLINGTON
VT0005331	ROYALTON TERRACE	A	60	C	10/1/2023	12/31/2023	ROYALTON
VT0005384	WHIFFLETREE CONDOMINIUM	A	189	C	7/1/2023	9/30/2023	KILLINGTON
VT0005397	BATTLEGROUNDS CONDOMINIUM	A	166	C	7/1/2023	9/30/2023	FAYSTON
VT0005397	BATTLEGROUNDS CONDOMINIUM	A	166	C	4/1/2023	6/30/2023	FAYSTON
VT0005397	BATTLEGROUNDS CONDOMINIUM	A	166	C	1/1/2023	3/31/2023	FAYSTON
VT0005397	BATTLEGROUNDS CONDOMINIUM	A	166	C	10/1/2023	12/31/2023	FAYSTON
VT0005397	BATTLEGROUNDS CONDOMINIUM	A	166	C	10/1/2022	12/31/2022	FAYSTON
VT0005589	CHRISTMAS TREE - SUNDOWN CONDOMINIUM	A	110	C	4/1/2023	6/30/2023	WARREN
VT0005589	CHRISTMAS TREE - SUNDOWN CONDOMINIUM	A	110	C	1/1/2023	3/31/2023	WARREN
VT0005589	CHRISTMAS TREE - SUNDOWN CONDOMINIUM	A	110	C	7/1/2023	9/30/2023	WARREN
VT0005589	CHRISTMAS TREE - SUNDOWN CONDOMINIUM	A	110	C	10/1/2023	12/31/2023	WARREN
VT0009073	KILLINGTON CENTER INN	A	132	NC	7/1/2023	9/30/2023	KILLINGTON
VT0009073	KILLINGTON CENTER INN	A	132	NC	10/1/2023	12/31/2023	KILLINGTON

VT0009073	KILLINGTON CENTER INN	A	132	NC	4/1/2023	6/30/2023	KILLINGTON
VT0009073	KILLINGTON CENTER INN	A	132	NC	1/1/2023	3/31/2023	KILLINGTON

**Number of Systems:** 6                      **Number of Violations:** 19                      **Population:** 693

**Vio Type:** 03                                      **Vio Name:** MONITORING, ROUTINE MAJOR

**Analyte/Group Code:** 1005                      **Analyte/Group Name:** ARSENIC

WSID	WS Name	Active	Population	System Type	Compliance Period Begin	Compliance Period End	City/Town
VT0005179	RANDOLPH VILLAGE	A	2700	C	1/1/2023	3/31/2023	RANDOLPH
VT0005452	NEW ENGLAND KURN HATTIN HOMES	A	200	C	7/1/2023	9/30/2023	WESTMINSTER
VT0006408	FARNSWORTH CAMP	A	306	NC	4/1/2023	6/30/2023	THETFORD
VT0020732	CW MULHOLLAND WELL 3	A	75	NC	7/1/2023	9/30/2023	CASTLETON

**Number of Systems:** 4                      **Number of Violations:** 4                      **Population:** 3281

**Vio Type:** 03                                      **Vio Name:** MONITORING, ROUTINE MAJOR

**Analyte/Group Code:** 1040                      **Analyte/Group Name:** NITRATE

WSID	WS Name	Active	Population	System Type	Compliance Period Begin	Compliance Period End	City/Town
VT0006671	CALAIS ELEMENTARY SCHOOL	A	165	NTNC	10/1/2022	12/31/2022	CALAIS
VT0021020	EASTFIELD CONDOMINIUM ASSN INC	A	63	C	10/1/2022	12/31/2022	FAIRFAX

**Number of Systems:** 2                      **Number of Violations:** 2                      **Population:** 228

**Vio Type:** 03                                      **Vio Name:** MONITORING, ROUTINE MAJOR

**Analyte/Group Code:** CAIN                      **Analyte/Group Name:** CDS FOR ALL INORGAN

WSID	WS Name	Active	Population	System Type	Compliance Period Begin	Compliance Period End	City/Town
VT0005379	RHODESIDE ACRES	A	65	C	7/1/2023	9/30/2023	GEORGIA

**Number of Systems:** 1                      **Number of Violations:** 1                      **Population:** 65

**Vio Type:** 03                                      **Vio Name:** MONITORING, ROUTINE MAJOR

**Analyte/Group Code:** CASB                      **Analyte/Group Name:** CDS FOR ASBESTOS

WSID	WS Name	Active	Population	System Type	Compliance Period Begin	Compliance Period End	City/Town
VT0005059	COLCHESTER FIRE DISTRICT 2	A	8300	C	10/1/2022	12/31/2022	COLCHESTER
VT0005084	RICHMOND WATER DEPT	A	1048	C	10/1/2022	12/31/2022	RICHMOND

**Number of Systems:** 2                      **Number of Violations:** 2                      **Population:** 9348

**Vio Type:** 03                                      **Vio Name:** MONITORING, ROUTINE MAJOR

**Analyte/Group Code:** CCYN                      **Analyte/Group Name:** CDS FOR CYANIDE

WSID	WS Name	Active	Population	System Type	Compliance Period Begin	Compliance Period End	City/Town
VT0005294	MAGIC VILLAGE WATER COOP	A	308	C	10/1/2022	12/31/2022	LONDONDERRY
VT0006750	HALIFAX WEST SCHOOL	A	93	NTNC	10/1/2022	12/31/2022	HALIFAX
VT0020721	METTAWEE COMMUNITY SCHOOL	A	352	NTNC	7/1/2023	9/30/2023	PAWLET

VT0021182 APPLEJACK ART PARTNERS INC A 75 NTNC 1/1/2023 3/31/2023 MANCHESTER

Number of Systems: 4 Number of Violations: 4 Population: 828

Vio Type: 03 Vio Name: MONITORING, ROUTINE MAJOR

Analyte/Group Code: CGA Analyte/Group Name: CDS FOR GROSS ALPHA

WSID	WS Name	Active	Population	System Type	Compliance Period Begin	Compliance Period End	City/Town
VT0005041	LYN HAVEN FIRE DISTRICT 1	A	100	C	1/1/2023	3/31/2023	LYNDON
VT0005253	BIRCHWOOD PARK	A	30	C	7/1/2023	9/30/2023	BARRE TOWN
VT0005382	EDGEMONT CONDOMINIUMS	A	108	C	7/1/2023	9/30/2023	KILLINGTON
VT0005577	MOUNTAIN SIDE CONDOMINIUM	A	45	C	1/1/2023	3/31/2023	LONDONDERRY
VT0005649	COLD BROOK FD BASE AREA	A	761	C	1/1/2023	3/31/2023	WILMINGTON
VT0020986	HUCKLE HILL HOUSING	A	49	C	4/1/2023	6/30/2023	VERNON

Number of Systems: 6 Number of Violations: 6 Population: 1093

Vio Type: 03 Vio Name: MONITORING, ROUTINE MAJOR

Analyte/Group Code: CIOC Analyte/Group Name: CDS FOR INORGANICS

WSID	WS Name	Active	Population	System Type	Compliance Period Begin	Compliance Period End	City/Town
VT0020376	KILLINGTON UPPER ADMINISTRATION BLDG	A	284	NTNC	1/1/2023	3/31/2023	KILLINGTON

Number of Systems: 1 Number of Violations: 1 Population: 284

Vio Type: 03 Vio Name: MONITORING, ROUTINE MAJOR

Analyte/Group Code: CNO3 Analyte/Group Name: CDS FOR NITRATE

WSID	WS Name	Active	Population	System Type	Compliance Period Begin	Compliance Period End	City/Town
VT0000237	SANDYS DRIVE IN	I	29	NC	1/1/2022	12/31/2022	SHARON
VT0000487	INN AT LONG TRAIL	A	178	NC	1/1/2022	12/31/2022	KILLINGTON
VT0001702	CHANTECLEER RESTAURANT	A	122	NC	1/1/2022	12/31/2022	DORSET
VT0001715	BRONWYN ON BATTENKILL	A	100	NC	1/1/2022	12/31/2022	ARLINGTON
VT0001852	ROMAS BUTCHERY	A	63	NC	1/1/2022	12/31/2022	ROYALTON
VT0002060	SITZMARK LODGE	A	795	NC	1/1/2022	12/31/2022	WILMINGTON
VT0002218	INN AT WEATHERSFIELD	A	75	NC	1/1/2022	12/31/2022	WEATHERSFIELD
VT0002309	VERMONT FINE	A	25	NC	1/1/2022	12/31/2022	RICHMOND
VT0002603	BUTTERNUT PROPERTIES	A	36	NTNC	1/1/2022	12/31/2022	KILLINGTON
VT0002719	CABINS AT AUTUMN MOUNTAIN WINERY	I	98	NC	1/1/2022	12/31/2022	BRANDON
VT0004115	ARCADY AT THE SUNDERLAND MOTOR LODGE	A	58	NC	1/1/2022	12/31/2022	SUNDERLAND
VT0004307	FIFE N DRUM MOTEL	A	35	NC	1/1/2022	12/31/2022	BENNINGTON
VT0004479	SOUTH GATE MOTEL	A	50	NC	1/1/2022	12/31/2022	BENNINGTON
VT0005262	EAST CALAIS FIRE DISTRICT 1	A	200	C	1/1/2023	3/31/2023	CALAIS
VT0005282	DRUMLEYS CONDOMINIUMS	A	92	C	7/1/2023	9/30/2023	WARREN
VT0005312	CHIMNEY HILL	A	2594	C	1/1/2023	3/31/2023	WILMINGTON
VT0005312	CHIMNEY HILL	A	2594	C	1/1/2023	3/31/2023	WILMINGTON
VT0005312	CHIMNEY HILL	A	2594	C	1/1/2023	3/31/2023	WILMINGTON

VT0005312	CHIMNEY HILL	A	2594	C	1/1/2023	3/31/2023	WILMINGTON
VT0005312	CHIMNEY HILL	A	2594	C	1/1/2023	3/31/2023	WILMINGTON
VT0005341	WINDSOR WATER DEPT	A	2350	C	1/1/2023	3/31/2023	WINDSOR
VT0005375	TALL TIMBERS MHP	A	275	C	7/1/2023	9/30/2023	HARTFORD
VT0005426	RICHMOND FIRE DISTRICT 1	A	56	C	7/1/2023	9/30/2023	RICHMOND
VT0005538	RIVER ROAD APARTMENTS	A	50	C	7/1/2023	9/30/2023	STOWE
VT0005598	LEDGES SYSTEM 1	A	252	C	1/1/2023	3/31/2023	PLYMOUTH
VT0005600	GLEN RUN CONDOMINIUM	A	100	C	7/1/2023	9/30/2023	DOVER
VT0005654	CHIMNEY HILL COLCHESTER	A	42	C	1/1/2023	3/31/2023	COLCHESTER
VT0006071	TOWNSHEND ELEMENTARY SCHOOL	A	105	NTNC	4/1/2023	6/30/2023	TOWNSHEND
VT0006457	HOSMER POINT OUTDOOR CAMP	A	150	NC	1/1/2022	12/31/2022	CRAFTSBURY
VT0006650	LOWELL GRADED SCHOOL	A	120	NTNC	4/1/2023	6/30/2023	LOWELL
VT0006667	WATERFORD ELEMENTARY SCHOOL	A	203	NTNC	10/1/2022	12/31/2022	WATERFORD
VT0006729	CONCORD SCHOOL	A	370	NTNC	10/1/2022	12/31/2022	CONCORD
VT0006750	HALIFAX WEST SCHOOL	A	93	NTNC	1/1/2023	3/31/2023	HALIFAX
VT0008020	WOODFORD STATE PARK	A	422	NC	1/1/2022	12/31/2022	WOODFORD
VT0008201	CHIPMAN POINT MARINA	A	25	NC	1/1/2022	12/31/2022	ORWELL
VT0008333	NORTHERNSHIRE	A	166	NTNC	7/1/2023	9/30/2023	UNDERHILL
VT0020098	ORCHARD COMMONS	A	64	C	4/1/2023	6/30/2023	HINESBURG
VT0020135	FARMS AT CLUB SUGARBUSH	A	48	C	1/1/2023	3/31/2023	WARREN
VT0020151	TRAILSIDE AT MAGIC MOUNTAIN	A	150	C	10/1/2022	12/31/2022	LONDONDERRY
VT0020247	NEWFANE STORE	A	33	NC	1/1/2022	12/31/2022	NEWFANE
VT0020381	RUNAMOK MAPLE FACILITY	A	150	NTNC	10/1/2022	12/31/2022	FAIRFAX
VT0020524	SMORE FAMILY FUN	I	243	NC	1/1/2022	12/31/2022	HYDE PARK
VT0020600	POND VIEW LLC - JOES POND	A	50	NC	1/1/2022	12/31/2022	DANVILLE
VT0020691	AMERICAN FLATBREAD AND LAREAU FARM INN	A	253	NC	1/1/2022	12/31/2022	WAITSFIELD
VT0020813	RAMUNTOS ARLINGTON	A	40	NC	1/1/2022	12/31/2022	ARLINGTON
VT0020879	NEW HOPE BIBLE CHURCH	A	399	NC	1/1/2022	12/31/2022	IRASBURG
VT0020965	VENTURE OUT BASECAMP	I	104	NC	1/1/2022	12/31/2022	WHITINGHAM
VT0021124	MILL POND CAMPGROUND	A	283	NC	1/1/2022	12/31/2022	FRANKLIN
VT0021157	CRAFTSBURY GENERAL STORE	A	45	NC	1/1/2022	12/31/2022	CRAFTSBURY
VT0021250	OTTER CREEK FUN CENTER	A	220	NC	1/1/2022	12/31/2022	DANBY
VT0021311	NVRH WATER SYSTEM	A	125	NTNC	4/1/2023	6/30/2023	SAINT JOHNSBURY
VT0021315	PARKER PIE	A	89	NC	1/1/2022	12/31/2022	GLOVER
VT0021410	THE OLD GRAY BARN	A	235	NC	1/1/2022	12/31/2022	BENNINGTON
VT0021411	SUNRISE ORCHARDS	A	42	NC	1/1/2022	12/31/2022	CORNWALL
VT0021454	HEARTBEET COMMUNITY CENTER	A	266	NTNC	1/1/2023	3/31/2023	HARDWICK
VT0021532	KINGDOM HALL - MORRISVILLE	A	220	NC	1/1/2022	12/31/2022	MORRISTOWN
VT0021550	SNOW FARM WINERY	A	114	NC	1/1/2022	12/31/2022	GRAND ISLE
VT0021647	WESTFORD COUNTRY STORE	A	28	NC	1/1/2022	12/31/2022	WESTFORD
VT0021662	BURKLYN INN	A	32	NC	1/1/2022	12/31/2022	BURKE

Number of Systems: 55

Number of Violations: 59

Population: 12562



**Vio Type: 03**

**Vio Name: MONITORING, ROUTINE MAJOR**

**Analyte/Group Code: CSOC**

**Analyte/Group Name: CDS FOR SOC**

WSID	WS Name	Active	Population	System Type	Compliance Period Begin	Compliance Period End	City/Town
VT0005600	GLEN RUN CONDOMINIUM	A	100	C	7/1/2023	9/30/2023	DOVER

**Number of Systems: 1**

**Number of Violations: 1**

**Population: 100**

**Vio Type: 03**

**Vio Name: MONITORING, ROUTINE MAJOR**

**Analyte/Group Code: CTRA**

**Analyte/Group Name: CDS FOR RADIUM**

WSID	WS Name	Active	Population	System Type	Compliance Period Begin	Compliance Period End	City/Town
VT0005076	HUNTINGTON FIRE DISTRICT 1	A	120	C	1/1/2023	3/31/2023	HUNTINGTON
VT0005104	BLOOMFIELD WATER SYSTEM	A	50	C	1/1/2023	3/31/2023	BLOOMFIELD
VT0005382	EDGEMONT CONDOMINIUMS	A	108	C	7/1/2023	9/30/2023	KILLINGTON
VT0020151	TRAILSIDE AT MAGIC MOUNTAIN	A	150	C	10/1/2022	12/31/2022	LONDONDERRY

**Number of Systems: 4**

**Number of Violations: 4**

**Population: 428**

**Vio Type: 03**

**Vio Name: MONITORING, ROUTINE MAJOR**

**Analyte/Group Code: CURA**

**Analyte/Group Name: CDS FOR URANIUM**

WSID	WS Name	Active	Population	System Type	Compliance Period Begin	Compliance Period End	City/Town
VT0020423	QUARRY HILL SCHOOL	A	30	NTNC	7/1/2023	9/30/2023	MIDDLEBURY

**Number of Systems: 1**

**Number of Violations: 1**

**Population: 30**

**Vio Type: 03**

**Vio Name: MONITORING, ROUTINE MAJOR**

**Analyte/Group Code: CVOC**

**Analyte/Group Name: CDS FOR VOC**

WSID	WS Name	Active	Population	System Type	Compliance Period Begin	Compliance Period End	City/Town
VT0005136	ALBURGH VILLAGE WATER SYSTEM	A	576	C	1/1/2023	3/31/2023	ALBURGH
VT0005312	CHIMNEY HILL	A	2594	C	1/1/2023	3/31/2023	WILMINGTON
VT0005312	CHIMNEY HILL	A	2594	C	1/1/2023	3/31/2023	WILMINGTON
VT0005312	CHIMNEY HILL	A	2594	C	1/1/2023	3/31/2023	WILMINGTON
VT0005312	CHIMNEY HILL	A	2594	C	1/1/2023	3/31/2023	WILMINGTON
VT0005382	EDGEMONT CONDOMINIUMS	A	108	C	7/1/2023	9/30/2023	KILLINGTON
VT0005632	KILLINGTON UPLAND WATER CO INC	A	518	C	1/1/2023	3/31/2023	KILLINGTON
VT0005654	CHIMNEY HILL COLCHESTER	A	42	C	1/1/2023	3/31/2023	COLCHESTER
VT0006665	POWNALE ELEMENTARY SCHOOL	A	428	NTNC	1/1/2023	3/31/2023	POWNALE
VT0020376	KILLINGTON UPPER ADMINISTRATION BLDG	A	284	NTNC	1/1/2023	3/31/2023	KILLINGTON
VT0021349	802 TOYOTA	I	51	NTNC	4/1/2023	6/30/2023	BERLIN
VT0021454	HEARTBEET COMMUNITY CENTER	A	266	NTNC	10/1/2022	12/31/2022	HARDWICK
VT0021767	WRP	A	54	NTNC	7/1/2023	9/30/2023	HARTFORD

**Number of Systems: 10**

**Number of Violations: 13**

**Population: 4921**

**Vio Type: 1A**

**Vio Name: MCL, E. COLI, POS E COLI (RTCR)**

**Analyte/Group Code: 3014**

**Analyte/Group Name: E. COLI**

WSID	WS Name	Active	Population	System Type	Compliance Period Begin	Compliance Period End	City/Town
VT0001089	QUIMBY COUNTRY	A	135	NC	8/24/2023		AVERILL
VT0005268	SUGAR RUN ASSOCIATION INC	A	197	C	7/28/2023	8/10/2023	FAYSTON
VT0005280	BUTTERNUT HILL	A	82	C	7/19/2023	8/10/2023	WAITSFIELD
VT0005385	MANSFIELD VIEW WATER CORP	A	121	C	6/30/2023	7/7/2023	STOWE
VT0005577	MOUNTAIN SIDE CONDOMINIUM	A	45	C	7/17/2023		LONDONDERRY
VT0006098	LEICESTER CENTRAL SCHOOL	A	176	NTNC	7/20/2023		LEICESTER
VT0006420	VERMONT STATE GRANGE CENTER	A	125	NC	9/15/2023		BROOKFIELD
VT0008209	BARRE COUNTRY CLUB	A	192	NC	11/2/2023		PLAINFIELD
VT0020524	SMORE FAMILY FUN	I	243	NC	6/28/2023		HYDE PARK
VT0021032	HIGHGATE VILLAGE MARKET	A	31	NC	10/9/2023		HIGHGATE
VT0021192	SUNRAY PEACE VILLAGE	A	204	NC	9/25/2023		LINCOLN
VT0021386	WEST ENOSBURG COUNTRY STORE	A	31	NC	11/2/2023		ENOSBURGH
VT0021386	WEST ENOSBURG COUNTRY STORE	A	31	NC	12/1/2023		ENOSBURGH
VT0021386	WEST ENOSBURG COUNTRY STORE	A	31	NC	6/23/2023	10/4/2023	ENOSBURGH
VT0021584	HILL FARMSTEAD BREWERY	A	39	NC	8/8/2023	9/1/2023	GREENSBORO
VT0021647	WESTFORD COUNTRY STORE	A	28	NC	1/11/2023		WESTFORD
VT0021647	WESTFORD COUNTRY STORE	A	28	NC	1/31/2023		WESTFORD

**Number of Systems: 14**

**Number of Violations: 17**

**Population: 1649**

**Vio Type: 27**

**Vio Name: MONITORING, ROUTINE (DBP), MAJOR**

**Analyte/Group Code: 0999**

**Analyte/Group Name: CHLORINE**

WSID	WS Name	Active	Population	System Type	Compliance Period Begin	Compliance Period End	City/Town
VT0005043	RYEGATE FIRE DISTRICT 2	A	131	C	5/1/2023	5/31/2023	RYEGATE
VT0005043	RYEGATE FIRE DISTRICT 2	A	131	C	7/1/2022	7/31/2022	RYEGATE
VT0005043	RYEGATE FIRE DISTRICT 2	A	131	C	9/1/2022	9/30/2022	RYEGATE
VT0005043	RYEGATE FIRE DISTRICT 2	A	131	C	10/1/2022	10/31/2022	RYEGATE
VT0005043	RYEGATE FIRE DISTRICT 2	A	131	C	11/1/2022	11/30/2022	RYEGATE
VT0005043	RYEGATE FIRE DISTRICT 2	A	131	C	12/1/2022	12/31/2022	RYEGATE
VT0005043	RYEGATE FIRE DISTRICT 2	A	131	C	1/1/2023	1/31/2023	RYEGATE
VT0005043	RYEGATE FIRE DISTRICT 2	A	131	C	2/1/2023	2/28/2023	RYEGATE
VT0005043	RYEGATE FIRE DISTRICT 2	A	131	C	3/1/2023	3/31/2023	RYEGATE
VT0005043	RYEGATE FIRE DISTRICT 2	A	131	C	4/1/2023	4/30/2023	RYEGATE
VT0005043	RYEGATE FIRE DISTRICT 2	A	131	C	6/1/2023	6/30/2023	RYEGATE
VT0005043	RYEGATE FIRE DISTRICT 2	A	131	C	8/1/2022	8/31/2022	RYEGATE
VT0009010	NORTH STAR LODGE	A	143	NC	5/1/2023	5/31/2023	KILLINGTON
VT0009010	NORTH STAR LODGE	A	143	NC	6/1/2023	6/30/2023	KILLINGTON
VT0020760	EAST MOUNTAIN MHP	A	76	C	10/1/2022	10/31/2022	BENNINGTON
VT0020799	SOUTHERN VERMONT ARTS CENTER	A	881	NC	1/1/2023	3/31/2023	MANCHESTER
VT0021037	VA MEDICAL CENTER	A	1225	NTNC	7/1/2022	7/31/2022	HARTFORD

Number of Systems: 5

Number of Violations: 17

Population: 2456

Vio Type: 27

Vio Name: MONITORING, ROUTINE (DBP), MAJOR

Analyte/Group Code: CDB2

Analyte/Group Name: CDS FOR DBP STAGE 2

WSID	WS Name	Active	Population	System Type	Compliance Period Begin	Compliance Period End	City/Town
VT0005003	EAST MIDDLEBURY FD 1	A	642	C	1/1/2023	12/31/2023	MIDDLEBURY
VT0005012	WHITING WATER CORP	A	61	C	1/1/2023	12/31/2025	WHITING
VT0005022	MANCHESTER WATER DEPT	A	4140	C	1/1/2023	12/31/2023	MANCHESTER
VT0005043	RYEGATE FIRE DISTRICT 2	A	131	C	1/1/2023	12/31/2023	RYEGATE
VT0005057	HILLCREST MHP INC	A	615	C	1/1/2023	12/31/2023	COLCHESTER
VT0005078	JERICHO HEIGHTS WATER COOP	A	40	C	1/1/2023	12/31/2023	JERICHO
VT0005125	MONTGOMERY WATER SYSTEM	A	530	C	1/1/2023	12/31/2023	MONTGOMERY
VT0005134	HOMESTEAD ACRES MHP	A	81	C	1/1/2023	12/31/2025	SWANTON
VT0005189	BARTON WATER SYSTEM	A	950	C	7/1/2023	9/30/2023	BARTON
VT0005248	GRANITEVILLE FIRE DISTRICT 4	A	700	C	4/1/2023	6/30/2023	BARRE TOWN
VT0005322	NORTH HARTLAND COOP WATER SYSTEM INC	A	262	C	1/1/2023	12/31/2025	HARTLAND
VT0005330	ROYALTON FIRE DISTRICT 1	A	1500	C	1/1/2023	12/31/2025	ROYALTON
VT0005331	ROYALTON TERRACE	A	60	C	1/1/2023	12/31/2025	ROYALTON
VT0005515	CASTLETON MEADOWS	A	107	C	1/1/2023	12/31/2023	CASTLETON
VT0005534	RUTLAND TOWN FIRE DISTRICT 1	A	401	C	1/1/2023	12/31/2025	RUTLAND TOWN
VT0005577	MOUNTAIN SIDE CONDOMINIUM	A	45	C	1/1/2023	12/31/2023	LONDONDERRY
VT0005590	HIGH RIDGE CONDOMINIUM	A	500	C	1/1/2023	12/31/2023	KILLINGTON
VT0005635	WINTERPLACE WATER SYSTEM	A	700	C	1/1/2023	12/31/2023	LUDLOW
VT0006658	BURKE TOWN SCHOOL	A	250	NTNC	1/1/2023	12/31/2025	BURKE
VT0020796	CHAMBERS MOBILE HOME VILLAGE	A	150	C	1/1/2023	12/31/2025	HARTFORD
VT0020801	WHITE BIRCHES MHP	A	125	C	10/1/2022	12/31/2022	BENNINGTON
VT0020833	WESTSHIRE ELEMENTARY SCHOOL	A	183	NTNC	1/1/2023	12/31/2025	WEST FAIRLEE
VT0020878	MACK MOLDING COMPANY	A	220	NTNC	1/1/2023	12/31/2025	ARLINGTON
VT0021020	EASTFIELD CONDOMINIUM ASSN INC	A	63	C	1/1/2023	12/31/2025	FAIRFAX
VT0021051	HERITAGE HILL ASSOCIATION	A	102	C	7/1/2023	9/30/2023	RUTLAND TOWN
VT0021051	HERITAGE HILL ASSOCIATION	A	102	C	4/1/2023	6/30/2023	RUTLAND TOWN
VT0021051	HERITAGE HILL ASSOCIATION	A	102	C	1/1/2023	3/31/2023	RUTLAND TOWN

Number of Systems: 25

Number of Violations: 27

Population: 12558

Vio Type: 2A

Vio Name: LEVEL 1 ASSESS, MULTIPLE TC POS (RTCR)

Analyte/Group Code: 8000

Analyte/Group Name: REVISED TOTAL COLIFORM RULE (RTCR)

WSID	WS Name	Active	Population	System Type	Compliance Period Begin	Compliance Period End	City/Town
VT0001805	WAITSFIELD INN	A	100	NC	9/6/2023	3/29/2024	WAITSFIELD

Number of Systems: 1

Number of Violations: 1

Population: 100

**Vio Type: 2A**

**Vio Name: LEVEL 1 ASSESS, TC POS RT NO RPT (RTCR)**

**Analyte/Group Code: 8000**

**Analyte/Group Name: REVISED TOTAL COLIFORM RULE (RTCR)**

WSID	WS Name	Active	Population	System Type	Compliance Period Begin	Compliance Period End	City/Town
VT0009010	NORTH STAR LODGE	A	143	NC	9/6/2023		KILLINGTON
VT0021248	BURKE TOWN OFFICES	A	112	NC	6/15/2023	7/25/2023	BURKE

**Number of Systems: 2**

**Number of Violations: 2**

**Population: 255**

**Vio Type: 2B**

**Vio Name: LEVEL 2 ASSESSMENT, 2ND LEVEL 1(RTCR)**

**Analyte/Group Code: 8000**

**Analyte/Group Name: REVISED TOTAL COLIFORM RULE (RTCR)**

WSID	WS Name	Active	Population	System Type	Compliance Period Begin	Compliance Period End	City/Town
VT0000268	LOT SIX BREWING CO	A	100	NC	2/19/2023	12/27/2023	CAMBRIDGE

**Number of Systems: 1**

**Number of Violations: 1**

**Population: 100**

**Vio Type: 2C**

**Vio Name: CORRECTIVE/EXPEDITED ACTIONS (RTCR)**

**Analyte/Group Code: 8000**

**Analyte/Group Name: REVISED TOTAL COLIFORM RULE (RTCR)**

WSID	WS Name	Active	Population	System Type	Compliance Period Begin	Compliance Period End	City/Town
VT0000268	LOT SIX BREWING CO	A	100	NC	6/5/2023	12/27/2023	CAMBRIDGE
VT0000372	WHEEL INN RESTAURANT	A	40	NC	6/10/2023		BENSON
VT0021392	PHOENIX HOUSE	A	25	NC	8/12/2022		BERKSHIRE
VT0021392	PHOENIX HOUSE	A	25	NC	8/13/2022		BERKSHIRE

**Number of Systems: 3**

**Number of Violations: 4**

**Population: 165**

**Vio Type: 2D**

**Vio Name: STARTUP PROCEDURES TT (RTCR)**

**Analyte/Group Code: 8000**

**Analyte/Group Name: REVISED TOTAL COLIFORM RULE (RTCR)**

WSID	WS Name	Active	Population	System Type	Compliance Period Begin	Compliance Period End	City/Town
VT0002042	PINE CONE SNACK BAR	A	55	NC	6/11/2023	5/1/2023	BERKSHIRE
VT0008159	MARYVILLE CAMPGROUND	A	124	NC	7/11/2023		DORSET
VT0020835	GROTON FOREST ROAD CAMPGROUND	A	140	NC	6/11/2023	7/20/2023	MARSHFIELD
VT0020844	BARREWOOD CAMPGROUND	A	190	NC	6/11/2023	8/14/2023	WESTFIELD
VT0021780	KAMPERSVILLE CAMPGROUND - LOONEY LANE	A	88	NC	6/11/2023	7/6/2023	SALISBURY

**Number of Systems: 5**

**Number of Violations: 5**

**Population: 597**

**Vio Type: 34**

**Vio Name: MONITOR GWR TRIGGERED/ADDITONAL, MAJOR**

**Analyte/Group Code: 3014**

**Analyte/Group Name: E. COLI**

WSID	WS Name	Active	Population	System Type	Compliance Period Begin	Compliance Period End	City/Town
VT0000268	LOT SIX BREWING CO	A	100	NC	12/30/2022	1/9/2023	CAMBRIDGE
VT0000322	VERMONT COUNTRY STORE WESTON	A	49	NC	8/2/2023	8/12/2023	WESTON
VT0000372	WHEEL INN RESTAURANT	A	40	NC	3/31/2023	4/10/2023	BENSON
VT0002218	INN AT WEATHERSFIELD	A	75	NC	9/28/2023	10/8/2023	WEATHERSFIELD

VT0002776	ROCKY RIDGE GOLF CLUB	A	60	NC	9/28/2023	10/8/2023	SAINT GEORGE
VT0004171	NORDIC MOTEL	A	66	NC	9/20/2023	9/30/2023	RUTLAND TOWN
VT0004333	BRITTANY MOTEL	A	32	NC	8/1/2023	8/11/2023	MANCHESTER
VT0004552	WEATHERVANE MOTEL	A	72	NC	10/18/2023	10/28/2023	MANCHESTER
VT0004552	WEATHERVANE MOTEL	A	72	NC	9/13/2023	9/23/2023	MANCHESTER
VT0005049	WHEELLOCK FIRE DISTRICT 1	A	50	C	1/18/2023	1/28/2023	WHEELLOCK
VT0005381	SHEFFIELD FIRE DISTRICT 1	A	50	C	2/2/2023	2/12/2023	SHEFFIELD
VT0005452	NEW ENGLAND KURN HATTIN HOMES	A	200	C	12/9/2022	12/19/2022	WESTMINSTER
VT0006690	E TAYLOR HATTON	A	60	NTNC	10/28/2022	11/7/2022	MORGAN
VT0008163	COUNTRYSIDE CAMPGROUND	A	149	NC	10/17/2023	10/27/2023	RYEGATE
VT0008209	BARRE COUNTRY CLUB	A	192	NC	11/3/2023	11/13/2023	PLAINFIELD
VT0009010	NORTH STAR LODGE	A	143	NC	6/29/2023	7/9/2023	KILLINGTON
VT0020384	PUTNEY INN	A	338	NC	9/15/2023	9/25/2023	PUTNEY
VT0020533	OCTAGON	A	170	NC	10/19/2023	10/29/2023	STOWE
VT0020972	ALBURGH BRIDGE JOLLEY	A	25	NC	1/10/2023	1/20/2023	ALBURGH
VT0021078	HYDE PARK VFW	A	175	NC	10/4/2023	10/14/2023	HYDE PARK
VT0021128	INN AT MOUNTAIN VIEW FARM	A	236	NC	6/8/2023	6/18/2023	BURKE
VT0021248	BURKE TOWN OFFICES	A	112	NC	4/26/2023	5/6/2023	BURKE
VT0021626	MANCHESTER COUNTRY CLUB BATHHOUSE	A	50	NC	9/13/2023	9/23/2023	MANCHESTER

Number of Systems: 22

Number of Violations: 23

Population: 2444

Vio Type: 35

Vio Name: FAILURE SUBMIT IDSE/SUBPT V PLAN (DBPR2)

Analyte/Group Code: 0600

Analyte/Group Name: DBP STAGE 2

WSID	WS Name	Active	Population	System Type	Compliance Period Begin	Compliance Period End	City/Town
VT0005043	RYEGATE FIRE DISTRICT 2	A	131	C	2/2/2023		RYEGATE

Number of Systems: 1

Number of Violations: 1

Population: 131

Vio Type: 3A

Vio Name: MONITORING, ROUTINE, MAJOR (RTCR)

Analyte/Group Code: 3014

Analyte/Group Name: E. COLI

WSID	WS Name	Active	Population	System Type	Compliance Period Begin	Compliance Period End	City/Town
VT0000131	NORTON RESTAURANT	A	86	NC	6/1/2023	6/30/2023	NORTON
VT0000131	NORTON RESTAURANT	A	86	NC	7/1/2023	7/31/2023	NORTON
VT0000131	NORTON RESTAURANT	A	86	NC	8/1/2023	8/31/2023	NORTON
VT0000131	NORTON RESTAURANT	A	86	NC	9/1/2023	9/30/2023	NORTON
VT0000131	NORTON RESTAURANT	A	86	NC	10/1/2023	10/31/2023	NORTON
VT0000131	NORTON RESTAURANT	A	86	NC	11/1/2023	11/30/2023	NORTON
VT0000131	NORTON RESTAURANT	A	86	NC	4/1/2023	4/30/2023	NORTON
VT0000131	NORTON RESTAURANT	A	86	NC	12/1/2022	12/31/2022	NORTON
VT0000131	NORTON RESTAURANT	A	86	NC	5/1/2023	5/31/2023	NORTON
VT0000131	NORTON RESTAURANT	A	86	NC	2/1/2023	2/28/2023	NORTON
VT0000131	NORTON RESTAURANT	A	86	NC	1/1/2023	1/31/2023	NORTON
VT0000196	VISTA SENIOR LIVING	A	237	C	10/1/2022	10/31/2022	MENDON

VT0000196	VISTA SENIOR LIVING	A	237	C	4/1/2023	4/30/2023	MENDON
VT0000268	LOT SIX BREWING CO	A	100	NC	7/1/2023	7/31/2023	CAMBRIDGE
VT0000268	LOT SIX BREWING CO	A	100	NC	5/1/2023	5/31/2023	CAMBRIDGE
VT0000268	LOT SIX BREWING CO	A	100	NC	4/1/2023	4/30/2023	CAMBRIDGE
VT0000268	LOT SIX BREWING CO	A	100	NC	3/1/2023	3/31/2023	CAMBRIDGE
VT0000268	LOT SIX BREWING CO	A	100	NC	1/1/2023	1/31/2023	CAMBRIDGE
VT0000268	LOT SIX BREWING CO	A	100	NC	6/1/2023	6/30/2023	CAMBRIDGE
VT0000372	WHEEL INN RESTAURANT	A	40	NC	11/1/2023	11/30/2023	BENSON
VT0000372	WHEEL INN RESTAURANT	A	40	NC	5/1/2023	5/31/2023	BENSON
VT0000372	WHEEL INN RESTAURANT	A	40	NC	8/1/2023	8/31/2023	BENSON
VT0000372	WHEEL INN RESTAURANT	A	40	NC	10/1/2023	10/31/2023	BENSON
VT0000372	WHEEL INN RESTAURANT	A	40	NC	6/1/2023	6/30/2023	BENSON
VT0000372	WHEEL INN RESTAURANT	A	40	NC	9/1/2023	9/30/2023	BENSON
VT0000372	WHEEL INN RESTAURANT	A	40	NC	7/1/2023	7/31/2023	BENSON
VT0000372	WHEEL INN RESTAURANT	A	40	NC	1/1/2023	1/31/2023	BENSON
VT0000410	SWISS FARM INN	A	93	NC	1/1/2023	3/31/2023	PITTSFIELD
VT0000447	GREEN APRON	A	129	NC	8/1/2023	8/31/2023	WINHALL
VT0000448	RED FOX INN	A	117	NC	10/1/2022	12/31/2022	WINHALL
VT0000487	INN AT LONG TRAIL	A	178	NC	7/1/2023	9/30/2023	KILLINGTON
VT0000560	PORKYS PLACE LLC	I	39	NC	5/1/2023	5/31/2023	NEW HAVEN
VT0000560	PORKYS PLACE LLC	I	39	NC	2/1/2023	2/28/2023	NEW HAVEN
VT0000739	ROWELLS INN	A	25	NC	11/1/2023	11/30/2023	ANDOVER
VT0000739	ROWELLS INN	A	25	NC	7/1/2023	9/30/2023	ANDOVER
VT0000783	QUECHEE INN AT MARSHLAND	A	150	NC	9/1/2023	9/30/2023	HARTFORD
VT0000783	QUECHEE INN AT MARSHLAND	A	150	NC	5/1/2023	5/31/2023	HARTFORD
VT0000783	QUECHEE INN AT MARSHLAND	A	150	NC	3/1/2023	3/31/2023	HARTFORD
VT0000783	QUECHEE INN AT MARSHLAND	A	150	NC	1/1/2023	1/31/2023	HARTFORD
VT0000783	QUECHEE INN AT MARSHLAND	A	150	NC	12/1/2022	12/31/2022	HARTFORD
VT0000783	QUECHEE INN AT MARSHLAND	A	150	NC	2/1/2023	2/28/2023	HARTFORD
VT0000847	CHRISTMAS TREE INN	A	83	NC	4/1/2023	6/30/2023	WARREN
VT0000963	CHARITYS	A	160	NC	9/1/2023	9/30/2023	KILLINGTON
VT0000963	CHARITYS	A	160	NC	1/1/2023	1/31/2023	KILLINGTON
VT0000963	CHARITYS	A	160	NC	2/1/2023	2/28/2023	KILLINGTON
VT0001089	QUIMBY COUNTRY	A	135	NC	9/1/2023	9/30/2023	AVERILL
VT0001124	MICHAELS ON THE HILL	A	90	NC	10/1/2023	10/31/2023	WATERBURY
VT0001127	NORTHERN LIGHTS LODGE	A	307	NC	1/1/2023	3/31/2023	STOWE
VT0001128	FATHERS RESTAURANT	A	47	NC	4/1/2023	6/30/2023	WESTMINSTER
VT0001128	FATHERS RESTAURANT	A	47	NC	7/1/2023	9/30/2023	WESTMINSTER
VT0001626	VIKING NORDIC CENTER	A	35	NC	12/1/2022	12/31/2022	LONDONDERRY
VT0001652	BROMLEY VIEW INN	A	110	NC	1/1/2023	3/31/2023	WINHALL
VT0001652	BROMLEY VIEW INN	A	110	NC	6/1/2023	6/30/2023	WINHALL
VT0001652	BROMLEY VIEW INN	A	110	NC	5/1/2023	5/31/2023	WINHALL
VT0001652	BROMLEY VIEW INN	A	110	NC	11/1/2023	11/30/2023	WINHALL
VT0001652	BROMLEY VIEW INN	A	110	NC	7/1/2023	7/31/2023	WINHALL
VT0001706	MIKE & TAMMYS MAIN STREET MARKET	A	38	NC	10/1/2023	10/31/2023	LONDONDERRY

VT0001706	MIKE & TAMMYS MAIN STREET MARKET	A	38	NC	7/1/2023	7/31/2023	LONDONDERRY
VT0001713	6163 MAIN ST LLC	A	210	NC	7/1/2023	9/30/2023	WAITSFIELD
VT0001728	MANCHESTER COUNTRY CLUB	A	166	NC	12/1/2022	12/31/2022	MANCHESTER
VT0001728	MANCHESTER COUNTRY CLUB	A	166	NC	3/1/2023	3/31/2023	MANCHESTER
VT0001728	MANCHESTER COUNTRY CLUB	A	166	NC	4/1/2023	4/30/2023	MANCHESTER
VT0001728	MANCHESTER COUNTRY CLUB	A	166	NC	7/1/2023	7/31/2023	MANCHESTER
VT0001728	MANCHESTER COUNTRY CLUB	A	166	NC	8/1/2023	8/31/2023	MANCHESTER
VT0001728	MANCHESTER COUNTRY CLUB	A	166	NC	10/1/2023	10/31/2023	MANCHESTER
VT0001728	MANCHESTER COUNTRY CLUB	A	166	NC	11/1/2023	11/30/2023	MANCHESTER
VT0001805	WAITSFIELD INN	A	100	NC	5/1/2023	5/31/2023	WAITSFIELD
VT0001805	WAITSFIELD INN	A	100	NC	9/1/2023	9/30/2023	WAITSFIELD
VT0001805	WAITSFIELD INN	A	100	NC	12/1/2022	12/31/2022	WAITSFIELD
VT0001810	SNOW GOOSE INN	A	36	NC	10/1/2022	12/31/2022	DOVER
VT0001944	WHITE HOUSE	A	166	NC	7/1/2023	9/30/2023	WILMINGTON
VT0002042	PINE CONE SNACK BAR	A	55	NC	9/1/2023	9/30/2023	BERKSHIRE
VT0002051	LINCOLN INN & RESTAURANT COVERED BRIDG	A	80	NC	4/1/2023	6/30/2023	WOODSTOCK
VT0002063	CROWN POINT COUNTRY CLUB	A	281	NC	1/1/2023	1/31/2023	SPRINGFIELD
VT0002097	JERBIL, LLC	A	40	NC	10/1/2022	12/31/2022	WINHALL
VT0002097	JERBIL, LLC	A	40	NC	1/1/2023	3/31/2023	WINHALL
VT0002190	MAPLEWOOD LODGE	I	120	NC	7/1/2023	7/31/2023	LYNDON
VT0002190	MAPLEWOOD LODGE	I	120	NC	4/1/2023	4/30/2023	LYNDON
VT0002190	MAPLEWOOD LODGE	I	120	NC	11/1/2023	11/30/2023	LYNDON
VT0002190	MAPLEWOOD LODGE	I	120	NC	10/1/2023	10/31/2023	LYNDON
VT0002190	MAPLEWOOD LODGE	I	120	NC	8/1/2023	8/31/2023	LYNDON
VT0002190	MAPLEWOOD LODGE	I	120	NC	6/1/2023	6/30/2023	LYNDON
VT0002190	MAPLEWOOD LODGE	I	120	NC	9/1/2023	9/30/2023	LYNDON
VT0002190	MAPLEWOOD LODGE	I	120	NC	2/1/2023	2/28/2023	LYNDON
VT0002338	LAKE BOMOSEEN INN	A	94	NC	4/1/2023	4/30/2023	CASTLETON
VT0004307	FIFE N DRUM MOTEL	A	35	NC	10/1/2022	12/31/2022	BENNINGTON
VT0004333	BRITTANY MOTEL	A	32	NC	5/1/2023	5/31/2023	MANCHESTER
VT0004333	BRITTANY MOTEL	A	32	NC	11/1/2023	11/30/2023	MANCHESTER
VT0004333	BRITTANY MOTEL	A	32	NC	8/1/2023	8/31/2023	MANCHESTER
VT0004333	BRITTANY MOTEL	A	32	NC	3/1/2023	3/31/2023	MANCHESTER
VT0004395	RIDERS OUTPOST LLC	A	99	NC	7/1/2023	9/30/2023	WAITSFIELD
VT0004479	SOUTH GATE MOTEL	A	50	NC	10/1/2022	12/31/2022	BENNINGTON
VT0004560	MIDDLEBURY SWEETS MOTEL	A	44	NC	8/1/2023	8/31/2023	MIDDLEBURY
VT0004708	VAL ROC MOTEL	A	98	NC	8/1/2023	8/31/2023	KILLINGTON
VT0004708	VAL ROC MOTEL	A	98	NC	1/1/2023	1/31/2023	KILLINGTON
VT0004708	VAL ROC MOTEL	A	98	NC	5/1/2023	5/31/2023	KILLINGTON
VT0004708	VAL ROC MOTEL	A	98	NC	7/1/2023	7/31/2023	KILLINGTON
VT0004708	VAL ROC MOTEL	A	98	NC	6/1/2023	6/30/2023	KILLINGTON
VT0004708	VAL ROC MOTEL	A	98	NC	2/1/2023	2/28/2023	KILLINGTON
VT0004708	VAL ROC MOTEL	A	98	NC	9/1/2023	9/30/2023	KILLINGTON
VT0004708	VAL ROC MOTEL	A	98	NC	10/1/2023	10/31/2023	KILLINGTON
VT0004811	REST	A	72	NC	9/1/2023	9/30/2023	MANCHESTER

VT0004916	SLEEP WOODSTOCK MOTEL	A	43	NC	7/1/2023	9/30/2023	WOODSTOCK
VT0005031	PASSUMPSIC FIRE DISTRICT 1	A	140	C	10/1/2022	10/31/2022	BARNET
VT0005031	PASSUMPSIC FIRE DISTRICT 1	A	140	C	7/1/2022	7/31/2022	BARNET
VT0005049	WHEELLOCK FIRE DISTRICT 1	A	50	C	4/1/2023	4/30/2023	WHEELLOCK
VT0005049	WHEELLOCK FIRE DISTRICT 1	A	50	C	2/1/2023	2/28/2023	WHEELLOCK
VT0005049	WHEELLOCK FIRE DISTRICT 1	A	50	C	12/1/2022	12/31/2022	WHEELLOCK
VT0005049	WHEELLOCK FIRE DISTRICT 1	A	50	C	11/1/2022	11/30/2022	WHEELLOCK
VT0005049	WHEELLOCK FIRE DISTRICT 1	A	50	C	6/1/2023	6/30/2023	WHEELLOCK
VT0005095	ST GEORGE COMMUNITY COOPERATIVE	A	420	C	2/1/2023	2/28/2023	SAINT GEORGE
VT0005111	GUILDHALL WATER SYSTEM	A	136	C	4/1/2023	4/30/2023	GUILDHALL
VT0005137	ALBURGH FIRE DISTRICT 1	A	87	C	8/1/2022	8/31/2022	ALBURGH
VT0005158	MORRISTOWN CORNER WATER CORP	A	150	C	7/1/2022	7/31/2022	MORRISTOWN
VT0005158	MORRISTOWN CORNER WATER CORP	A	150	C	11/1/2022	11/30/2022	MORRISTOWN
VT0005158	MORRISTOWN CORNER WATER CORP	A	150	C	5/1/2023	5/31/2023	MORRISTOWN
VT0005165	MOUNTAINSIDE RESORT	A	240	C	1/1/2023	1/31/2023	STOWE
VT0005165	MOUNTAINSIDE RESORT	A	240	C	2/1/2023	2/28/2023	STOWE
VT0005165	MOUNTAINSIDE RESORT	A	240	C	12/1/2022	12/31/2022	STOWE
VT0005217	DANBY MOUNT TABOR F D 1	A	385	C	7/1/2022	7/31/2022	DANBY
VT0005240	HEMLOCK RIDGE CONDOMINIUM	A	63	C	3/1/2023	3/31/2023	KILLINGTON
VT0005248	GRANITEVILLE FIRE DISTRICT 4	A	700	C	7/1/2022	7/31/2022	BARRE TOWN
VT0005287	EAST WIND MHP	A	100	C	6/1/2023	6/30/2023	WATERBURY
VT0005304	NORTHSHORE MHP	A	63	C	10/1/2022	10/31/2022	ROCKINGHAM
VT0005328	ROCHESTER WATER SYSTEM	A	440	C	3/1/2023	3/31/2023	ROCHESTER
VT0005382	EDGEMONT CONDOMINIUMS	A	108	C	5/1/2023	5/31/2023	KILLINGTON
VT0005404	WOODSIDE MANOR	A	240	C	1/1/2023	1/31/2023	HARTFORD
VT0005404	WOODSIDE MANOR	A	240	C	8/1/2022	8/31/2022	HARTFORD
VT0005424	MERRIMAC MANOR MHP	A	122	C	1/1/2023	1/31/2023	HARTFORD
VT0005424	MERRIMAC MANOR MHP	A	122	C	8/1/2022	8/31/2022	HARTFORD
VT0005524	SNOWSIDE CONDOMINIUM	A	63	C	10/1/2022	10/31/2022	FAYSTON
VT0005530	UNION HOUSE NURSING HOME	A	56	C	2/1/2023	2/28/2023	GLOVER
VT0005530	UNION HOUSE NURSING HOME	A	56	C	11/1/2022	11/30/2022	GLOVER
VT0005530	UNION HOUSE NURSING HOME	A	56	C	1/1/2023	1/31/2023	GLOVER
VT0005532	VERNON GREEN NURSING HOME	A	96	C	8/1/2022	8/31/2022	VERNON
VT0005534	RUTLAND TOWN FIRE DISTRICT 1	A	401	C	11/1/2022	11/30/2022	RUTLAND TOWN
VT0005571	TELEMARK VILLAGE	A	82	C	3/1/2023	3/31/2023	KILLINGTON
VT0005603	WINTERGREEN AT KILLINGTON	A	50	C	2/1/2023	2/28/2023	PITTSFIELD
VT0005607	MAPLE LANE NURSING HOME	A	181	C	2/1/2023	2/28/2023	BARTON
VT0005607	MAPLE LANE NURSING HOME	A	181	C	1/1/2023	1/31/2023	BARTON
VT0005607	MAPLE LANE NURSING HOME	A	181	C	11/1/2022	11/30/2022	BARTON
VT0005615	TIMBERCREEK CONDOMINIUM	A	1116	C	9/1/2022	9/30/2022	DOVER
VT0005615	TIMBERCREEK CONDOMINIUM	A	1116	C	11/1/2022	11/30/2022	DOVER
VT0005645	EVERGREEN MHP	A	50	C	9/1/2022	9/30/2022	POWNAL
VT0006006	KILLOOLEET CAMP	A	138	NC	8/1/2023	8/31/2023	HANCOCK
VT0006080	SUNDERLAND ELEMENTARY SCHOOL	A	88	NTNC	6/1/2023	6/30/2023	SUNDERLAND
VT0006508	KEHOE GRN MTN CONSERVATION CAMP	A	150	NC	2/1/2023	2/28/2023	CASTLETON



VT0006602	GREEN MOUNTAIN CAMP INC	A	75	NC	7/1/2023	7/31/2023	DUMMERSTON
VT0006629	SAXTONS RIVER SCHOOL	A	120	NTNC	8/1/2022	8/31/2022	ROCKINGHAM
VT0006661	KINHAVEN MUSIC SCHOOL	A	127	NC	9/1/2023	9/30/2023	WESTON
VT0006661	KINHAVEN MUSIC SCHOOL	A	127	NC	7/1/2023	7/31/2023	WESTON
VT0006729	CONCORD SCHOOL	A	370	NTNC	10/1/2022	12/31/2022	CONCORD
VT0006730	BENSON VILLAGE SCHOOL	A	130	NTNC	11/1/2022	11/30/2022	BENSON
VT0008037	SEYON LODGE STATE PARK	A	52	NC	10/1/2022	12/31/2022	GROTON
VT0008112	KAMPERSVILLE CAMPGROUND AND STORE	A	864	NC	6/1/2023	6/30/2023	SALISBURY
VT0008112	KAMPERSVILLE CAMPGROUND AND STORE	A	864	NC	8/1/2023	8/31/2023	SALISBURY
VT0008112	KAMPERSVILLE CAMPGROUND AND STORE	A	864	NC	10/1/2023	10/31/2023	SALISBURY
VT0008125	REST N NEST CAMPGROUND	A	92	NC	6/1/2023	6/30/2023	THETFORD
VT0008125	REST N NEST CAMPGROUND	A	92	NC	8/1/2023	8/31/2023	THETFORD
VT0008125	REST N NEST CAMPGROUND	A	92	NC	10/1/2023	10/31/2023	THETFORD
VT0008126	CHAR BO CAMPGROUND	A	105	NC	5/1/2023	5/31/2023	DERBY
VT0008131	OTTER CREEK CAMPGROUND	A	154	NC	8/1/2023	8/31/2023	DANBY
VT0008136	ONION RIVER CAMPGROUND	A	112	NC	7/1/2023	7/31/2023	MARSHFIELD
VT0008159	MARYVILLE CAMPGROUND	A	124	NC	7/1/2023	7/31/2023	DORSET
VT0008159	MARYVILLE CAMPGROUND	A	124	NC	8/1/2023	8/31/2023	DORSET
VT0008161	CAMPBELLS BAY	A	136	NC	9/1/2023	9/30/2023	SWANTON
VT0008163	COUNTRYSIDE CAMPGROUND	A	149	NC	7/1/2023	7/31/2023	RYEGATE
VT0008201	CHIPMAN POINT MARINA	A	25	NC	8/1/2023	8/31/2023	ORWELL
VT0008201	CHIPMAN POINT MARINA	A	25	NC	5/1/2023	5/31/2023	ORWELL
VT0008248	MOOSALAMOO CAMPGROUND	A	76	NC	9/1/2023	9/30/2023	GOSHEN
VT0008257	ALBURG RV RESORT	A	860	NC	6/1/2023	6/30/2023	ALBURGH
VT0008257	ALBURG RV RESORT	A	860	NC	9/1/2023	9/30/2023	ALBURGH
VT0020031	VERNON HALL	A	50	C	8/1/2022	8/31/2022	VERNON
VT0020078	PAPA TIROZZI BAKERY AND PIZZA	A	74	NC	4/1/2023	6/30/2023	SAINT JOHNSBURY
VT0020080	SOUTH HERO FIRE DISTRICT 4	A	760	C	9/1/2022	9/30/2022	SOUTH HERO
VT0020247	NEWFANE STORE	A	33	NC	7/1/2023	9/30/2023	NEWFANE
VT0020247	NEWFANE STORE	A	33	NC	10/1/2022	12/31/2022	NEWFANE
VT0020516	MOOSELOOK DINER	A	45	NC	1/1/2023	3/31/2023	CONCORD
VT0020516	MOOSELOOK DINER	A	45	NC	5/1/2023	5/31/2023	CONCORD
VT0020516	MOOSELOOK DINER	A	45	NC	7/1/2023	7/31/2023	CONCORD
VT0020516	MOOSELOOK DINER	A	45	NC	8/1/2023	8/31/2023	CONCORD
VT0020516	MOOSELOOK DINER	A	45	NC	11/1/2023	11/30/2023	CONCORD
VT0020516	MOOSELOOK DINER	A	45	NC	10/1/2023	10/31/2023	CONCORD
VT0020516	MOOSELOOK DINER	A	45	NC	9/1/2023	9/30/2023	CONCORD
VT0020521	ECONO LODGE - MANCHESTER	A	80	NC	7/1/2023	9/30/2023	MANCHESTER
VT0020600	POND VIEW LLC - JOES POND	A	50	NC	5/1/2023	5/31/2023	DANVILLE
VT0020600	POND VIEW LLC - JOES POND	A	50	NC	8/1/2023	8/31/2023	DANVILLE
VT0020649	GREEN MOUNTAIN NATIONAL GOLF COURSE	A	347	NC	5/1/2023	5/31/2023	KILLINGTON
VT0020656	JAY VILLAGE INN AND RESTAURANT	A	94	NC	10/1/2022	12/31/2022	JAY
VT0020658	THE TILLERMAN	A	132	NC	10/1/2022	12/31/2022	BRISTOL
VT0020667	RIVERSHED	A	98	NC	12/1/2022	12/31/2022	KILLINGTON
VT0020667	RIVERSHED	A	98	NC	2/1/2023	2/28/2023	KILLINGTON

VT0020667	RIVERSHED	A	98	NC	5/1/2023	5/31/2023	KILLINGTON
VT0020667	RIVERSHED	A	98	NC	6/1/2023	6/30/2023	KILLINGTON
VT0020667	RIVERSHED	A	98	NC	7/1/2023	7/31/2023	KILLINGTON
VT0020667	RIVERSHED	A	98	NC	11/1/2023	11/30/2023	KILLINGTON
VT0020681	CAJUNS SNACK BAR	A	30	NC	7/1/2023	7/31/2023	LOWELL
VT0020681	CAJUNS SNACK BAR	A	30	NC	5/1/2023	5/31/2023	LOWELL
VT0020681	CAJUNS SNACK BAR	A	30	NC	6/1/2023	6/30/2023	LOWELL
VT0020732	CW MULHOLLAND WELL 3	A	75	NC	7/1/2023	9/30/2023	CASTLETON
VT0020760	EAST MOUNTAIN MHP	A	76	C	8/1/2022	8/31/2022	BENNINGTON
VT0020796	CHAMBERS MOBILE HOME VILLAGE	A	150	C	7/1/2022	7/31/2022	HARTFORD
VT0020796	CHAMBERS MOBILE HOME VILLAGE	A	150	C	9/1/2022	9/30/2022	HARTFORD
VT0020796	CHAMBERS MOBILE HOME VILLAGE	A	150	C	10/1/2022	10/31/2022	HARTFORD
VT0020796	CHAMBERS MOBILE HOME VILLAGE	A	150	C	11/1/2022	11/30/2022	HARTFORD
VT0020796	CHAMBERS MOBILE HOME VILLAGE	A	150	C	12/1/2022	12/31/2022	HARTFORD
VT0020796	CHAMBERS MOBILE HOME VILLAGE	A	150	C	2/1/2023	2/28/2023	HARTFORD
VT0020796	CHAMBERS MOBILE HOME VILLAGE	A	150	C	3/1/2023	3/31/2023	HARTFORD
VT0020796	CHAMBERS MOBILE HOME VILLAGE	A	150	C	5/1/2023	5/31/2023	HARTFORD
VT0020797	TRAIL 87	A	51	NC	7/1/2023	9/30/2023	DOVER
VT0020813	RAMUNTOS ARLINGTON	A	40	NC	10/1/2022	12/31/2022	ARLINGTON
VT0020813	RAMUNTOS ARLINGTON	A	40	NC	1/1/2023	3/31/2023	ARLINGTON
VT0020844	BARREWOOD CAMPGROUND	A	190	NC	5/1/2023	5/31/2023	WESTFIELD
VT0020844	BARREWOOD CAMPGROUND	A	190	NC	6/1/2023	6/30/2023	WESTFIELD
VT0020890	KILLINGTON VILLAGE PROPERTIES INC	A	83	NC	11/1/2023	11/30/2023	KILLINGTON
VT0020890	KILLINGTON VILLAGE PROPERTIES INC	A	83	NC	10/1/2023	10/31/2023	KILLINGTON
VT0020890	KILLINGTON VILLAGE PROPERTIES INC	A	83	NC	6/1/2023	6/30/2023	KILLINGTON
VT0020890	KILLINGTON VILLAGE PROPERTIES INC	A	83	NC	3/1/2023	3/31/2023	KILLINGTON
VT0020890	KILLINGTON VILLAGE PROPERTIES INC	A	83	NC	12/1/2022	12/31/2022	KILLINGTON
VT0020940	FAT HAT CORNER	A	63	NC	1/1/2023	3/31/2023	HARTFORD
VT0020981	TREE CORNERS FAMILY CAMPGROUND LLC	A	655	NC	10/1/2023	10/31/2023	IRASBURG
VT0021019	TWIN CITY SUBARU	I	80	NC	7/1/2023	9/30/2023	BERLIN
VT0021019	TWIN CITY SUBARU	I	80	NC	4/1/2023	6/30/2023	BERLIN
VT0021019	TWIN CITY SUBARU	I	80	NC	1/1/2023	3/31/2023	BERLIN
VT0021030	JACKSONVILLE COUNTRY STORE	A	37	NC	10/1/2022	12/31/2022	WHITINGHAM
VT0021030	JACKSONVILLE COUNTRY STORE	A	37	NC	7/1/2023	7/31/2023	WHITINGHAM
VT0021030	JACKSONVILLE COUNTRY STORE	A	37	NC	2/1/2023	2/28/2023	WHITINGHAM
VT0021059	AMERICAN LEGION POST 90	A	201	NC	7/1/2023	9/30/2023	POWNA
VT0021078	HYDE PARK VFW	A	175	NC	11/1/2023	11/30/2023	HYDE PARK
VT0021078	HYDE PARK VFW	A	175	NC	9/1/2023	9/30/2023	HYDE PARK
VT0021078	HYDE PARK VFW	A	175	NC	8/1/2023	8/31/2023	HYDE PARK
VT0021078	HYDE PARK VFW	A	175	NC	6/1/2023	6/30/2023	HYDE PARK
VT0021078	HYDE PARK VFW	A	175	NC	5/1/2023	5/31/2023	HYDE PARK
VT0021078	HYDE PARK VFW	A	175	NC	4/1/2023	4/30/2023	HYDE PARK
VT0021078	HYDE PARK VFW	A	175	NC	2/1/2023	2/28/2023	HYDE PARK
VT0021078	HYDE PARK VFW	A	175	NC	12/1/2022	12/31/2022	HYDE PARK
VT0021146	KINGDOM HALL - NEWPORT	A	238	NC	4/1/2023	6/30/2023	DERBY

VT0021151	COUNTRY VILLAGE CAMPGROUND	A	166	NC	8/1/2023	8/31/2023	LEICESTER
VT0021157	CRAFTSBURY GENERAL STORE	A	45	NC	4/1/2023	6/30/2023	CRAFTSBURY
VT0021160	NULHEGAN BASIN DIVISION	A	60	NC	10/1/2022	12/31/2022	BRUNSWICK
VT0021167	HILLTOP MONTESSORI SCHOOL	A	150	NTNC	1/1/2023	1/31/2023	BRATTLEBORO
VT0021177	ORWELL ONE STOP	A	28	NC	3/1/2023	3/31/2023	ORWELL
VT0021177	ORWELL ONE STOP	A	28	NC	4/1/2023	4/30/2023	ORWELL
VT0021177	ORWELL ONE STOP	A	28	NC	7/1/2023	7/31/2023	ORWELL
VT0021177	ORWELL ONE STOP	A	28	NC	10/1/2023	10/31/2023	ORWELL
VT0021177	ORWELL ONE STOP	A	28	NC	6/1/2023	6/30/2023	ORWELL
VT0021177	ORWELL ONE STOP	A	28	NC	11/1/2023	11/30/2023	ORWELL
VT0021180	WILMINGTON HOUSE OF PIZZA	I	40	NC	7/1/2023	9/30/2023	WILMINGTON
VT0021189	MIKES STORE AND DELI	A	33	NC	4/1/2023	6/30/2023	HARTLAND
VT0021192	SUNRAY PEACE VILLAGE	A	204	NC	11/1/2023	11/30/2023	LINCOLN
VT0021192	SUNRAY PEACE VILLAGE	A	204	NC	1/1/2023	3/31/2023	LINCOLN
VT0021211	JIFFY MART - NEW HAVEN	A	25	NC	10/1/2023	10/31/2023	NEW HAVEN
VT0021228	ALPINE VALLEY RV PARK	A	282	NC	4/1/2023	6/30/2023	CONCORD
VT0021245	PITTSFIELD PITT-STOP	A	25	NC	1/1/2023	3/31/2023	PITTSFIELD
VT0021248	BURKE TOWN OFFICES	A	112	NC	5/1/2023	5/31/2023	BURKE
VT0021250	OTTER CREEK FUN CENTER	A	220	NC	2/1/2023	2/28/2023	DANBY
VT0021250	OTTER CREEK FUN CENTER	A	220	NC	12/1/2022	12/31/2022	DANBY
VT0021250	OTTER CREEK FUN CENTER	A	220	NC	11/1/2023	11/30/2023	DANBY
VT0021250	OTTER CREEK FUN CENTER	A	220	NC	8/1/2023	8/31/2023	DANBY
VT0021250	OTTER CREEK FUN CENTER	A	220	NC	7/1/2023	7/31/2023	DANBY
VT0021250	OTTER CREEK FUN CENTER	A	220	NC	10/1/2023	10/31/2023	DANBY
VT0021250	OTTER CREEK FUN CENTER	A	220	NC	9/1/2023	9/30/2023	DANBY
VT0021296	MAXFIELD SPORTS FIELDS	A	942	NC	4/1/2023	4/30/2023	HARTFORD
VT0021296	MAXFIELD SPORTS FIELDS	A	942	NC	11/1/2023	11/30/2023	HARTFORD
VT0021298	WRIGHTSVILLE RECREATION DISTRICT BEACH	A	25	NC	6/1/2023	6/30/2023	MIDDLESEX
VT0021311	NVRH WATER SYSTEM	A	125	NTNC	8/1/2022	8/31/2022	SAINT JOHNSBURY
VT0021315	PARKER PIE	A	89	NC	10/1/2022	12/31/2022	GLOVER
VT0021321	CAMP COMMON GROUND	A	154	NC	7/1/2023	9/30/2023	STARKSBORO
VT0021349	802 TOYOTA	I	51	NTNC	1/1/2023	3/31/2023	BERLIN
VT0021349	802 TOYOTA	I	51	NTNC	4/1/2023	6/30/2023	BERLIN
VT0021367	ALLEN BROTHERS INC	A	36	NC	4/1/2023	6/30/2023	WESTMINSTER
VT0021372	DISHMILL FOREST PRODUCTS LLC	A	184	NC	10/1/2023	10/31/2023	BURKE
VT0021372	DISHMILL FOREST PRODUCTS LLC	A	184	NC	10/1/2022	12/31/2022	BURKE
VT0021372	DISHMILL FOREST PRODUCTS LLC	A	184	NC	4/1/2023	6/30/2023	BURKE
VT0021372	DISHMILL FOREST PRODUCTS LLC	A	184	NC	11/1/2023	11/30/2023	BURKE
VT0021372	DISHMILL FOREST PRODUCTS LLC	A	184	NC	9/1/2023	9/30/2023	BURKE
VT0021392	PHOENIX HOUSE	A	25	NC	9/1/2023	9/30/2023	BERKSHIRE
VT0021392	PHOENIX HOUSE	A	25	NC	12/1/2022	12/31/2022	BERKSHIRE
VT0021422	RED ONION CAFE	A	37	NC	7/1/2023	7/31/2023	CHARLOTTE
VT0021445	RUTLAND LDS CHURCH	A	150	NC	11/1/2023	11/30/2023	RUTLAND CITY
VT0021489	MOUNTAIN VIEW SNACK BAR - MORRISVILLE	I	32	NC	5/1/2023	5/31/2023	MORRISTOWN
VT0021515	NORTHWOODS VILLAGE APARTMENTS	A	130	C	1/1/2023	1/31/2023	EAST MONTPELIER

VT0021524	GARVEY NISSAN	A	50	NC	4/1/2023	4/30/2023	CLARENDON
VT0021534	KINGDOM HALL - SWANTON	A	170	NC	1/1/2023	3/31/2023	SWANTON
VT0021553	HIGH HORSES THERAPEUTIC RIDING	A	60	NC	10/1/2022	12/31/2022	SHARON
VT0021626	MANCHESTER COUNTRY CLUB BATHHOUSE	A	50	NC	6/1/2023	6/30/2023	MANCHESTER
VT0021626	MANCHESTER COUNTRY CLUB BATHHOUSE	A	50	NC	7/1/2023	7/31/2023	MANCHESTER
VT0021626	MANCHESTER COUNTRY CLUB BATHHOUSE	A	50	NC	10/1/2023	10/31/2023	MANCHESTER
VT0021626	MANCHESTER COUNTRY CLUB BATHHOUSE	A	50	NC	8/1/2023	8/31/2023	MANCHESTER
VT0021644	MISSISQUOI NATIONAL WILDLIFE REFUGE	A	75	NC	7/1/2023	9/30/2023	SWANTON
VT0021647	WESTFORD COUNTRY STORE	A	28	NC	2/1/2023	2/28/2023	WESTFORD
VT0021647	WESTFORD COUNTRY STORE	A	28	NC	6/1/2023	6/30/2023	WESTFORD
VT0021662	BURKLYN INN	A	32	NC	4/1/2023	6/30/2023	BURKE
VT0021677	CHURCH OF CHRIST - SPRINGFIELD	A	80	NC	9/1/2023	9/30/2023	SPRINGFIELD
VT0021683	HOGBACK MOUNTAIN COUNTRY STORE	A	366	NC	1/1/2023	3/31/2023	MARLBORO
VT0021725	PITTSFORD ASSOCIATES PROPERTY	A	35	NTNC	7/1/2022	7/31/2022	PITTSFORD
VT0021743	GOOD SHEPHERD LUTHERAN CHURCH	A	204	NC	10/1/2023	10/31/2023	JERICO
VT0021743	GOOD SHEPHERD LUTHERAN CHURCH	A	204	NC	9/1/2023	9/30/2023	JERICO
VT0021743	GOOD SHEPHERD LUTHERAN CHURCH	A	204	NC	4/1/2023	6/30/2023	JERICO
VT0021780	KAMPERSVILLE CAMPGROUND - LOONEY LANE	A	88	NC	8/1/2023	8/31/2023	SALISBURY
VT0021780	KAMPERSVILLE CAMPGROUND - LOONEY LANE	A	88	NC	6/1/2023	6/30/2023	SALISBURY
VT0021780	KAMPERSVILLE CAMPGROUND - LOONEY LANE	A	88	NC	10/1/2023	10/31/2023	SALISBURY

Number of Systems: 148

Number of Violations: 302

Population: 22021

Vio Type: 3A

Vio Name: MONITORING, ROUTINE, MINOR (RTCR)

Analyte/Group Code: 3014

Analyte/Group Name: E. COLI

WSID	WS Name	Active	Population	System Type	Compliance Period Begin	Compliance Period End	City/Town
VT0005228	PROCTOR WATER DEPT	A	2000	C	8/1/2022	8/31/2022	PROCTOR
VT0021192	SUNRAY PEACE VILLAGE	A	204	NC	10/1/2023	10/31/2023	LINCOLN

Number of Systems: 2

Number of Violations: 2

Population: 2204

Vio Type: 3B

Vio Name: MONITORING, ADD. ROUTINE, MAJOR (RTCR)

Analyte/Group Code: 3014

Analyte/Group Name: E. COLI

WSID	WS Name	Active	Population	System Type	Compliance Period Begin	Compliance Period End	City/Town
VT0001745	ECHO LAKE INN	A	260	NC	8/1/2023	8/31/2023	PLYMOUTH
VT0002218	INN AT WEATHERSFIELD	A	75	NC	10/1/2023	10/31/2023	WEATHERSFIELD
VT0004171	NORDIC MOTEL	A	66	NC	10/1/2023	10/31/2023	RUTLAND TOWN
VT0004524	STANFORD HOUSE	A	55	NC	10/1/2023	10/31/2023	MANCHESTER
VT0006620	WEST HAVEN SCHOOL	A	62	NTNC	8/1/2022	8/31/2022	WEST HAVEN
VT0006655	JAY WESTFIELD ELEMENTARY SCHOOL	A	167	NTNC	8/1/2022	8/31/2022	JAY
VT0006667	WATERFORD ELEMENTARY SCHOOL	A	203	NTNC	8/1/2022	8/31/2022	WATERFORD
VT0006689	BARNARD ACADEMY	A	133	NTNC	8/1/2022	8/31/2022	BARNARD
VT0008205	FAIR HAVEN WELCOME AREA	A	303	NC	6/1/2023	6/30/2023	FAIR HAVEN
VT0020596	COCHRAN SKI AREA	A	93	NC	10/1/2023	10/31/2023	RICHMOND



VT0021780 KAMPERSVILLE CAMPGROUND - LOONEY LANE A 88 NC 6/11/2023 7/6/2023 SALISBURY

Number of Systems: 5 Number of Violations: 5 Population: 597

Vio Type: 52 Vio Name: FOLLOW-UP OR ROUTINE TAP M/R (LCR)

Analyte/Group Code: 5000 Analyte/Group Name: LEAD & COPPER RULE

WSID	WS Name	Active	Population	System Type	Compliance Period Begin	Compliance Period End	City/Town
VT0005012	WHITING WATER CORP	A	61	C	1/1/2023	12/31/2025	WHITING
VT0005228	PROCTOR WATER DEPT	A	2000	C	1/1/2023	12/31/2025	PROCTOR
VT0005281	MOUNTAIN WATER COMPANY	A	2400	C	1/1/2023	6/30/2023	WARREN
VT0005382	EDGEMONT CONDOMINIUMS	A	108	C	1/1/2023	12/31/2025	KILLINGTON
VT0005589	CHRISTMAS TREE - SUNDOWN CONDOMINIUM	A	110	C	1/1/2023	12/31/2025	WARREN
VT0006630	NEWARK SCHOOL	A	105	NTNC	1/1/2023	12/31/2025	NEWARK
VT0006639	HARTLAND ELEMENTARY SCHOOL	A	573	NTNC	1/1/2022	12/31/2022	HARTLAND
VT0006658	BURKE TOWN SCHOOL	A	250	NTNC	1/1/2023	12/31/2023	BURKE
VT0020760	EAST MOUNTAIN MHP	A	76	C	7/1/2022	12/31/2022	BENNINGTON
VT0020786	PROVIDENCE ADVENTURE ACADEMY	I	40	NP	1/1/2023	6/30/2023	SUTTON
VT0020796	CHAMBERS MOBILE HOME VILLAGE	A	150	C	7/1/2022	12/31/2022	HARTFORD
VT0020796	CHAMBERS MOBILE HOME VILLAGE	A	150	C	1/1/2023	6/30/2023	HARTFORD
VT0020951	POMPANOOSUC MILLS	A	150	NTNC	1/12/2023	1/30/2023	THETFORD
VT0021349	802 TOYOTA	I	51	NTNC	1/1/2023	12/31/2025	BERLIN

Number of Systems: 13 Number of Violations: 14 Population: 6074

Vio Type: 57 Vio Name: OCCT/SOWT RECOMMENDATION/STUDY (LCR)

Analyte/Group Code: 5000 Analyte/Group Name: LEAD & COPPER RULE

WSID	WS Name	Active	Population	System Type	Compliance Period Begin	Compliance Period End	City/Town
VT0005184	EAST THETFORD WATER CO	A	250	C	10/12/2022	2/13/2023	THETFORD

Number of Systems: 1 Number of Violations: 1 Population: 250

Vio Type: 58 Vio Name: OCCT/SOWT INSTALL DEMONSTRATION (LCR)

Analyte/Group Code: 5000 Analyte/Group Name: LEAD & COPPER RULE

WSID	WS Name	Active	Population	System Type	Compliance Period Begin	Compliance Period End	City/Town
VT0006605	THE MOUNTAIN SCHOOL AT WINHALL	A	84	NTNC	11/16/2023		WINHALL

Number of Systems: 1 Number of Violations: 1 Population: 84

Vio Type: 59 Vio Name: WQP LEVEL NON-COMPLIANCE (LCR)

Analyte/Group Code: 5000 Analyte/Group Name: LEAD & COPPER RULE

WSID	WS Name	Active	Population	System Type	Compliance Period Begin	Compliance Period End	City/Town
VT0005169	WATERVILLE FIRE DISTRICT 1	A	84	C	1/1/2023	6/30/2023	WATERVILLE
VT0005169	WATERVILLE FIRE DISTRICT 1	A	84	C	7/1/2023	12/31/2023	WATERVILLE
VT0005169	WATERVILLE FIRE DISTRICT 1	A	84	C	7/1/2022	12/31/2022	WATERVILLE

VT0005306 WESTMINSTER AQUEDUCT SOCIETY A 150 C 7/1/2022 7/1/2023 WESTMINSTER  
**Number of Systems: 2                      Number of Violations: 4                      Population: 234**

**Vio Type: 71                                      Vio Name: CCR REPORT**

**Analyte/Group Code: 7000                      Analyte/Group Name: CONSUMER CONFIDENCE RULE**

WSID	WS Name	Active	Population	System Type	Compliance Period Begin	Compliance Period End	City/Town
VT0000196	VISTA SENIOR LIVING	A	237	C	7/1/2023		MENDON
VT0005003	EAST MIDDLEBURY FD 1	A	642	C	7/1/2023	1/22/2024	MIDDLEBURY
VT0005040	LYNDONVILLE WATER SYSTEM	A	4500	C	7/1/2023	11/13/2023	LYNDON
VT0005043	RYEGATE FIRE DISTRICT 2	A	131	C	7/1/2023		RYEGATE
VT0005056	PINE RIDGE WATER SYSTEM	A	46	C	7/1/2023	11/8/2023	CHARLOTTE
VT0005078	JERICHO HEIGHTS WATER COOP	A	40	C	7/1/2023	11/8/2023	JERICHO
VT0005117	FAIRFAX WATER DEPT	A	1550	C	7/1/2023	11/8/2023	FAIRFAX
VT0005119	EAST FAIRFIELD FIRE DISTRICT 1	A	184	C	7/1/2023	8/25/2023	FAIRFIELD
VT0005134	HOMESTEAD ACRES MHP	A	81	C	7/1/2023		SWANTON
VT0005137	ALBURGH FIRE DISTRICT 1	A	87	C	7/1/2023		ALBURGH
VT0005155	MOUNTAIN VIEW MHP	A	75	C	7/1/2023	11/10/2023	JOHNSON
VT0005176	WELLS RIVER WATER SYSTEM	A	490	C	7/1/2023	7/5/2023	NEWBURY
VT0005212	CASTLETON FIRE DISTRICT 1	A	1940	C	7/1/2023	11/13/2023	CASTLETON
VT0005243	SOUTH WALLINGFORD WATER CO	A	63	C	7/1/2023	7/16/2023	WALLINGFORD
VT0005282	DRUMLEYS CONDOMINIUMS	A	92	C	7/1/2023	10/3/2023	WARREN
VT0005303	VERMONT ACADEMY	A	305	C	7/1/2023	4/29/2024	ROCKINGHAM
VT0005315	BETHEL WATER DEPT	A	1929	C	7/1/2023	8/29/2023	BETHEL
VT0005322	NORTH HARTLAND COOP WATER SYSTEM INC	A	262	C	7/1/2023	7/5/2023	HARTLAND
VT0005379	RHODESIDE ACRES	A	65	C	7/1/2023	10/10/2023	GEORGIA
VT0005381	SHEFFIELD FIRE DISTRICT 1	A	50	C	7/1/2023		SHEFFIELD
VT0005382	EDGEMONT CONDOMINIUMS	A	108	C	7/1/2023		KILLINGTON
VT0005397	BATTLEGROUNND CONDOMINIUM	A	166	C	7/1/2023	10/31/2023	FAYSTON
VT0005452	NEW ENGLAND KURN HATTIN HOMES	A	200	C	7/1/2023	11/28/2023	WESTMINSTER
VT0005493	RIVERSIDE MHP	A	30	C	7/1/2023	11/14/2023	MORETOWN
VT0005502	WASHINGTON NORTH MHP	A	63	C	7/1/2023		WASHINGTON
VT0005513	WILDWOOD WEST	A	65	C	7/1/2023	9/22/2023	CHARLOTTE
VT0005524	SNOWSIDE CONDOMINIUM	A	63	C	7/1/2023		FAYSTON
VT0005535	SUNNY ACRES DEVELOPMENT WATER ASSOC I	A	50	C	7/1/2023	11/21/2023	MILTON
VT0005537	KARME CHOLING	A	140	C	7/1/2023		BARNET
VT0005563	BEAR CREEK CONDOMINIUM	A	116	C	7/1/2023	11/9/2023	JAMAICA
VT0005598	LEDGES SYSTEM 1	A	252	C	7/1/2023		PLYMOUTH
VT0005602	SHELBURNE FARMS	A	235	C	7/1/2023	11/9/2023	SHELBURNE
VT0005617	DAIRY CENTER	A	109	C	7/1/2023		ENOSBURGH
VT0020568	DERBY LINE VILLAGE WATER DISTRICT	A	897	C	7/1/2023		DERBY
VT0020603	BLACK MOUNTAIN PARK	A	50	C	7/1/2023		BRATTLEBORO
VT0020605	GLEN PARK	A	55	C	7/1/2023		BRATTLEBORO
VT0020760	EAST MOUNTAIN MHP	A	76	C	7/1/2023		BENNINGTON

VT0020796	CHAMBERS MOBILE HOME VILLAGE	A	150	C	7/1/2023		HARTFORD
VT0020855	COLONIAL ESTATES HOMEOWNERS ASSN	A	79	C	7/1/2023		FAIRFAX
VT0020964	SOUTH ALBURGH FIRE DISTRICT 2	A	300	C	7/1/2023	7/12/2023	ALBURGH
VT0021007	RUTLAND TOWN FIRE DISTRICT 11	A	29	C	7/1/2023	9/25/2023	RUTLAND TOWN
VT0021020	EASTFIELD CONDOMINIUM ASSN INC	A	63	C	7/1/2023	12/11/2023	FAIRFAX
VT0021121	WHEELER BROOK HOUSING DEVELOPMENT	A	47	C	7/1/2023	10/30/2023	WARREN
VT0021254	STRATTON WEST LEISURE LODGE CORPORATI	A	75	C	7/1/2023	11/10/2023	WINHALL

Number of Systems: 44

Number of Violations: 44

Population: 16187

Vio Type: 75

Vio Name: PUBLIC NOTICE RULE LINKED TO VIOLATION

Analyte/Group Code: 7500

Analyte/Group Name: PUBLIC NOTICE

WSID	WS Name	Active	Population	System Type	Compliance Period Begin	Compliance Period End	City/Town
VT0000131	NORTON RESTAURANT	A	86	NC	3/28/2023		NORTON
VT0000153	OLYMPIA MOTOR LODGE	A	91	NC	3/15/2023	4/18/2023	MANCHESTER
VT0000372	WHEEL INN RESTAURANT	A	40	NC	4/4/2023	5/1/2024	BENSON
VT0000487	INN AT LONG TRAIL	A	178	NC	11/20/2023	12/27/2023	KILLINGTON
VT0000560	PORKYS PLACE LLC	I	39	NC	4/28/2023	9/28/2023	NEW HAVEN
VT0000585	HEARTHSTONE VILLAGE	A	69	NC	4/28/2023		LONDONDERRY
VT0000637	SALT ASH INN	A	96	NC	4/28/2023		PLYMOUTH
VT0000783	QUECHEE INN AT MARSHLAND	A	150	NC	4/29/2023	4/25/2024	HARTFORD
VT0000847	CHRISTMAS TREE INN	A	83	NC	5/9/2023	7/28/2023	WARREN
VT0001093	SKUNK HOLLOW TAVERN	A	65	NC	4/29/2023	6/19/2023	HARTLAND
VT0001128	FATHERS RESTAURANT	A	47	NC	5/6/2023		WESTMINSTER
VT0001260	MCKEE'S ISLAND PUB AND PIZZA	A	57	NC	3/10/2023	4/13/2023	SOUTH HERO
VT0001291	LAST CHAIR	A	125	NC	5/9/2023		DOVER
VT0001484	TWO TANNERY ROAD RESTAURANT	A	100	NC	5/2/2023	7/3/2023	DOVER
VT0001706	MIKE & TAMMYS MAIN STREET MARKET	A	38	NC	5/26/2023	2/15/2024	LONDONDERRY
VT0001930	BLUSH HILL COUNTRY CLUB THE CLUB HOUSE	A	110	NC	6/21/2023	10/4/2023	WATERBURY
VT0002047	WILDFLOWER INN	A	153	NC	6/2/2023		LYNDON
VT0002060	SITZMARK LODGE	A	795	NC	6/20/2023	5/29/2024	WILMINGTON
VT0002116	LANDGROVE INN	A	56	NC	5/19/2023	10/13/2023	LANDGROVE
VT0002190	MAPLEWOOD LODGE	I	120	NC	5/26/2023	3/13/2024	LYNDON
VT0002218	INN AT WEATHERSFIELD	A	75	NC	6/2/2023	9/20/2023	WEATHERSFIELD
VT0002386	BATTENKILL RIVER LODGE	A	66	NC	5/26/2023		ARLINGTON
VT0002433	RICHFORD COUNTRY CLUB	A	49	NC	6/21/2023		RICHFORD
VT0002560	VERMONT INN	A	109	NC	6/2/2023	1/2/2024	MENDON
VT0002974	GARLIC RESTAURANT	A	166	NC	6/15/2023	5/15/2024	KILLINGTON
VT0002978	VERMONT HOME BAKERY OLD HANCOCK HOTE	A	37	NC	6/8/2023		HANCOCK
VT0004062	JACKSONS LODGE	A	112	NC	7/21/2023		CANAAN
VT0004550	STARLIGHT INN	A	73	NC	6/20/2023		BENNINGTON
VT0004708	VAL ROC MOTEL	A	98	NC	6/28/2023	2/15/2024	KILLINGTON
VT0004811	REST	A	72	NC	7/11/2023		MANCHESTER
VT0004837	CEDAR BROOK MOTOR INN	A	78	NC	7/20/2023		KILLINGTON



VT0004905	GOVERNORS ROCK MOTEL	A	32	NC	7/11/2023		SHAFTSBURY
VT0006650	LOWELL GRADED SCHOOL	A	120	NTNC	11/28/2023	1/16/2024	LOWELL
VT0008112	KAMPERSVILLE CAMPGROUND AND STORE	A	864	NC	9/20/2023		SALISBURY
VT0008113	PLEASANT VALLEY CAMPGROUND	A	236	NC	10/18/2023		RYEGATE
VT0008131	OTTER CREEK CAMPGROUND	A	154	NC	9/16/2023		DANBY
VT0008137	BRATTLEBORO NORTH KOA	A	198	NC	9/19/2023		PUTNEY
VT0008140	LAKEWOOD CAMPGROUND	A	998	NC	9/19/2023		SWANTON
VT0008201	CHIPMAN POINT MARINA	A	25	NC	9/20/2023		ORWELL
VT0009010	NORTH STAR LODGE	A	143	NC	9/26/2023		KILLINGTON
VT0020031	VERNON HALL	A	50	C	7/1/2023	11/1/2023	VERNON
VT0020247	NEWFANE STORE	A	33	NC	11/11/2023	3/21/2024	NEWFANE
VT0020385	FORMULA FORD	A	45	NTNC	11/28/2023		RUTLAND TOWN
VT0020516	MOOSELOOK DINER	A	45	NC	11/9/2023		CONCORD
VT0020517	ERICAS AMERICAN DINER	A	110	NC	11/9/2023	1/8/2024	FAIRFAX
VT0020650	HAPPY TRAILS MOTEL	I	66	NC	11/8/2023	5/1/2024	LUDLOW
VT0020732	CW MULHOLLAND WELL 3	A	75	NC	10/1/2022	3/3/2024	CASTLETON
VT0020802	KAMPFIRE	A	160	NC	10/28/2023		DUMMERSTON
VT0020844	BARREWOOD CAMPGROUND	A	190	NC	10/28/2023		WESTFIELD
VT0020890	KILLINGTON VILLAGE PROPERTIES INC	A	83	NC	9/20/2023		KILLINGTON
VT0021030	JACKSONVILLE COUNTRY STORE	A	37	NC	11/9/2023		WHITINGHAM
VT0021078	HYDE PARK VFW	A	175	NC	9/26/2023	4/19/2024	HYDE PARK
VT0021085	NORTH COUNTRY CAREER CENTER LAND LAB	A	68	NTNC	11/28/2023		DERBY
VT0021177	ORWELL ONE STOP	A	28	NC	11/28/2023		ORWELL
VT0021250	OTTER CREEK FUN CENTER	A	220	NC	9/20/2023		DANBY
VT0021392	PHOENIX HOUSE	A	25	NC	11/28/2023		BERKSHIRE
VT0021520	CAMP PRECAST	A	213	NTNC	12/20/2023		MILTON
VT0021587	MAD HATTERS	A	27	NC	11/11/2023		KILLINGTON

Number of Systems: 58

Number of Violations: 58

Population: 7853

**Vio Type: 76**

**Vio Name: PUBLIC NOTICE RULE NOT LINKED VIOLATION**

**Analyte/Group Code: 7500**

**Analyte/Group Name: PUBLIC NOTICE**

WSID	WS Name	Active	Population	System Type	Compliance Period Begin	Compliance Period End	City/Town
VT0005532	VERNON GREEN NURSING HOME	A	96	C	9/1/2023	11/1/2023	VERNON
VT0006765	EDEN CENTRAL SCHOOL	A	180	NTNC	7/1/2023	2/12/2024	EDEN

Number of Systems: 2

Number of Violations: 2

Population: 276

**Vio Type: SM**

**Vio Name: STATE MONITORING/REPORTING VIOLATION**

**Analyte/Group Code: 1032**

**Analyte/Group Name: MANGANESE**

WSID	WS Name	Active	Population	System Type	Compliance Period Begin	Compliance Period End	City/Town
VT0020381	RUNAMOK MAPLE FACILITY	A	150	NTNC	10/1/2022	12/31/2022	FAIRFAX

Number of Systems: 1

Number of Violations: 1

Population: 150

**Vio Type: SM**

**Vio Name: STATE MONITORING/REPORTING VIOLATION**

**Analyte/Group Code: CFLU**

**Analyte/Group Name: CDS FOR FLUORIDE**

WSID	WS Name	Active	Population	System Type	Compliance Period Begin	Compliance Period End	City/Town
VT0005294	MAGIC VILLAGE WATER COOP	A	308	C	10/1/2022	12/31/2022	LONDONDERRY

**Number of Systems: 1**

**Number of Violations: 1**

**Population: 308**

**Vio Type: SM**

**Vio Name: STATE MONITORING/REPORTING VIOLATION**

**Analyte/Group Code: CIOS**

**Analyte/Group Name: CDS FOR SECONDARIES**

WSID	WS Name	Active	Population	System Type	Compliance Period Begin	Compliance Period End	City/Town
VT0005184	EAST THETFORD WATER CO	A	250	C	4/1/2023	6/30/2023	THETFORD
VT0005280	BUTTERNUT HILL	A	82	C	4/1/2023	6/30/2023	WAITSFIELD
VT0005294	MAGIC VILLAGE WATER COOP	A	308	C	10/1/2022	12/31/2022	LONDONDERRY
VT0005476	JERICO FIRE DISTRICT 1	A	190	C	4/1/2023	6/30/2023	JERICO
VT0005654	CHIMNEY HILL COLCHESTER	A	42	C	1/1/2023	3/31/2023	COLCHESTER
VT0020406	WESTMINSTER WEST SCHOOL	A	46	NTNC	1/1/2023	3/31/2023	WESTMINSTER
VT0020456	KINGSWOOD AT MOUNT SNOW	A	425	C	7/1/2023	9/30/2023	DOVER
VT0020956	WASHINGTON COUNTY MENTAL HEALTH	A	130	NTNC	7/1/2023	9/30/2023	BARRE TOWN

**Number of Systems: 8**

**Number of Violations: 8**

**Population: 1473**

**Vio Type: SM**

**Vio Name: STATE MONITORING/REPORTING VIOLATION**

**Analyte/Group Code: CMN**

**Analyte/Group Name: CDS FOR MANGANESE**

WSID	WS Name	Active	Population	System Type	Compliance Period Begin	Compliance Period End	City/Town
VT0005452	NEW ENGLAND KURN HATTIN HOMES	A	200	C	7/1/2023	9/30/2023	WESTMINSTER
VT0020776	FARMHOUSE POTTERY	I	50	NTNC	1/1/2023	3/31/2023	WOODSTOCK

**Number of Systems: 2**

**Number of Violations: 2**

**Population: 250**

**Vio Type: SM**

**Vio Name: STATE MONITORING/REPORTING VIOLATION**

**Analyte/Group Code: PFA5**

**Analyte/Group Name: PFAS - VT 5 SUM**

WSID	WS Name	Active	Population	System Type	Compliance Period Begin	Compliance Period End	City/Town
VT0000402	CHALET KILLINGTON	A	66	NC	10/1/2022	12/31/2022	KILLINGTON
VT0002707	MOGULS SPORTS PUB	I	67	NC	10/1/2022	12/31/2022	KILLINGTON
VT0005182	UNION WATER CO	A	61	C	4/1/2023	6/30/2023	THETFORD
VT0005328	ROCHESTER WATER SYSTEM	A	440	C	4/1/2023	6/30/2023	ROCHESTER
VT0005499	COLONIAL ESTATES WATER CORP	A	300	C	10/1/2022	12/31/2022	RUTLAND TOWN
VT0006076	GRAFTON ELEMENTARY SCHOOL	A	127	NTNC	7/1/2023	9/30/2023	GRAFTON
VT0006630	NEWARK SCHOOL	A	105	NTNC	7/1/2023	9/30/2023	NEWARK
VT0006642	VERNON ELEMENTARY SCHOOL	A	348	NTNC	7/1/2023	9/30/2023	VERNON
VT0006646	ROXBURY VILLAGE SCHOOL	A	193	NTNC	7/1/2023	9/30/2023	ROXBURY
VT0006727	MIDDLETOWN SPRINGS SCHOOL	A	214	NTNC	7/1/2023	9/30/2023	MIDDLETOWN SPRING
VT0006745	WESTFORD ELEMENTARY SCHOOL	A	394	NTNC	7/1/2023	9/30/2023	WESTFORD

VT0009010	NORTH STAR LODGE	A	143	NC	7/1/2023	9/30/2023	KILLINGTON
VT0020639	RUTLAND AIRPORT BUSINESS PARK ASSO.	A	915	NTNC	4/1/2023	6/30/2023	CLARENDON
VT0020734	POWNALE FIRE DISTRICT 2	A	400	C	4/1/2023	6/30/2023	POWNALE
VT0020842	HILAND HALL SCHOOL	A	40	NTNC	7/1/2023	9/30/2023	BENNINGTON
VT0021311	NVRH WATER SYSTEM	A	125	NTNC	4/1/2023	6/30/2023	SAINT JOHNSBURY
VT0021349	802 TOYOTA	I	51	NTNC	4/1/2023	6/30/2023	BERLIN
VT0021446	BINDING SITE VT	A	30	NTNC	4/1/2023	6/30/2023	BENSON

**Number of Systems: 18                      Number of Violations: 18                      Population: 4019**

**Vio Type: WO                                      Vio Name: WSR VIO. - NO OPERATOR**

**Analyte/Group Code: 0700                      Analyte/Group Name: GROUNDWATER RULE**

WSID	WS Name	Active	Population	System Type	Compliance Period Begin	Compliance Period End	City/Town
VT0021444	SOUTH ROYALTON LDS CHURCH	A	175	NC	11/29/2023		ROYALTON

**Number of Systems: 1                      Number of Violations: 1                      Population: 175**

**Vio Type: WO                                      Vio Name: WSR VIO. - NO OPERATOR**

**Analyte/Group Code: N/A                      Analyte/Group Name: N/A**

WSID	WS Name	Active	Population	System Type	Compliance Period Begin	Compliance Period End	City/Town
VT0000131	NORTON RESTAURANT	A	86	NC	6/20/2023		NORTON
VT0000237	SANDYS DRIVE IN	I	29	NC	6/20/2023	6/30/2023	SHARON
VT0000268	LOT SIX BREWING CO	A	100	NC	8/30/2023	12/27/2023	CAMBRIDGE
VT0000736	CUP N SAUCER	A	49	NC	6/20/2023		WILMINGTON
VT0000782	CREEK HOUSE	A	59	NC	8/30/2023	9/21/2023	BETHEL
VT0001127	NORTHERN LIGHTS LODGE	A	307	NC	6/20/2023	7/7/2023	STOWE
VT0001516	FOUR COLUMNS INN	I	109	NC	8/30/2023		NEWFANE
VT0001880	DREAM MAKER BAKERS	A	105	NC	6/20/2023		KILLINGTON
VT0002742	RABBIT HILL INN	A	100	NC	8/30/2023	1/30/2024	WATERFORD
VT0002978	VERMONT HOME BAKERY OLD HANCOCK HOTE	A	37	NC	8/30/2023		HANCOCK
VT0004171	NORDIC MOTEL	A	66	NC	6/20/2023	3/4/2024	RUTLAND TOWN
VT0004333	BRITTANY MOTEL	A	32	NC	6/20/2023	7/7/2023	MANCHESTER
VT0004403	WEST ROAD MOTEL	A	90	NC	6/20/2023	10/16/2023	BENNINGTON
VT0004608	SNOWED INN	A	59	NC	6/20/2023	1/9/2024	KILLINGTON
VT0005256	BERLIN MOBILE HOME PARK	I	70	C	3/1/2023	3/8/2023	BERLIN
VT0005322	NORTH HARTLAND COOP WATER SYSTEM INC	A	262	C	3/1/2023		HARTLAND
VT0006658	BURKE TOWN SCHOOL	A	250	NTNC	8/30/2023	8/30/2023	BURKE
VT0008112	KAMPERSVILLE CAMPGROUND AND STORE	A	864	NC	6/20/2023		SALISBURY
VT0020466	WESTBURY PARK	A	663	C	3/1/2023	3/8/2023	COLCHESTER
VT0020650	HAPPY TRAILS MOTEL	I	66	NC	6/20/2023		LUDLOW
VT0020672	RED CLOVER INN	A	110	NC	8/30/2023	4/19/2024	MENDON
VT0020825	WATERHOUSES MARINA CAMPGROUND	A	471	NC	6/20/2023	7/23/2023	SALISBURY
VT0020890	KILLINGTON VILLAGE PROPERTIES INC	A	83	NC	6/20/2023		KILLINGTON
VT0020975	BARNARD GENERAL STORE	A	36	NC	6/20/2023		BARNARD

VT0021146	KINGDOM HALL - NEWPORT	A	238	NC	6/20/2023		DERBY
VT0021177	ORWELL ONE STOP	A	28	NC	8/30/2023		ORWELL
VT0021180	WILMINGTON HOUSE OF PIZZA	I	40	NC	6/20/2023		WILMINGTON
VT0021199	NOTCHBROOK III	A	39	C	3/1/2023	3/8/2023	STOWE
VT0021207	KILLINGTON GATEWAY I CONDO ASSOCIATION	A	68	C	10/12/2022	1/10/2023	MENDON
VT0021209	MOTHER HUBBARDS	A	29	NC	6/20/2023	6/29/2023	SAINT ALBANS CITY
VT0021228	ALPINE VALLEY RV PARK	A	282	NC	6/20/2023	11/14/2023	CONCORD
VT0021238	ST ALBANS LDS CHURCH	A	224	NC	6/20/2023		SWANTON
VT0021397	HARLOW FARM STAND	A	31	NC	6/20/2023		WESTMINSTER
VT0021441	MONTPELIER LDS CHURCH	A	150	NC	6/20/2023		BERLIN
VT0021442	NEWPORT LDS CHURCH	A	150	NC	6/20/2023		DERBY
VT0021690	NORWICH SERVICE CENTER	A	25	NC	8/30/2023		NORWICH

Number of Systems: 36

Number of Violations: 36

Population: 5407

Vio Type: WS

Vio Name: WATER SUPPLY RULE VIOLATIONS

Analyte/Group Code: 7500

Analyte/Group Name: PUBLIC NOTICE

WSID	WS Name	Active	Population	System Type	Compliance Period Begin	Compliance Period End	City/Town
VT0000473	BASE CAMP RV PARK AND CAMPGROUND	A	112	NC	7/1/2023	9/30/2023	JAY
VT0000473	BASE CAMP RV PARK AND CAMPGROUND	A	112	NC	4/1/2023	6/30/2023	JAY
VT0000473	BASE CAMP RV PARK AND CAMPGROUND	A	112	NC	1/1/2023	3/31/2023	JAY
VT0002707	MOGULS SPORTS PUB	I	67	NC	4/1/2022	12/31/2022	KILLINGTON
VT0003263	KILLINGTON MOUNTAIN LODGE	A	545	NC	4/1/2023	6/30/2023	KILLINGTON
VT0005179	RANDOLPH VILLAGE	A	2700	C	10/1/2022	12/21/2023	RANDOLPH
VT0005179	RANDOLPH VILLAGE	A	2700	C	7/1/2022	9/30/2022	RANDOLPH
VT0005179	RANDOLPH VILLAGE	A	2700	C	4/1/2022	6/30/2022	RANDOLPH
VT0005476	JERICHO FIRE DISTRICT 1	A	190	C	10/30/2023		JERICHO
VT0006075	MOUNT HOLLY SCHOOL	A	137	NTNC	1/1/2023	3/31/2023	MOUNT HOLLY
VT0006075	MOUNT HOLLY SCHOOL	A	137	NTNC	4/1/2023	6/30/2023	MOUNT HOLLY
VT0006075	MOUNT HOLLY SCHOOL	A	137	NTNC	7/1/2023	9/30/2023	MOUNT HOLLY
VT0021095	LINCOLN MAPLES HARDWARE	A	167	NC	4/1/2023	6/30/2023	WINHALL
VT0021095	LINCOLN MAPLES HARDWARE	A	167	NC	7/1/2023	9/30/2023	WINHALL
VT0021095	LINCOLN MAPLES HARDWARE	A	167	NC	1/1/2023	3/31/2023	WINHALL

Number of Systems: 7

Number of Violations: 15

Population: 3918

Vio Type: WS

Vio Name: WATER SUPPLY RULE VIOLATIONS

Analyte/Group Code: N/A

Analyte/Group Name: N/A

WSID	WS Name	Active	Population	System Type	Compliance Period Begin	Compliance Period End	City/Town
VT0000849	MAD RIVER BARN	A	130	NC	12/6/2023		FAYSTON
VT0002707	MOGULS SPORTS PUB	I	67	NC	2/17/2023	5/8/2024	KILLINGTON
VT0005084	RICHMOND WATER DEPT	A	1048	C	3/16/2023	5/7/2024	RICHMOND
VT0005153	HYDE PARK FIRE DISTRICT 1	A	275	C	11/15/2023		HYDE PARK
VT0005190	ORLEANS WATER SYSTEM	A	846	C	8/2/2023		BARTON

VT0005202	NEWPORT CITY WATER SYSTEM	A	4766	C	6/12/2023		NEWPORT CITY
VT0005291	MOUNT SNOW VILLAGE ASSOCIATION	A	123	C	5/23/2023		DOVER
VT0005322	NORTH HARTLAND COOP WATER SYSTEM INC	A	262	C	10/20/2023		HARTLAND
VT0005342	MOUNT ASCUTNEY MHP	A	42	C	5/3/2023		WINDSOR
VT0005426	RICHMOND FIRE DISTRICT 1	A	56	C	8/3/2023		RICHMOND
VT0005435	COMMONS	A	79	C	3/6/2023		MORETOWN
VT0005462	ROUND TOP	A	240	C	4/28/2023		PLYMOUTH
VT0005476	JERICHO FIRE DISTRICT 1	A	190	C	6/16/2023		JERICHO
VT0005593	SOUTH VILLAGE	A	445	C	5/19/2023		WARREN
VT0005608	SOUTHFACE	A	105	C	3/24/2023		WARREN
VT0005628	POWNALESTATES MHP, LLC.	A	147	C	5/8/2023		POWNALE
VT0005640	COUNTRY CLUB CONDOMINIUM	A	80	C	8/2/2023		BOLTON
VT0006408	FARNSWORTH CAMP	A	306	NC	8/15/2023	2/1/2024	THETFORD
VT0006605	THE MOUNTAIN SCHOOL AT WINHALL	A	84	NTNC	11/3/2023		WINHALL
VT0020078	PAPA TIROZZI BAKERY AND PIZZA	A	74	NC	12/27/2023		SAINT JOHNSBURY
VT0020516	MOOSELOOK DINER	A	45	NC	10/4/2023		CONCORD
VT0020622	LAKEHOUSE PUB AND GRILLE	A	101	NC	6/12/2023	5/30/2024	CASTLETON
VT0020890	KILLINGTON VILLAGE PROPERTIES INC	A	83	NC	6/27/2023		KILLINGTON
VT0021059	AMERICAN LEGION POST 90	A	201	NC	10/10/2023		POWNALE
VT0021248	BURKE TOWN OFFICES	A	112	NC	7/17/2023		BURKE
VT0021440	LAMOILLE VALLEY LDS CHURCH	A	240	NC	11/29/2023		JOHNSON
VT0021445	RUTLAND LDS CHURCH	A	150	NC	11/29/2023		RUTLAND CITY

Number of Systems: 27

Number of Violations: 27

Population: 10297

Vio Type: WS

Vio Name: WATER SUPPLY RULE VIOLATIONS

Analyte/Group Code: PFA5

Analyte/Group Name: PFAS - VT 5 SUM

WSID	WS Name	Active	Population	System Type	Compliance Period Begin	Compliance Period End	City/Town
VT0000402	CHALET KILLINGTON	A	66	NC	1/1/2023	3/31/2023	KILLINGTON
VT0000402	CHALET KILLINGTON	A	66	NC	4/1/2023	6/30/2023	KILLINGTON
VT0000402	CHALET KILLINGTON	A	66	NC	7/1/2023	9/30/2023	KILLINGTON
VT0000918	FOUNDRY	A	140	NC	7/1/2022	9/30/2022	KILLINGTON
VT0000918	FOUNDRY	A	140	NC	10/1/2022	12/31/2022	KILLINGTON
VT0000918	FOUNDRY	A	140	NC	1/1/2023	3/31/2023	KILLINGTON
VT0002603	BUTTERNUT PROPERTIES	A	36	NTNC	1/1/2023	3/31/2023	KILLINGTON
VT0002603	BUTTERNUT PROPERTIES	A	36	NTNC	7/1/2022	9/30/2022	KILLINGTON
VT0002603	BUTTERNUT PROPERTIES	A	36	NTNC	10/1/2022	12/31/2022	KILLINGTON
VT0002707	MOGULS SPORTS PUB	I	67	NC	1/1/2023	3/31/2023	KILLINGTON
VT0002707	MOGULS SPORTS PUB	I	67	NC	7/1/2023	9/30/2023	KILLINGTON
VT0002707	MOGULS SPORTS PUB	I	67	NC	4/1/2023	6/30/2023	KILLINGTON
VT0003263	KILLINGTON MOUNTAIN LODGE	A	545	NC	4/1/2023	6/30/2023	KILLINGTON
VT0003263	KILLINGTON MOUNTAIN LODGE	A	545	NC	7/1/2023	9/30/2023	KILLINGTON
VT0003263	KILLINGTON MOUNTAIN LODGE	A	545	NC	10/1/2022	12/31/2022	KILLINGTON
VT0003263	KILLINGTON MOUNTAIN LODGE	A	545	NC	7/1/2022	9/30/2022	KILLINGTON

VT0003263	KILLINGTON MOUNTAIN LODGE	A	545	NC	4/1/2022	6/30/2022	KILLINGTON
VT0003263	KILLINGTON MOUNTAIN LODGE	A	545	NC	1/1/2023	3/31/2023	KILLINGTON
VT0005194	CRAFTSBURY FIRE DISTRICT 2	A	420	C	10/1/2022	12/31/2022	CRAFTSBURY
VT0005194	CRAFTSBURY FIRE DISTRICT 2	A	420	C	7/1/2023	9/30/2023	CRAFTSBURY
VT0005304	NORTHSHORE MHP	A	63	C	10/1/2023	12/31/2023	ROCKINGHAM
VT0005304	NORTHSHORE MHP	A	63	C	7/1/2023	9/30/2023	ROCKINGHAM
VT0005504	FIDDLEHEAD CONDOMINIUMS	A	60	C	10/1/2022	12/31/2022	FAYSTON
VT0006075	MOUNT HOLLY SCHOOL	A	137	NTNC	10/1/2022	12/31/2022	MOUNT HOLLY
VT0006075	MOUNT HOLLY SCHOOL	A	137	NTNC	4/1/2023	6/30/2023	MOUNT HOLLY
VT0006075	MOUNT HOLLY SCHOOL	A	137	NTNC	1/1/2023	3/31/2023	MOUNT HOLLY
VT0006075	MOUNT HOLLY SCHOOL	A	137	NTNC	10/1/2023	12/31/2023	MOUNT HOLLY
VT0006075	MOUNT HOLLY SCHOOL	A	137	NTNC	7/1/2023	9/30/2023	MOUNT HOLLY
VT0006669	WOODBURY ELEMENTARY SCHOOL	A	61	NTNC	1/1/2023	3/31/2023	WOODBURY
VT0006669	WOODBURY ELEMENTARY SCHOOL	A	61	NTNC	4/1/2023	6/30/2023	WOODBURY
VT0006669	WOODBURY ELEMENTARY SCHOOL	A	61	NTNC	7/1/2023	9/30/2023	WOODBURY
VT0006690	E TAYLOR HATTON	A	60	NTNC	7/1/2023	9/30/2023	MORGAN
VT0006690	E TAYLOR HATTON	A	60	NTNC	10/1/2022	12/31/2022	MORGAN
VT0006690	E TAYLOR HATTON	A	60	NTNC	4/1/2023	6/30/2023	MORGAN
VT0006690	E TAYLOR HATTON	A	60	NTNC	1/1/2023	3/31/2023	MORGAN
VT0020361	KIDS IN THE COUNTRY	A	30	NTNC	1/1/2023	3/31/2023	DOVER
VT0020361	KIDS IN THE COUNTRY	A	30	NTNC	4/1/2023	6/30/2023	DOVER
VT0020361	KIDS IN THE COUNTRY	A	30	NTNC	10/1/2023	12/31/2023	DOVER
VT0020361	KIDS IN THE COUNTRY	A	30	NTNC	7/1/2023	9/30/2023	DOVER

**Number of Systems: 12**

**Number of Violations: 39**

**Population: 1685**