GSF®

Geotextile Sand Filter

Vermont
Design & Installation Manual

eljen
CORPORATION

Innovative Onsite Products & Solutions Since 1970

June 2020

www.eljen.com

Table of Contents

SUBJECT PAGE

GSF DRAWINGS AND TABLES

DRAWINGS

TABLES

Glossary of Terms

A42 Module	48” x 24” x 7” (L x W x H)
B43 Module	48” x 36” x 7” (L x W x H)
Cover Fabric	The geotextile cover fabric (provided by manufacturer) that is placed over the GSF modules.
Design Flow	The estimated design flow used to size a system is 70 gallons per day per person. For the first 3 bedrooms of a home, it is assumed that there are 2 people per bedroom. For each additional bedroom, there is 1 person per bedroom. Minimum design is a 2-bedroom home or 280 gpd for residential systems.
Distribution Box	A plastic or concrete box that receives effluent from a septic tank and splits the flow to pipes placed above the GSF modules. For equal distribution, the outlet pipe orifices are typically set at the same elevation to equalize the flow to each line.
GSF	The Eljen Geotextile Sand Filter Modules and the 6-inch sand layer at the base and 6-inches along the sides of the modules.
GSF Module	The individual module of a GSF system. The module is comprised of a cuspated plastic core and geotextile fabric.
Serial Distribution	For designs commonly used on sloping sites where GSF module rows are laid on contour at varying elevations and where each successive module row receives septic tank effluent only after the preceding module row have become full to the bottom of the invert. This design supports unequal length of module rows.
Sequential Distribution	A method of effluent distribution for sloping sites using drop boxes where the effluent discharges first to the lowest outlet in the upper most box and then backs up to a slightly higher overflow outlet to the next down slope row of modules. Sequential loading maximizes utilization of a row of modules and allows downstream rows to rest for use only during peak flows or stress conditions. It can also be applied to a distribution box for a level bed system by fitting the outlet pipes with dial-a-flows. This method of distribution also supports inspection and management of the system to define the percent of the system in use, maximum use, and to monitor and adjust system stress.

Specified Sand

To ensure proper system operation, the system MUST be installed using ASTM C33 Sand.

ASTM C33 sand will have less than 10% passing the #100 Sieve and less than 5% passing the # 200 sieve. Ask your material supplier for a sieve analysis to verify that your material meets the required specifications.

ASTM C33, Mound Fill Material #2 or Mound Sand #2 are all acceptable for use with the GSF system in Vermont.

TABLE 1: SPECIFIED SAND SIEVE REQUIREMENTS

ASTM C33 SAND SPECIFICATION		
Sieve Size	Sieve Square Opening Size	Specification Percent Passing (Wet Sieve)
3/8 inch	9.52 mm	100
No. 4	4.76 mm	95 - 100
No. 8	2.38 mm	80 - 100
No. 16	1.19 mm	50 - 85
No. 30	590 µm	25 - 60
No. 50	297 µm	10 - 30
No. 100	149 µm	< 10
No. 200	75 µm	< 5

Primary Treatment Zone

- Perforated pipe is centered above the GSF module to distribute septic effluent over and into corrugations created by the cuspated core of the geotextile module.
- Septic effluent is filtered through the Bio-Matt fabric. The module's unique design provides increased surface area for biological treatment that greatly exceeds the module's footprint.
- Open air channels within the module support aerobic bacterial growth on the modules geotextile fabric interface, surpassing the surface area required for traditional absorption systems.
- An anti-siltation geotextile fabric covers the top and sides of the GSF module and protects the ASTM C33 and soil from clogging, while maintaining effluent storage within the module.

Secondary Treatment Zone

- Effluent drips into the ASTM C33 layer and supports unsaturated flow into the native soil. This ASTM C33/soil interface maintains soil structure, thereby maximizing the available absorption interface in the native soil. The ASTM C33 supports nitrification of the effluent, which reduces oxygen demand in the soil, thus minimizing soil clogging from anaerobic bacteria.
- The ASTM C33 layer also protects the soil from compaction and helps maintain cracks and crevices in the soil. This preserves the soil's natural infiltration capacity, which is especially important in finer textured soils, where these large channels are critical for long-term performance.
- Native soil provides final filtration and allows for groundwater recharge.

FIGURE 1: GSF SYSTEM OPERATION

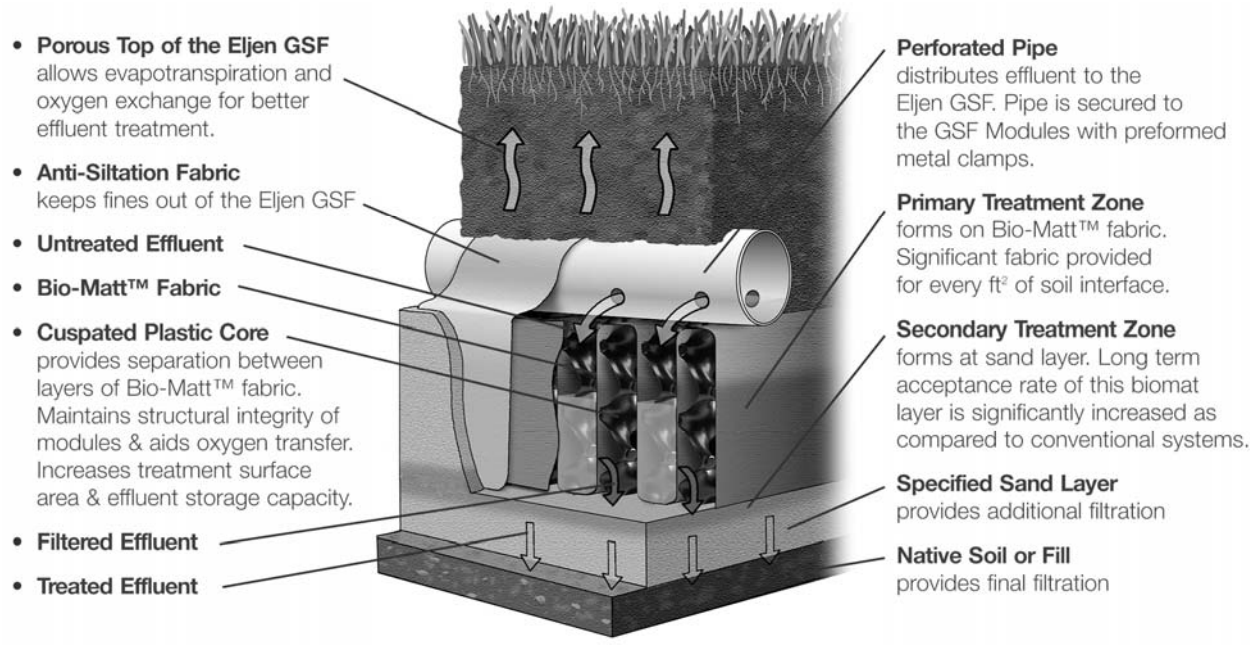

1.0 System Preconditions

1.1 REQUIREMENTS: GSF systems must meet the local rules and regulations except as outlined in this manual. The Vermont Environmental Protection Rules, Chapter 1, Wastewater System and Potable Water Supply Rules and the local regulations will be referred to as the *guidelines* in this manual. The sizing charts apply to residential systems only.

Please contact Eljen's Technical Resource Department at 1-800-444-1359 for design information on commercial systems.

1.2 WATER SOFTENER BACKWASH: At no time should water softener backwash be disposed of in the septic system. Water softener backwash should be discharged to a separate soil absorption field.

1.3 GARBAGE DISPOSALS: Eljen discourages the use of garbage disposals with septic systems. If a GSF system is to be designed and installed with garbage disposals the following measures must be taken to prevent solids from leaving the tank and entering the GSF system:

- Increase the septic tank capacity by a minimum of 50% or
- Installation of a second septic tank installed in series
- And a 50% larger leachfield

Eljen requires the use of septic tank outlet effluent filters on all systems especially on those systems that have single compartment tanks, even if up-sized, and when the dwelling has a garbage disposal installed.

1.4 ADDITIONAL FACTORS AFFECTING RESIDENTIAL SYSTEM SIZE: Homes with expected higher than normal water usage may consider increasing the septic tank volume as well as incorporating a multiple compartment septic tank. Consideration for disposal area may be up-sized for expected higher than normal water use.

For example:

- Luxury homes, homes with a Jacuzzi style tubs, and other high use fixtures.
- Homes with known higher than normal occupancy.

1.5 SYSTEM PROHIBITED AREAS: All vehicular traffic is prohibited over the GSF system. GSF systems shall not be installed under paved or concreted areas. If the system is to be installed in livestock areas, the system must be fenced off around the perimeter to prevent compaction of the cover material and damage to the system.

If the system is to be installed in livestock areas, tractored fields, close to roads, driveways, or any other places that may experience vehicular presence, the system must be fenced off.

FIGURE 2: TYPICAL A42 CROSS SECTION

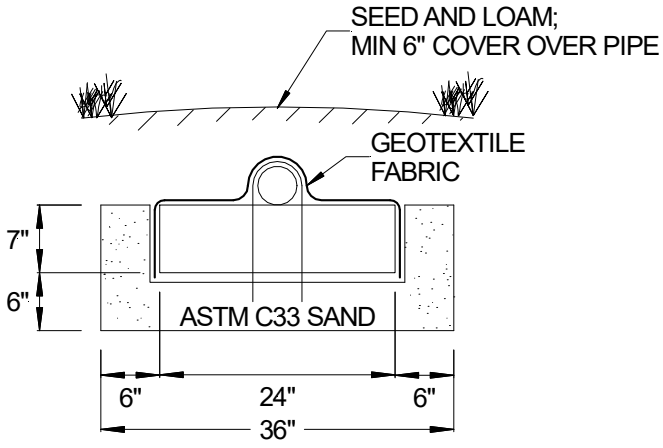

A42 MODULE (L x W x H) 48” x 24” x 7”

FIGURE 3: TYPICAL B43 CROSS SECTION

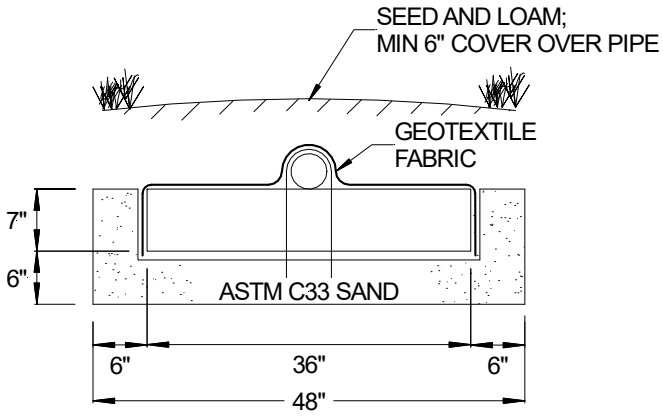

B43 MODULE (L x W x H) 48” x 36” x 7”

All systems are required to have a minimum of:

- 6 inches of ASTM C33 is at the edges of the GSF module.
- 6 inches of ASTM C33 is at the beginning and end of each GSF Row.
- 6 inches of ASTM C33 is directly below the GSF module.
- Minimum 6 inches of cover over the distribution pipe.

2.2 SEPTIC TANKS: Dual compartment tanks are recommended for all systems. Eljen supports this practice as it helps to promote long system life by reducing TSS and BOD to the effluent disposal area. Effluent filters are also required.

2.2 SEPTIC TANK FILTERS: Septic tank effluent filters are ***REQUIRED*** on the outlet end of the septic tank. Filter manufactures require that filters be cleaned from time to time. Ask your installer or designer for specific cleaning requirements based on the type or make of the filter installed. Eljen requires the septic tank to be pumped every three years or as needed which would be a good time to check and conduct filter maintenance.

2.3 VERTICAL SEPARATION TO LIMITING LAYER: The depth of mound fill material below the bottom of the unit shall be sufficient to obtain the following vertical separations:

FIGURE 4: VERTICAL SEPARATION DISTANCE

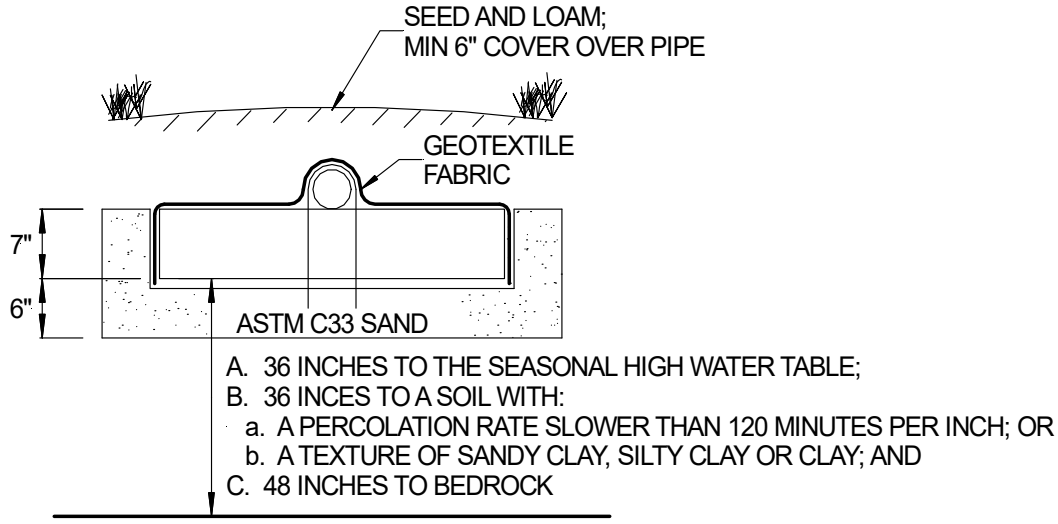

2.4 SAND SPECIFICATION FOR GSF SYSTEMS: The sand immediately under, between rows and around the perimeter of the GSF system must meet ***ASTM C33 SPECIFICATIONS, WITH LESS THAN 10% PASSING A #100 SIEVE AND LESS THAN 5% PASSING A #200 SIEVE.*** Mound Fill Material #2 or Mound Sand #2 are also acceptable. Please place a prominent note to this effect on each design drawing. See Table 1 for more information on the sand and sieve specifications. Washed concrete sand easily meets the above specification and is a reliable choice. Suitability of bank run sand must be verified.

2.5 PLACING GSF MODULES: The “painted stripe” on the GSF modules indicates the top of the module and is not intended to indicate the location of the distribution pipe. With the painted stripe facing up, all rows of GSF modules are set level, end to end on the ASTM C33 Sand layer. Beds on level sites require a minimum spacing of 12” of ASTM C33 Sand between parallel module rows with 24” of separation required on sites with 15% to 20% slope. No mechanical connection is required between modules.

2.6 DISTRIBUTION: Gravity, pump to gravity or pressure distribution are acceptable when using the GSF System. Piping shall meet the requirements guidelines; however, Eljen strongly recommends the use of SDR 35 pipe and fittings as to prevent crushing during backfill.

All systems require a perforated 4” diameter pipe centered on top of the GSF modules unless the system is curving. The distribution pipe continues along the entire length of all modules in a trench or row. Holes are set at the 4 and 8 o’clock position and secured by the Eljen provided wire clamps.

When using pressure distribution, a pressure manifold is placed inside the 4-inch distribution pipe. Section 7.0 of this manual goes into details of how to construct the distribution network. All piping must meet state and local regulations.

2.7 CONNECTIONS AND FITTINGS: Connections of lines to tanks and distribution boxes must be made using watertight mechanical seals. Use of any grouting material is not permitted.

2.8 DISTRIBUTION BOX CONNECTION: Plastic or concrete distribution boxes are acceptable. Distribution boxes must be installed level and on a compacted layer of sand or a base of gravel to prevent movement over time. Set gravity system distribution box outlet pipes 1/2" to 1/8" drop to per foot above the perforated pipe above the modules. A 2" minimum drop to the perforated pipe is required for pumped systems. Non-perforated pipes from the distribution box to the GSF modules must be placed on a compacted surface and secured with fill material that will prevent movement and settling. Dial-a-Flow fittings on outlet pipes are required for demand dosed systems.

2.9 PARALLEL DISTRIBUTION: Parallel distribution is the preferred method of dosing to a gravity or pump to gravity system. It encourages equal flows to each of the lines in the system. It is recommended for most trench systems.

2.10 SEQUENTIAL DISTRIBUTION: Sequential Distribution using a distribution box will fully utilize the uppermost section of the system prior to spilling effluent into a lower row of modules. This is for use on any site with greater than 0.5% slope when not using parallel distribution.

FIGURE 5: SEQUENTIAL DISTRIBUTION DROP–BOX DETAIL

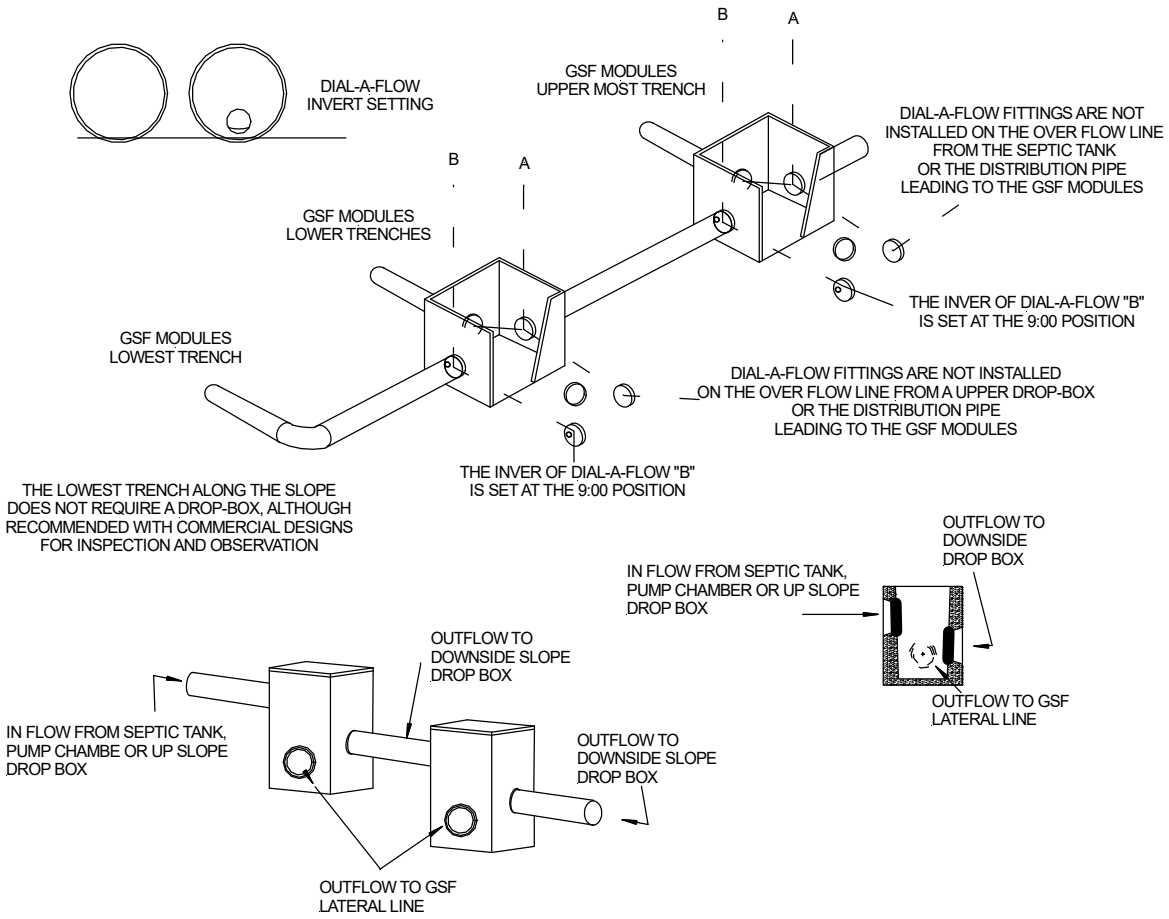

2.11 COVER FABRIC: Geotextile cover fabric is provided by Eljen Corporation for all GSF systems. It is placed over the top and sides of the module rows to prevent long term siltation and failure. **Cover fabric substitution is not allowed.** Fabric should drape vertically over the pipe and must *not* block holes in the distribution pipe or be stretched from the top of the pipe to the outside edge of the modules. "Tenting" will cause undue stress on fabric and pipe.

2.12 SYSTEM VENTING: It is required to vent all systems that are over 18" below finished grade and systems beneath any surface condition that would not allow for surface air exchange with the system such as patios. See Section 8.0 for a more detailed explanation of venting GSF products.

2.13 BACKFILL & FINISH GRADING: Complete backfill with a minimum of 6 inches of clean porous fill measured from the top of the distribution pipe. Backfill exceeding 18 inches requires venting at the far end of the trench or bed. Use well graded native soil fill that is clean, porous and devoid of large rocks. Do not use wheeled equipment over the system. A light track machine may be used with caution, avoiding crushing or shifting of pipe assembly. Divert surface runoff from the Effluent Disposal Area. Finish grade to prevent surface ponding. Place topsoil and seed system area to protect from erosion.

2.14 SYSTEM GEOMETRY: Design systems as long and narrow as practical along site contours to minimize ground water mounding especially in poorly drained low permeability soils. If possible, design level systems with equal number of modules per row.

Trenches shall be horizontally separated by at least 4 feet of naturally occurring soil.

2.15 NUMBER OF GSF MODULES REQUIRED: Tables 2 & 3 indicate the minimum number of GSF modules required for various percolation rates and number of bedrooms. At a minimum, every system shall be sized at 5 B43 modules per 150 gallons per day or 6 A42 modules per 150 gallons per day. Units may be scaled up for slower soils to improve distribution in the absorption area.

2.16 SIZING CHARTS:

TABLE 2: TRENCH SIZING CHART

Texture	Structure Type[1]	Application Rate GPD/ft^2	Minimum Trench Area Required (ft^2)				
			2 Bedroom 280 GPD	3 Bedroom 420 GPD	4 Bedroom 490 GPD	Add'l Bedrooms 70 GPD	Commercial Rate 100 GPD
Very Coarse Sand or Coarser	SG	See §1-919(b)					
Coarse Sand, Sand	SG	3.0	144	204	240	36	48
Fine Sand, Very Fine Sand, Loamy Fine Sand, Loamy Very Fine Sand	SG	2.0	144	210	245	36	50
	MA/PL	1.0	280	420	490	70	100
	PR/SBK/ ABK/GR	1.4	200	300	350	50	72
Sandy Loam, Coarse Sandy Loam	MA/PL	1.0	280	420	490	70	100
	PR/SBK/ ABK/GR	1.4	200	300	350	50	72
Fine Sandy Loam, Very Fine Sandy Loam	MA/PL	1.0	280	420	490	70	100
	PR/SBK/ ABK/GR	1.2	234	350	409	59	84
Loam	MA/PL	1.0	280	420	490	70	100
	PR/SBK/ ABK/GR	1.2	234	350	409	59	84
Silt Loam, Silt	MA/PL	0.6	467	700	817	117	167
	PR/SBK/ ABK/GR	0.8	350	525	613	88	125
Sandy Clay Loam, Clay Loam, Silty Clay Loam	MA/PL	0.5	560	840	980	140	200
	PR/SBK/ ABK/GR	0.6	467	700	817	117	167
Sandy Clay, Clay, Silty Clay		See §1-926					

1. The abbreviations used for structure are: SG = single grain; GR = granular; MA = massive; PL = platy; PR = prismatic; ABK = angular blocky; SBK = subangular blocky.

TABLE 3: BED SIZING CHART

Texture	Structure Type[1]	Application Rate GPD/ft^2	Minimum Bed Area Required (ft^2)				
			2 Bedroom 280 GPD	3 Bedroom 420 GPD	4 Bedroom 490 GPD	Add'l Bedrooms 70 GPD	Commercial Rate 100 GPD
Very Coarse Sand or Coarser	SG	See §1-919(b)					
Coarse Sand, Sand	SG	2.4	144	204	240	36	48
Fine Sand, Very Fine Sand, Loamy Fine Sand, Loamy Very Fine Sand	SG	1.6	175	263	307	44	63
	MA/PL	0.8	350	525	613	88	125
	PR/SBK/ ABK/GR	1.2	234	350	409	59	84
Sandy Loam, Coarse Sandy Loam	MA/PL	0.8	350	525	613	88	125
	PR/SBK/ ABK/GR	1.2	234	350	409	59	84
Fine Sandy Loam, Very Fine Sandy Loam	MA/PL	0.8	350	525	613	88	125
	PR/SBK/ ABK/GR	1.0	280	420	490	70	100
Loam	MA/PL	0.8	350	525	613	88	125
	PR/SBK/ ABK/GR	1.0	280	420	490	70	100
Silt Loam, Silt	MA/PL	0.4	700	1050	1225	175	250
	PR/SBK/ ABK/GR	0.6	467	700	817	117	167
Sandy Clay Loam, Clay Loam, Silty Clay Loam	MA/PL	0.4	700	1050	1225	175	250
	PR/SBK/ ABK/GR	0.4	700	1050	1225	175	250
Sandy Clay, Clay, Silty Clay		See §1-926					

1. The abbreviations used for structure are: SG = single grain; GR = granular; MA = massive; PL = platy; PR = prismatic; ABK = angular blocky; SBK = subangular blocky.

Trench Example:

House size: 3 Bedrooms
Soil description: Loamy fine sand, subangular blocky
Absorption field type: Trench

Calculate the Bottom Area Required

Lookup the information required from Table 2:

Texture	Structure Type[1]	Application Rate GPD/ft^2	Minimum Trench Area Required (ft^2)				
			2 Bedroom 280 GPD	3 Bedroom 420 GPD	4 Bedroom 490 GPD	Add'l Bedrooms 70 GPD	Commercial Rate 100 GPD
Fine Sand, Very Fine Sand, Loamy Fine Sand, Loamy Very Fine Sand	SG	2.0	144	210	245	36	50
	MA/PL	1.0	280	420	490	70	100
	PR/SBK/ ABK/GR	1.4	200	300	350	50	72

Calculate the Minimum Modules Required

Minimum Trench Area Required ÷ ft^2 per module

A42: 210 ft^2 ÷ 12 ft^2/module = 17.5 A42s
A42: Round up to 18 A42s

B43: 210 ft^2 ÷ 16 ft^2/module = 13.1 B43s
B43: Round up to 14 B43s

Calculate Minimum Trench Length

Modules Required x 4 + 1 ft

A42: 18 Units x 4 + 1 ft = 73 linear feet
B43: 14 Units x 4 + 1 ft = 57 linear feet

Trench Width

A42: 3 ft
B43: 4 ft

Final Dimension Layout

(Note: System layout and number of rows will vary based on site constraints)

A42

Min. Trench Length	73 ft
Trench Width	3 ft
Minimum Number of Units	18 A42 modules
Designed Absorption Area	219 ft^2

B43

Min. Trench Length	57 ft
Trench Width	4 ft
Minimum Number of Units	14 A42 modules
Designed Absorption Area	228 ft^2

FIGURE 6: PLAN VIEW –TRENCH SYSTEM EXAMPLE

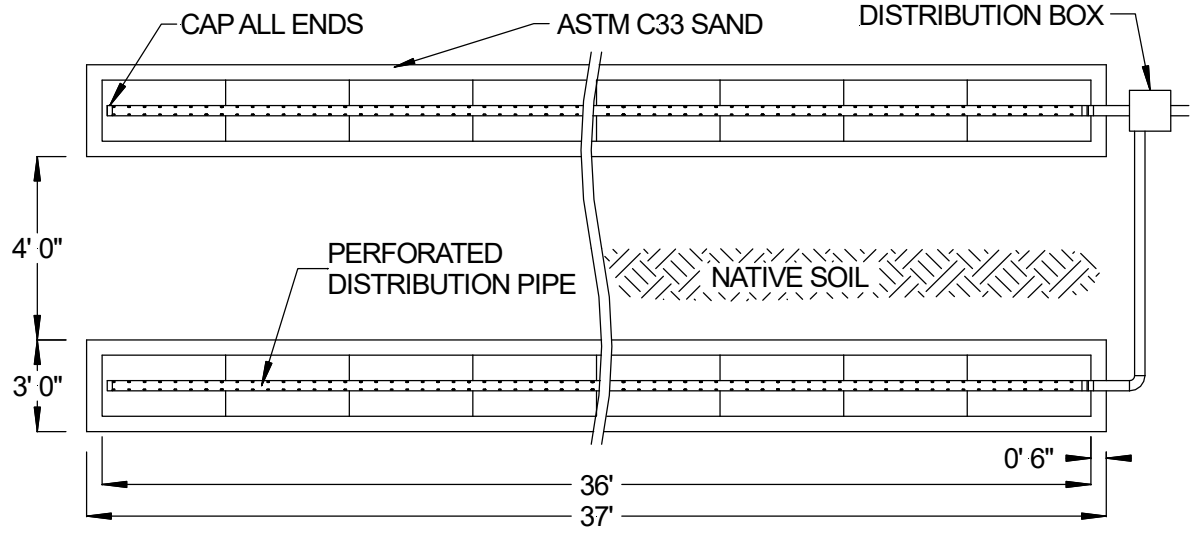

(*2 Rows of 9 A42's shown in Figure 6)

FIGURE 7: SECTION VIEW – TRENCH SYSTEM EXAMPLE – LEVEL SITE

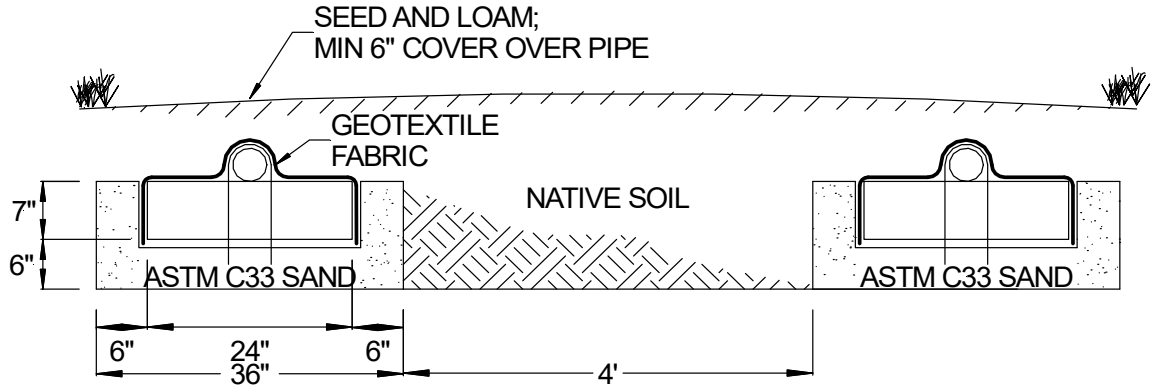

FIGURE 8: SECTION VIEW – TRENCH SYSTEM – SLOPING SITE

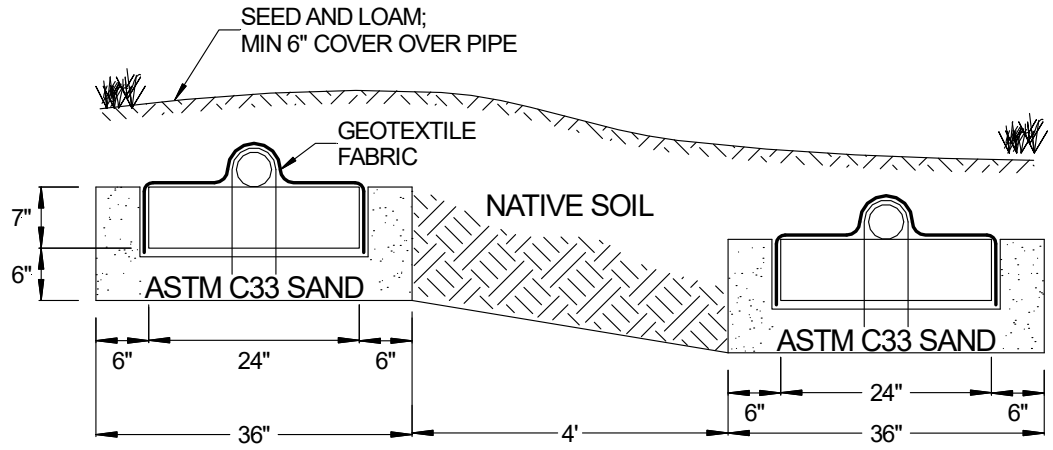

3.0 Trench Installation Sizing and Guidelines

1. Ensure all components leading to the GSF system are installed properly. Septic tank effluent filters are required with the GSF system.

2. Determine the number of GSF Modules required using the trench sizing example.

3. Prepare the site. Do not install a system on saturated ground or wet soils that are smeared during excavation. Keep machinery off infiltrative areas.

4. Plan all drainage requirements above (up-slope) of the system. Set soil grades to ensure that storm water drainage and ground water is diverted away from the absorption area once the system is complete.

5. Excavate the trench; prepare the receiving layer to maximize the interface between the native soil and ASTM C33 Sand.

6. Minimize walking in the trench prior to placement of the ASTM C33 Sand to avoid soil compaction.

7. Place ASTM C33 Sand in a 6" lift and stabilize by foot, a hand held tamping tool or a portable vibrating compactor. The minimum stabilized height below the GSF module must be level at 6".

8. Place GSF modules with **PAINTED STRIPE FACING UP**, end to end on top of the ASTM C33 Sand along their 4-foot length.

9. A standard 4-inch perforated pipe, SDR 35 or equivalent, is centered along the modules 4-foot length. Orifices are set at the 4 & 8 o'clock position.

10. All 4-inch pipes are secured with manufacturers supplied wire clamps, one per module.

11. (Pressure Distribution Systems) Insert a pressure pipe (size per design and code) into the standard 4-inch perforated pipe. The pressure pipe orifices are set at the 12 o'clock position as shown in Figure 14. Each pressure lateral will have a drain hole at the 6 o'clock position. Each pressure lateral shall include sweeping cleanouts at the terminal ends and be accessible from grade.

12. ***Cover fabric substitution is not allowed.*** The installer should lay the Eljen provided geotextile cover fabric lengthwise down the trench, with the fabric fitted to the perforated pipe on top of the GSF modules. Fabric should be neither too loose, nor too tight. The correct tension of the cover fabric is set by:
    a. Spreading the cover fabric over the top of the module and down both sides of the module with the cover fabric tented over the top of the perforated distribution pipe.
    b. Place shovelfuls of ASTM C33 Sand directly over the pipe area allowing the cover fabric to form a mostly vertical orientation along the sides of the pipe. Repeat this step moving down the pipe.

13. Place the sand extensions along both sides of the modules edge. A minimum of 6 inches of ASTM C33 Sand is placed at the beginning and end of each trench.

14. Complete backfill with a minimum of 6 inches of clean porous fill measured from the top of the distribution pipe. Backfill exceeding 18 inches requires venting at the far end of the trench. Use well graded native soil fill that is clean, porous and devoid of large rocks. Do not use wheeled equipment over the system. A light track machine may be used with caution, avoiding crushing or shifting of pipe assembly.

15. Divert surface runoff from the system. Finish grade to prevent surface ponding. Topsoil and seed system area to protect from erosion.

Bed Example:

House size: 3 Bedrooms
Soil description: Loamy fine sand, subangular blocky
Absorption field type: Bed

Calculate Minimum Bed Area Required

Lookup the information required from Table 3:

Texture	Structure Type[1]	Application Rate GPD/ft^2	Minimum Bed Area Required (ft^2)				
			2 Bedroom 280 GPD	3 Bedroom 420 GPD	4 Bedroom 490 GPD	Add'l Bedrooms 70 GPD	Commercial Rate 100 GPD
Fine Sand, Very Fine Sand, Loamy Fine Sand, Loamy Very Fine Sand	SG	1.6	175	263	307	44	63
	MA/PL	0.8	350	525	613	88	125
	PR/SBK/ ABK/GR	1.2	234	350	409	59	84

Minimum Basal Area required **263 ft^2**

Calculate Minimum Number of Modules Required

Application Rate GPD/ft^2	A42 Modules per 150 gpd	B43 Modules per 150 gpd
2.4	6	5
1.6	7	6
1.2	8	7
1.0	9	8
0.8	10	9
0.6	11	10
0.4	13	11

GPD ÷ 150 GPD x modules per 150 GPD

A42: 420 GPD ÷ 150 GPD x 7 = 19.6 A42s B43: 420 GPD ÷ 150 GPD x 6 = 16.8 B43s
A42: Round up to 20 A42s B43: Round up to 17 B43s

Calculate Minimum Bed Length

Maintain a minimum of 2 rows in a bed system.

A42: 20 modules ÷ 2 rows = 10 modules/row B43: 17 modules ÷ 2 rows = 8.5 modules/row
B43: Round up to 9 modules/row

Calculate Minimum Row Length

A42: 10 modules x 4 + 1 ft 41 linear feet B43: 9 modules x 4 + 1 ft 37 linear feet

Bed Width

Bed Width = Basal Area Required ÷ Bed Length

A42: 263 ft^2 ÷ 41 ft = 6.4 ft B43: 263 ft^2 ÷ 37 ft = 7.1 ft
A42: Round up to 6.5 ft B43: Round up to 7.5 ft

Determine Lateral Spacing

Lateral to Lateral Spacing = Bed Width ÷ Number of Rows

A42: 6.5 ft ÷ 2 rows = 3.25 ft B43: 7.5 ft ÷ 2 rows = 3.75 ft

Lateral to Edge Spacing = Lateral to Lateral Spacing ÷ 2

A42: 3.25 ft ÷ 2 = 1.625 ft B43: 3.75 ft ÷ 2 = 1.875 ft

Final Dimension Layout

(Note: System layout and number of rows will vary based on site constraints)

A42

Bed Length	41 ft
Bed Width	6.5 ft
Minimum Number of Units	20 A42 modules
Modules per row	10 modules
Lateral to Lateral Spacing	3.25 ft.
Lateral to Edge Spacing	1.625 ft.
System Area	266.5 ft^2

B43

Bed Length	37 ft
Bed Width	7.5 ft
Minimum Number of Units	18 B43 modules
Modules per row	9 modules
Lateral to Lateral Spacing	3.75 ft.
Lateral to Edge Spacing	1.875 ft.
System Area	277.5 ft^2

FIGURE 9: PLAN VIEW – BED SYSTEM EXAMPLE – LEVEL SITE

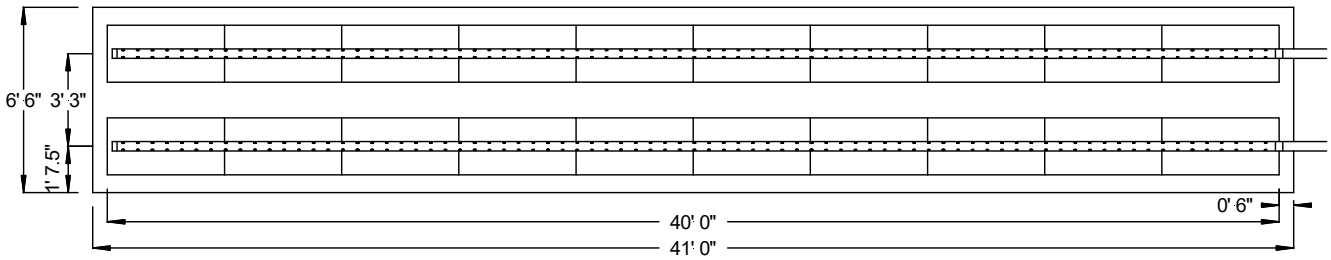

FIGURE 10: SECTION VIEW – BED SYSTEM EXAMPLE

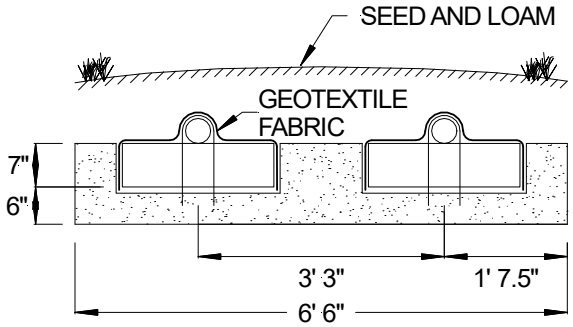

FIGURE 11: SECTION VIEW – BED SYSTEM EXAMPLE – SLOPING SITE

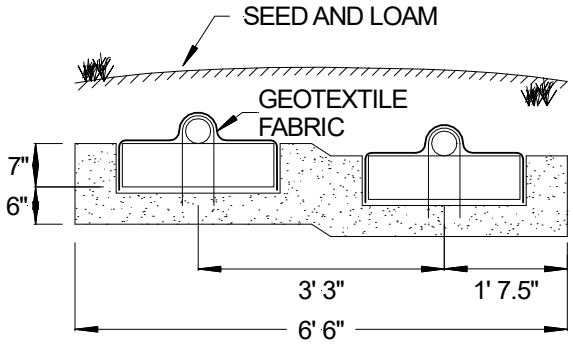

4.0 Bed Installation Sizing and Guidelines

1. Ensure all components leading to the GSF system are installed properly. Septic tank effluent filters are required with the GSF system.

2. Determine the number of GSF Modules required using the bed sizing example.

3. Prepare the site. Do not install a system on saturated ground or wet soils that are smeared during excavation. Keep machinery off infiltrative areas.

4. Plan all drainage requirements above (up-slope) of the system. Set soil grades to ensure that storm water drainage and ground water is diverted away from the absorption area once the system is complete.

5. Excavate the bed absorption area; prepare the receiving layer to maximize the interface between the native soil and ASTM C33 Sand.

6. Minimize walking in the absorption area prior to placement of the ASTM C33 Sand to avoid soil compaction.

7. Place ASTM C33 Sand in 6" lifts, stabilize by foot, a hand held tamping tool or a portable vibrating compactor. The minimum stabilized height below the GSF module must be level at 6".

8. Place GSF modules with **PAINTED STRIPE FACING UP**, end to end on top of the ASTM C33 Sand along their 4-foot length.

9. A standard 4-inch perforated pipe, SDR 35 or equivalent, is centered along the modules 4-foot length. Orifices are set at the 4 & 8 o'clock position.

10. All 4-inch pipes are secured with manufacturers supplied wire clamps, one per module.

11. (Pressure Distribution Systems) Insert a pressure pipe (size per design and code) into the standard 4-inch perforated pipe. The pressure pipe orifices are set at the 12 o'clock position as shown in Figure 14. Each pressure lateral will have a drain hole at the 6 o'clock position. Each pressure lateral shall include sweeping cleanouts at the terminal ends and be accessible from grade.

12. ***Cover fabric substitution is not allowed.*** The installer should lay the Eljen provided geotextile cover fabric lengthwise down the row, with the fabric fitted to the perforated pipe on top of the GSF modules. Fabric should be neither too loose, nor too tight. The correct tension of the cover fabric is set by:
    a. Spreading the cover fabric over the top of the module and down both sides of the module with the cover fabric tented over the top of the perforated distribution pipe.
    b. Place shovelfuls of ASTM C33 Sand directly over the pipe area allowing the cover fabric to form a mostly vertical orientation along the sides of the pipe. Repeat this step moving down the pipe.

13. Place 6 inches of ASTM C33 Sand along both sides of the modules edge. A minimum of 6 inches of ASTM C33 Sand is placed at the beginning and end of each module row. Beds on level sites require a minimum spacing of 12" of ASTM C33 Sand between parallel module rows with 24" of separation required on sites with 15% to 20% slope. No mechanical connection is required between modules.

14. Complete backfill with a minimum of 6 inches of clean porous fill measured from the top of the pipe. Backfill exceeding 18 inches requires venting at the far end of the bed. Use well graded native soil fill that is clean, porous and devoid of large rocks. Do not use wheeled equipment over the system. A light track machine may be used with caution, avoiding crushing or shifting of pipe assembly.

15. Divert surface runoff from the system. Finish grade to prevent surface ponding. Topsoil and seed system area to protect from erosion.

5.1 MOUND REFERENCE: The following guidelines provide an overview for mound design and construction. Mound distribution can either be gravity, pump to gravity or pressurized.

FIGURE 12: CROSS SECTION – MOUND SYSTEM
*Note: Design Can Utilize Either B43 or A42 Modules

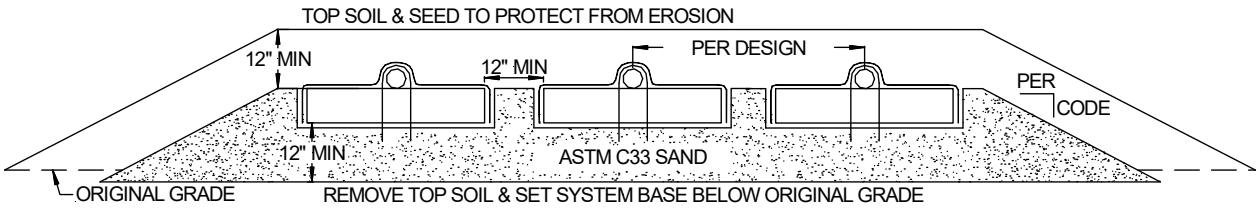

FIGURE 13: CROSS SECTION – SLOPED MOUND SYSTEM
*Note: Design Can Utilize Either B43 or A42 Modules

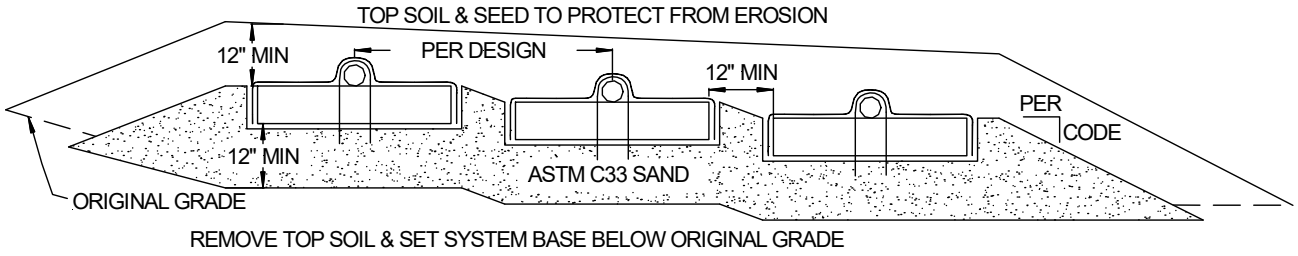

5.0 Mound Installation Guidelines

1. Ensure all components leading to the GSF system are installed properly. Septic tank effluent filters are required with the GSF system.

2. Determine the number of GSF Modules required using the sizing formula.

3. Prepare the site. Do not install a system on saturated ground or wet soils that are smeared during preparation. Keep machinery off infiltrative areas.

4. Plan all drainage requirements above (up-slope) of the system. Set soil grades to ensure that storm water drainage and ground water is diverted away from the absorption area once the system is complete.

5. Remove the organic soil layer. Prepare the receiving layer to maximize the interface between the native soil and ASTM C33 Sand. Minimize walking in the absorption area prior to placement of the ASTM C33 Sand to avoid soil compaction.

6. Place fill material meeting local requirements (or ASTM C33 Sand requirements) onto the soil interface as you move down the excavated area. Place ASTM C33 Sand in a 6" lift, stabilize by foot, a hand held tamping tool or a portable vibrating compactor. The stabilized height below the GSF module must shall meet the mound design requirements.

7. Place GSF modules with **PAINTED STRIPE FACING UP**, end to end on top of the ASTM C33 Sand along their 4-foot length.

8. A standard perforated 4-inch distribution pipe is centered along the modules 4-inch length. Orifices are set at the 4 & 8 o'clock position.

9. All distribution pipes are secured with manufacturers supplied wire clamps, one per module.

10. (Pressure Distribution Systems) Insert a PVC Sch. 40 pressure pipe (size per design and code) into the standard perforated distribution pipe. The pressure pipe orifices are set at the 12 o'clock position as shown in Figure 14. Each pressure lateral will have a drain hole at the 6 o'clock position. Each pressure lateral shall include sweeping cleanouts at the terminal ends and be accessible from grade.

11. ***Cover fabric substitution is not allowed.*** The installer should lay the Eljen provided geotextile cover fabric lengthwise down the row, with the fabric fitted to the perforated pipe on top of the GSF modules. Fabric should be neither too loose, nor too tight. The correct tension of the cover fabric is set by:
    a. Spreading the cover fabric over the top of the module and down both sides of the module with the cover fabric tented over the top of the perforated distribution pipe.
    b. Place shovelfuls of ASTM C33 Sand directly over the pipe area allowing the cover fabric to form a mostly vertical orientation along the sides of the pipe. Repeat this step moving down the pipe.

12. Ensure there is 6 inches of ASTM C33 Sand surrounding the GSF modules in the mound. Slope the sand away from the mound as described on the plan.

13. Complete backfill with a minimum of 6 inches of cover material measured from the top of the distribution pipe. Use well graded native soil fill that is clean, porous and devoid of large rocks. Do not use wheeled equipment over the system. A light track machine may be used with caution, avoiding crushing or shifting of pipe assembly. Divert surface runoff from the system. Finish grade to prevent surface ponding. Topsoil and seed system area to protect from erosion.

14. Divert surface runoff from the system. Finish grade to prevent surface ponding. Topsoil and seed system area to protect from erosion.

6.0 Dosing Distribution Guidance

6.1 PUMP TO DISTRIBUTION BOX: Specify an oversized distribution box for pumped dosed systems. Provide velocity reduction in the d-box with a tee or baffle. Set d-box outlets at the same elevation to equalize flow to each line or use drop boxes at the head of each line for serial distribution. If the absorption area is installed deeper than 18 inches, the system must be vented. See section 8.0 of this manual for detailed information on venting of systems.

6.2 DOSING DESIGN AND FLOW RATE: Dosing volume must be set to deliver a maximum of 4 gallons per B43 Module and 3 gallons per A42 Module per dosing cycle. Higher flow rates and short dose cycle push the effluent down the line and thus disperse the effluent over a larger area. A valve on the force main is recommended to set the flow rate so that the outlet pipes are submerged but prevents the d-box from over flowing.

7.0 Pressure Distribution Guidance

7.1 PRESSURE DISTRIBUTION: Dosing with small diameter pressurized laterals is acceptable for GSF systems. The pipe networks must be engineered and follow principles established for pressure distribution. Using pipe-in-pipe networks as shown in Figure 14, the orifice size and spacing of 3/16 inch and 4 feet is respectively recommended. Flushing ports are required to maintain the free flow of effluent from orifices at the distal ends of each lateral. Contact Eljen's Technical Resource Department at 1-800-444-1359 for more information on pressure distribution systems

Standard procedures for design of pressure distribution networks apply to the GSF filter. A minimum orifice size according to the regulations shall be maintained. A drain hole is required at the 6 o'clock position of each pressure lateral for drainage purposes. The lateral pipe network, constructed of PVC Sch. 40 pipe *(size per design and code),* is placed within a standard 4-inch perforated pipe. The perforation in the 4-inch outer pipe are set at the 4 and 8 o'clock position, the drilled orifices on the pressure pipe are set to spray at the 12 o'clock position directly to the top of the 4-inch perforated pipe as shown below. Pressure clean outs are required at the end of each lateral.

FIGURE 14: PRESSURE PIPE PLACEMENT

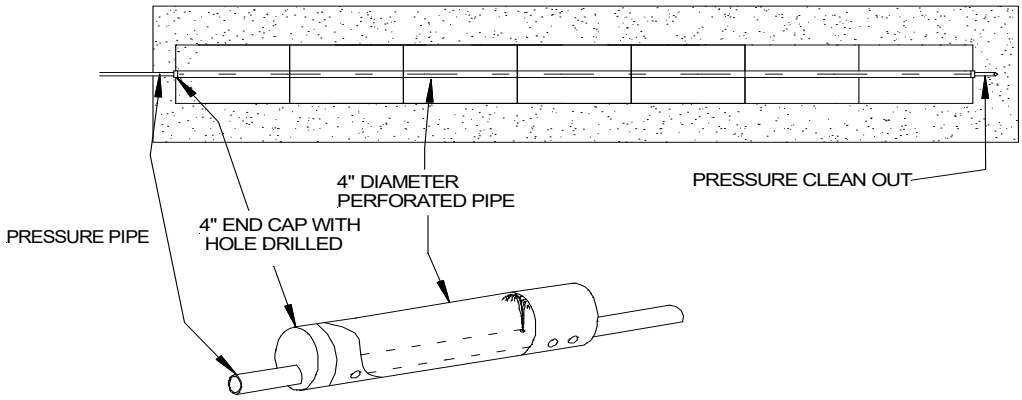

PRESSURE PIPE CROSS SECTION FOR ALL APPLICATIONS



FIGURE 15: PRESSURE CLEAN OUT

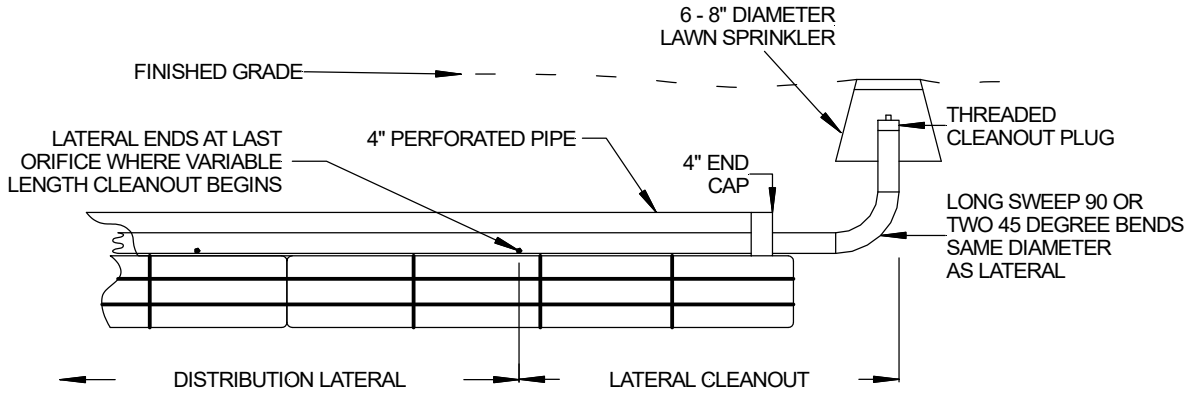

FIGURE 16: CONTOURED TRENCH PRESSURE DISTRIBUTION

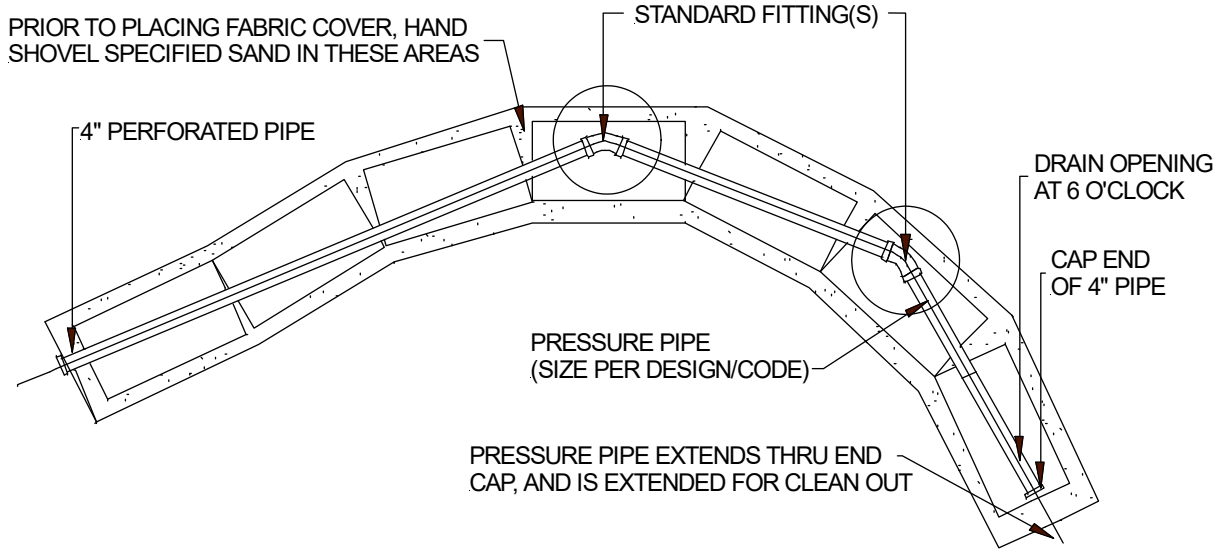

GSF Pressure Distribution trench placed on a contour or winding trenches to maintain horizontal separation distances may also be used in Dosed or Gravity system by removing the pressure pipe and using the 4-inch diameter perforated distribution pipe.

8.1 SYSTEM VENTILATION: Air vents are required on all absorption systems located under impervious surfaces or systems **with *more than 18 inches of cover material*** as measured from the top of the distribution pipe to finished grade. This will ensure proper aeration of the modules and sand filter. The GSF has aeration channels between the rows of GSF modules connecting to cuspations within the GSF modules. Under normal operating conditions, only a fraction of the filter is in use. The unused channels remain open for intermittent peak flows and the transfer of air.

8.2 VENT PIPE FOR GRAVITY AND LOW-PRESSURE SYSTEMS: Systems with over 18" of cover over the top of the distribution pipes require a vent. If the system is a low-pressure distribution system, ensure that the LPP clean outs are located in the vent for easy access.

FIGURE 17: VENT LAYOUTS FOR GRAVITY AND LOW-PRESSURE SYSTEMS

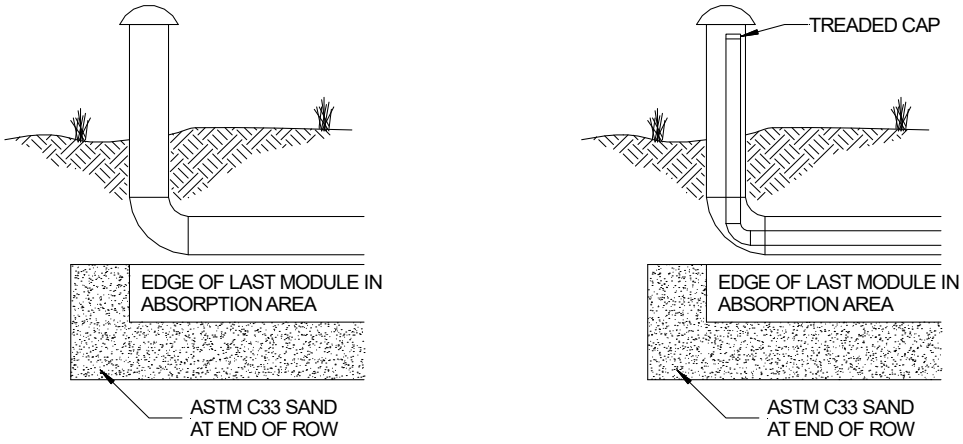

8.3 VENTILATION PLACEMENT: In a GSF system, the vent is usually a 4-inch diameter pipe extended to a convenient location behind shrubs, as shown in the figure below. Corrugated pipe may be used. If using corrugated pipe, ensure that the pipe does not have any bends that will allow condensation to pond in the pipe. This may close off the vent line. The pipe must have an invert higher than the system so that it does not drain effluent.

FIGURE 18: GSF WITH 4" VENT EXTENDED TO CONVENIENT LOCATION

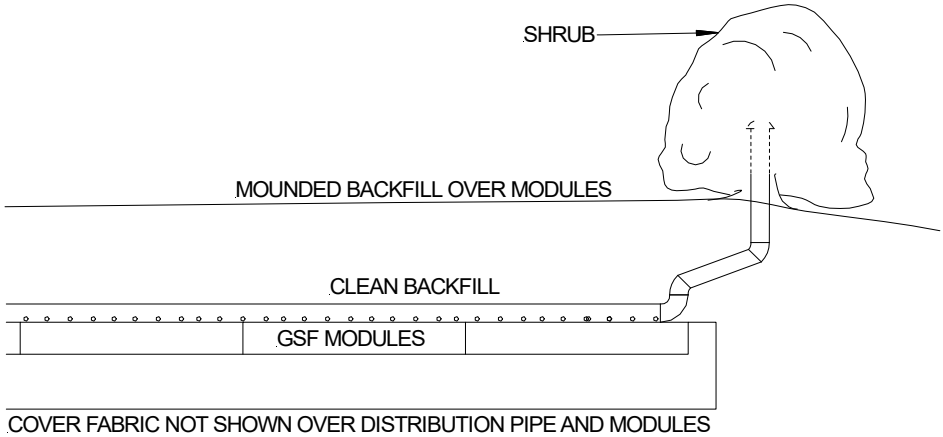

COMPANY HISTORY

Established in 1970, Eljen Corporation created the world's first prefabricated drainage system for foundation drainage and erosion control applications. In the mid-1980s, we introduced our Geotextile Sand Filter products for the passive advanced treatment of onsite wastewater in both residential and commercial applications. Today, Eljen is a global leader in providing innovative products and solutions for protecting our environment and public health.

COMPANY PHILOSOPHY

Eljen Corporation is committed to advancing the onsite industry through continuous development of innovative new products, delivering high quality products and services to our customers at the best price, and building lasting partnerships with our employees, suppliers, and customers.

eljen CORPORATION

90 Meadow Road, Windsor, CT 06095 • Tel: 800-444-1359 • Fax: 860-610-0427

www.eljen.com

Printed in U.S.A. on recycled paper