


Joes Pond (Danville) Station 1 Temperature and Dissolved Oxygen Profiles on 6/1/2017

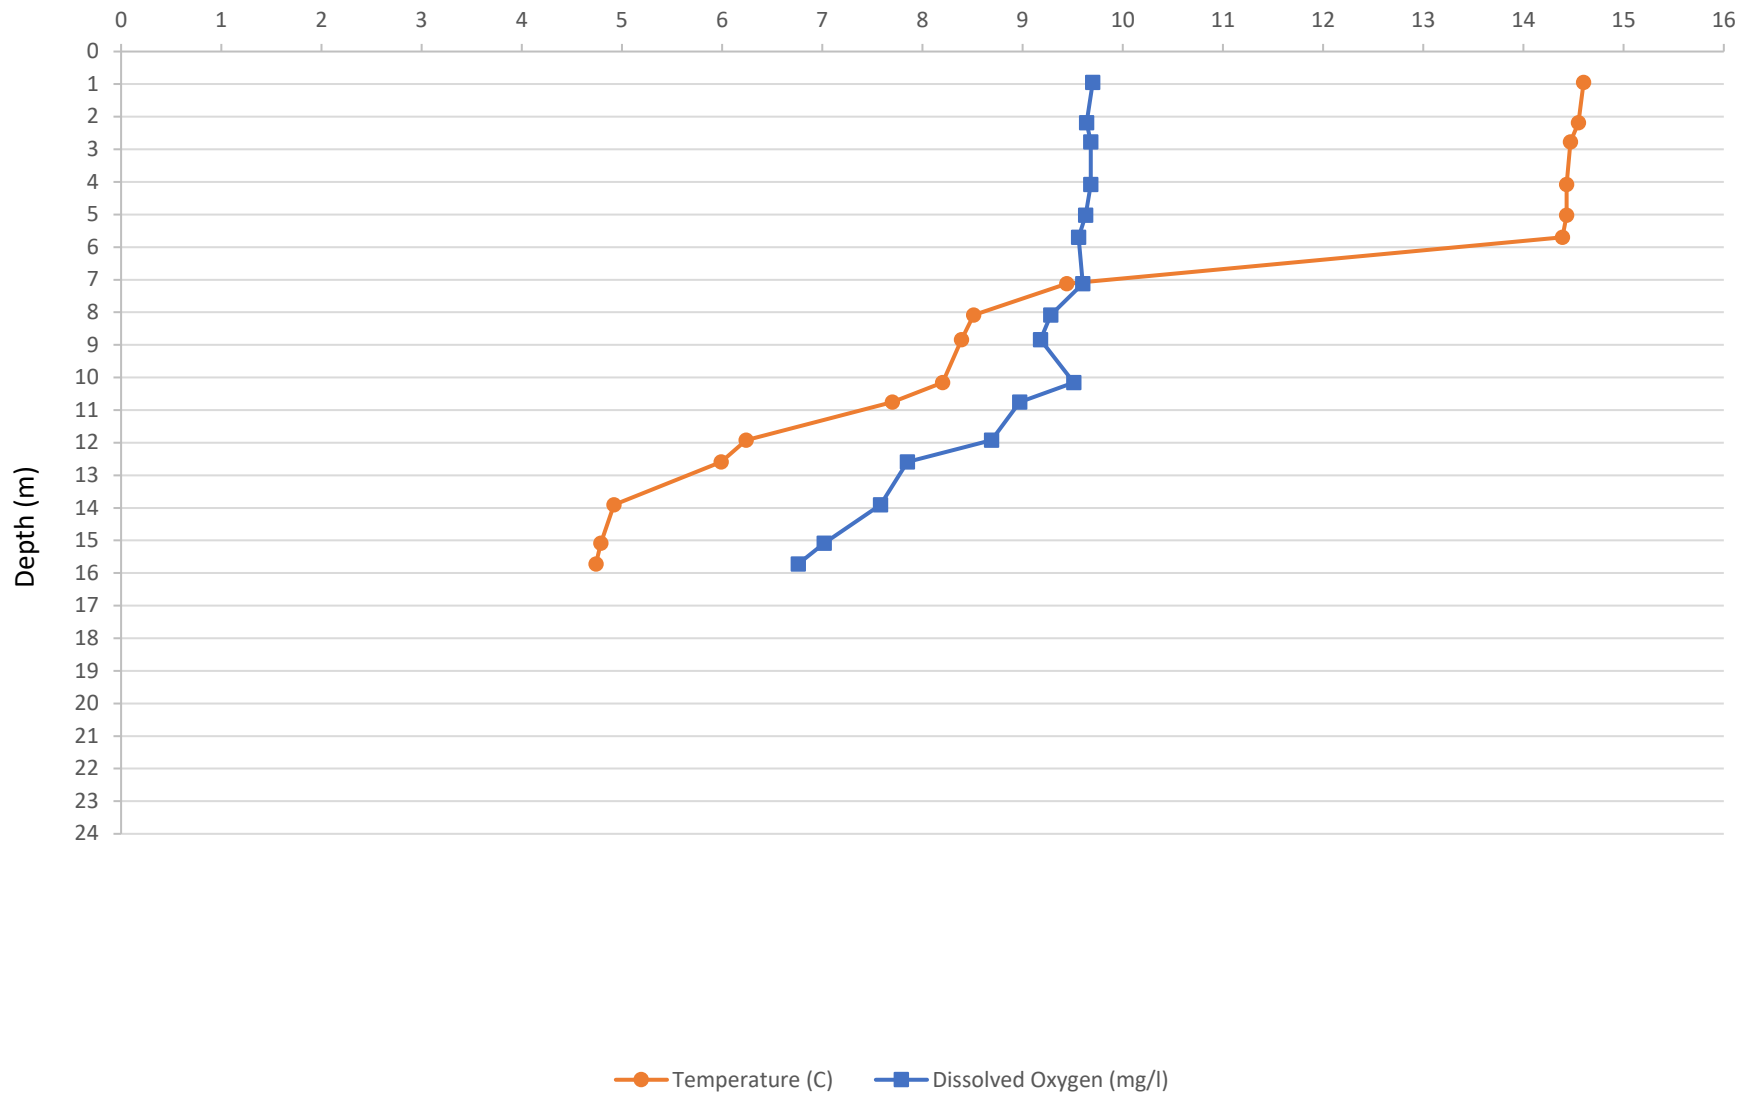

LayMonID	Station	Date	Time	Depth (m)	Temp (C)	pH	Conductivity (uS/cm)	Dissolved Oxygen %	Dissolved Oxygen (mg/l)
JOESD	1	6/01/2017	13:15:49	0.95	14.6	7.46	90.3	96.1	9.7
JOESD	1	6/01/2017	13:16:37	2.18	14.55	7.38	90.1	95.4	9.64
JOESD	1	6/01/2017	13:19:05	2.77	14.47	7.42	90.4	95.6	9.68
JOESD	1	6/01/2017	13:19:58	4.08	14.43	7.36	90.3	95.6	9.68
JOESD	1	6/01/2017	13:22:29	5.02	14.43	7.38	90.1	95.1	9.63
JOESD	1	6/01/2017	13:22:54	5.7	14.39	7.36	90.3	94.3	9.56
JOESD	1	6/01/2017	13:24:53	7.12	9.44	7.27	83.5	84.6	9.6
JOESD	1	6/01/2017	13:26:44	8.08	8.51	7.01	85.3	79.9	9.28
JOESD	1	6/01/2017	13:26:38	8.84	8.39	6.99	86.8	78.9	9.18
JOESD	1	6/01/2017	13:36:25	10.16	8.2	7.19	86.6	81.4	9.51
JOESD	1	6/01/2017	13:36:49	10.75	7.7	7.11	89.2	75.9	8.97
JOESD	1	6/01/2017	13:37:42	11.92	6.24	7.03	100.7	70.8	8.69
JOESD	1	6/01/2017	13:38:08	12.59	5.99	6.97	103.1	63.5	7.85
JOESD	1	6/01/2017	13:38:44	13.91	4.92	6.92	111.7	59.7	7.58
JOESD	1	6/01/2017	13:39:17	15.08	4.79	6.87	113.1	55.1	7.02
JOESD	1	6/01/2017	13:39:42	15.72	4.74	6.85	113.6	53	6.76